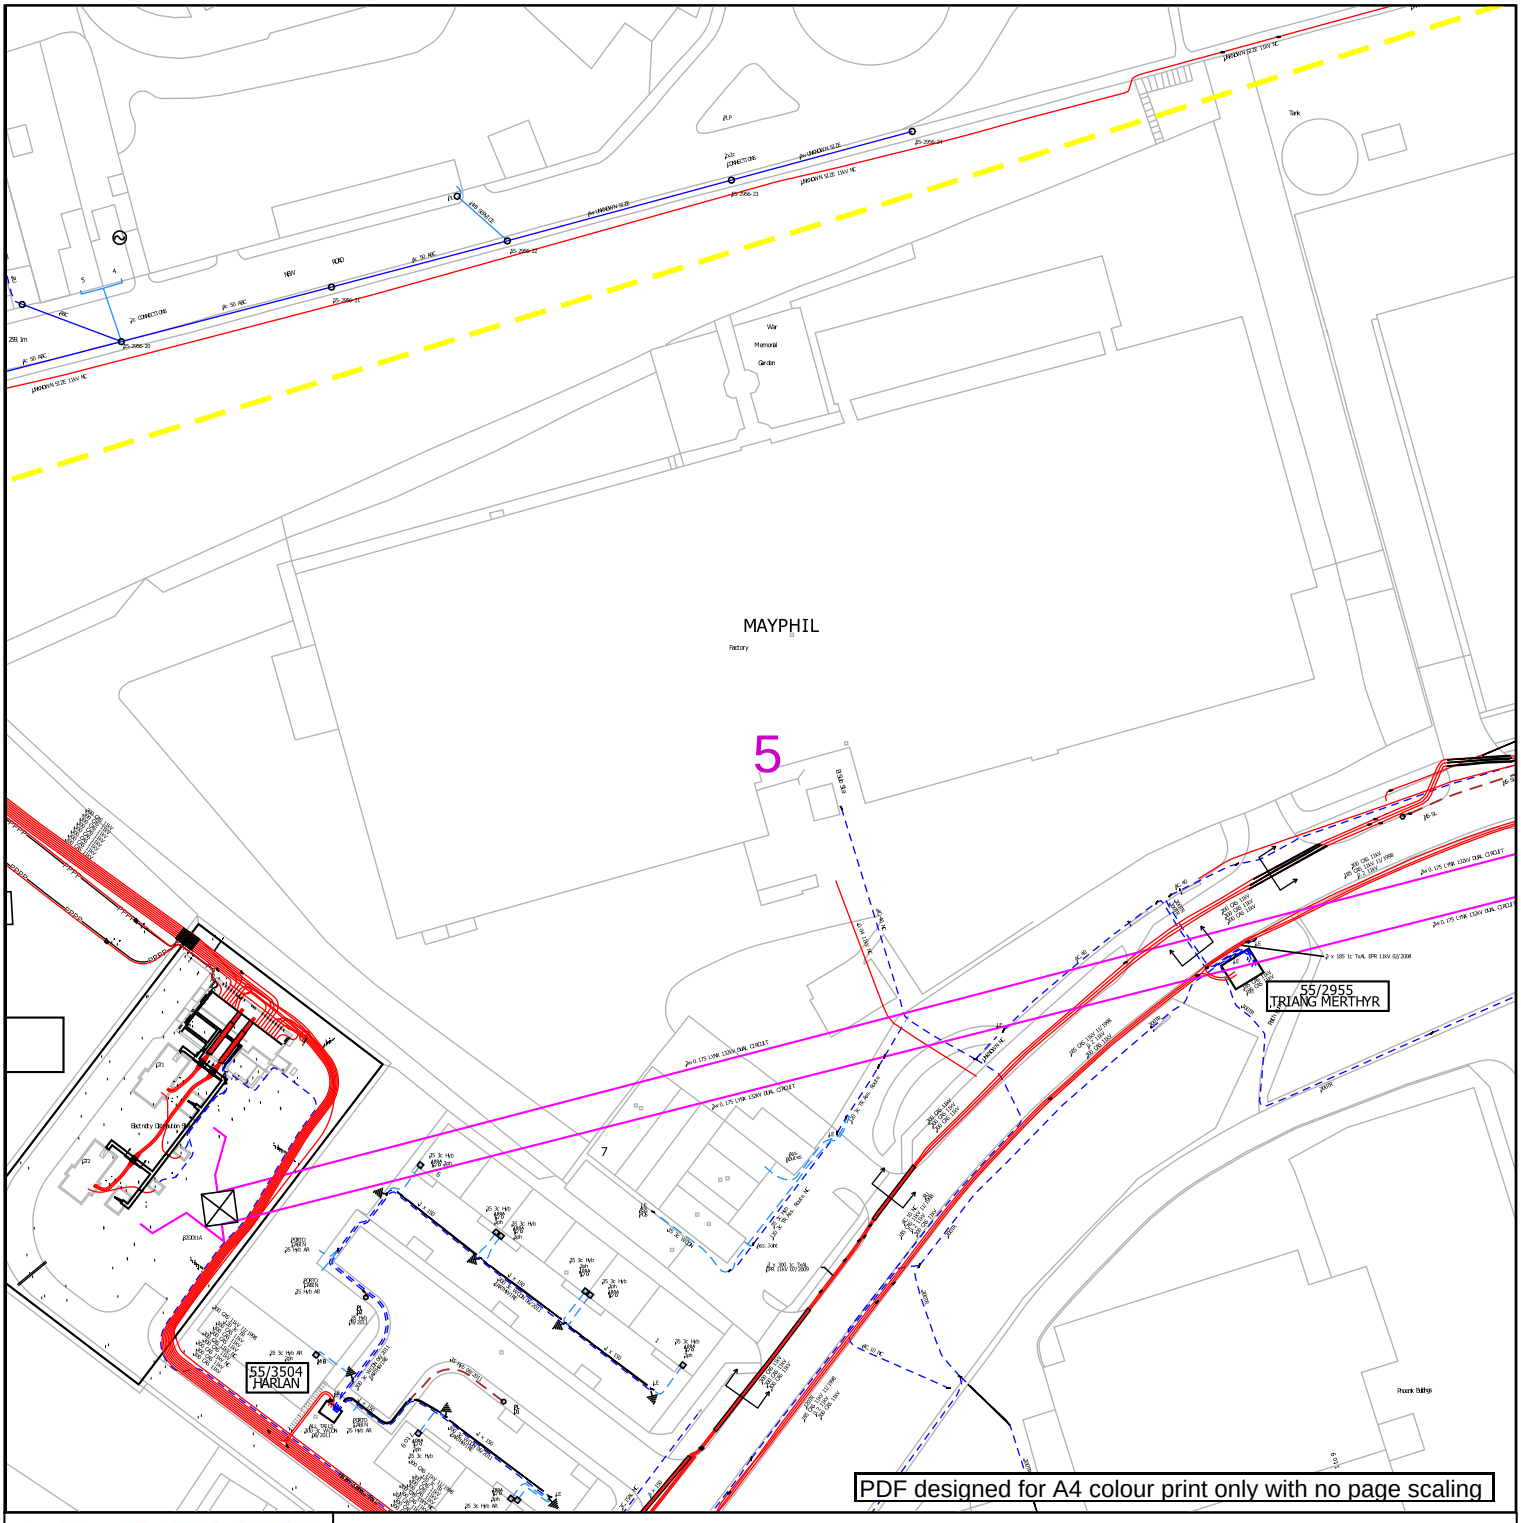


nationalgrid Electricity Distribution

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables

Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer
PME Earth
Underground Earth

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543


Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

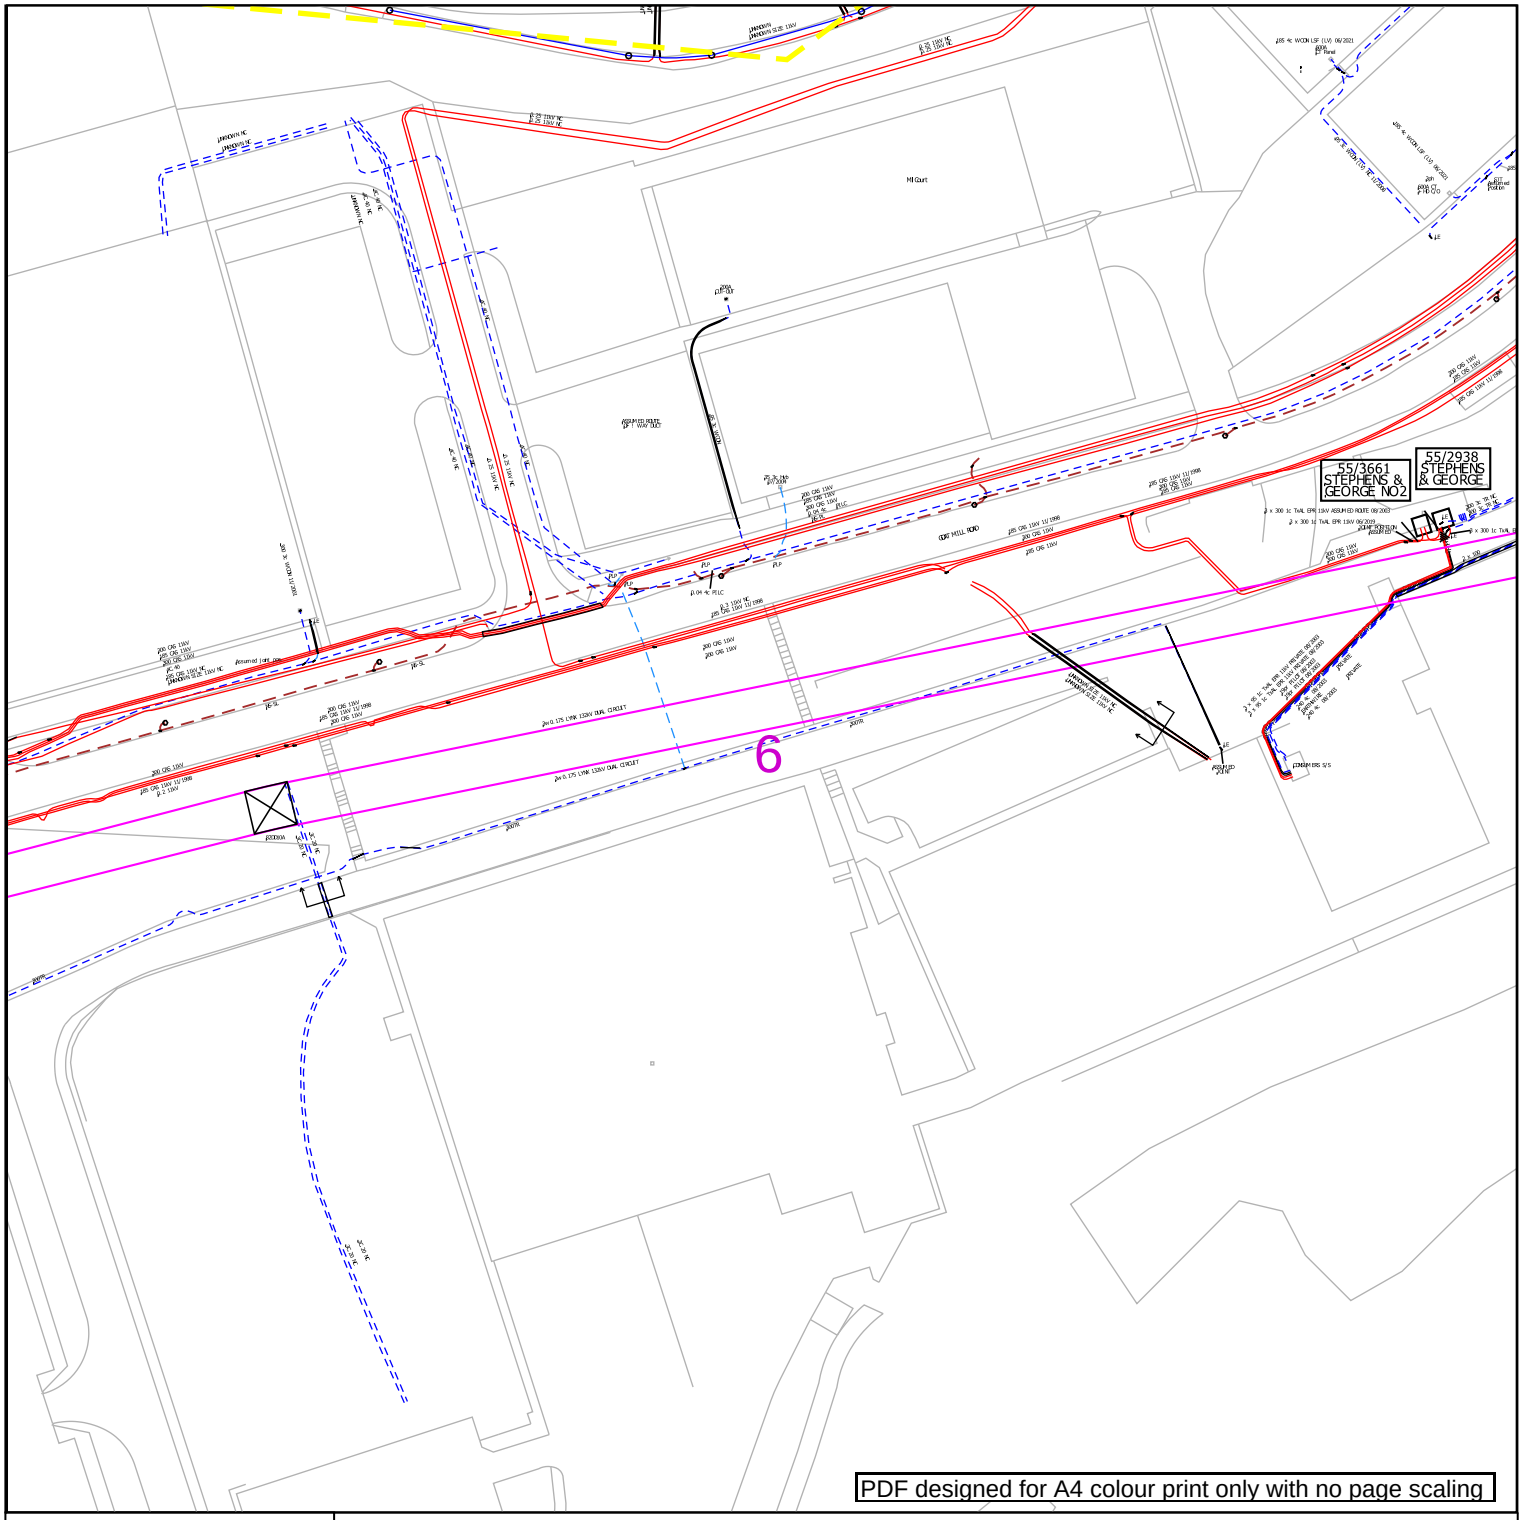

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer

Ground Mounted Transformer

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543


Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

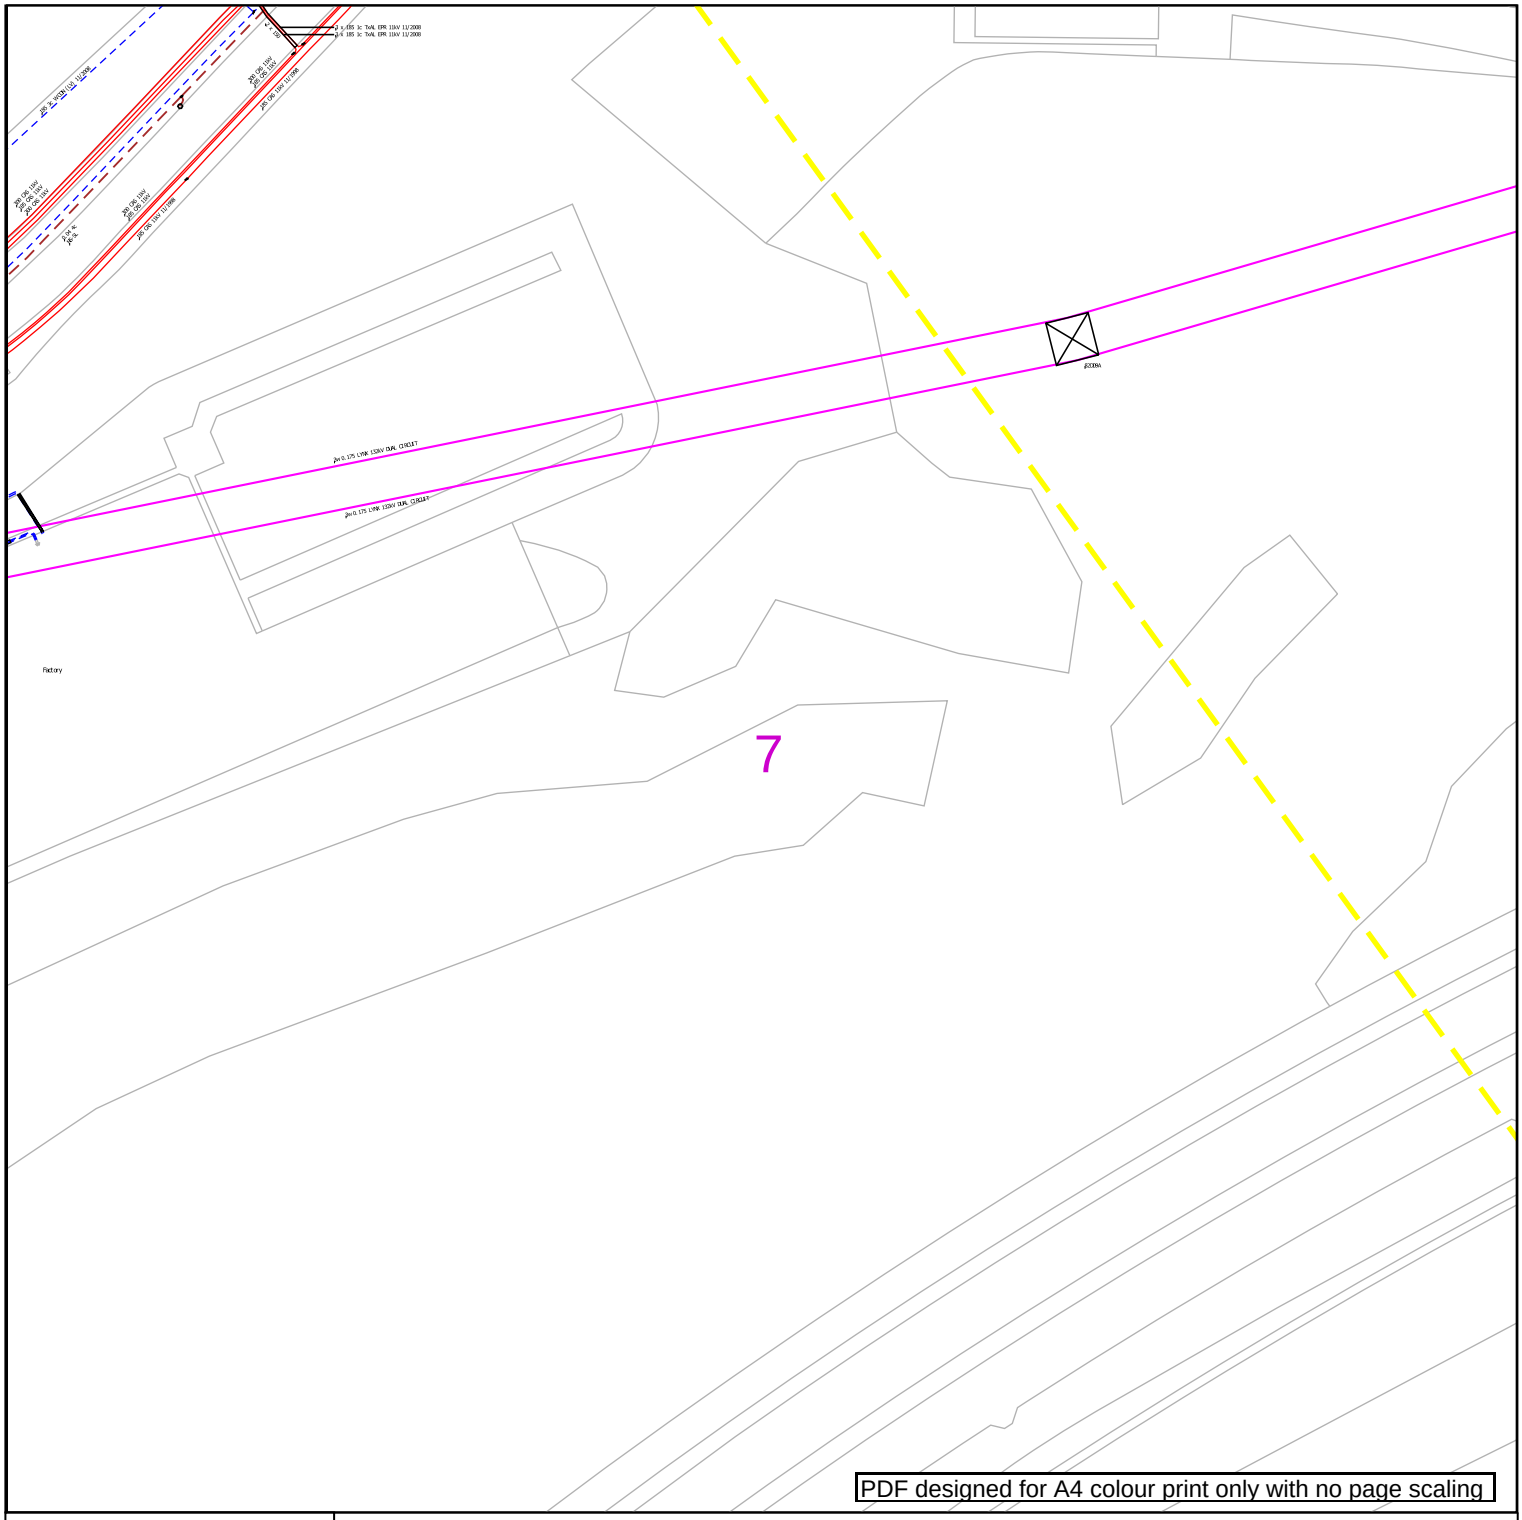

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer


Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

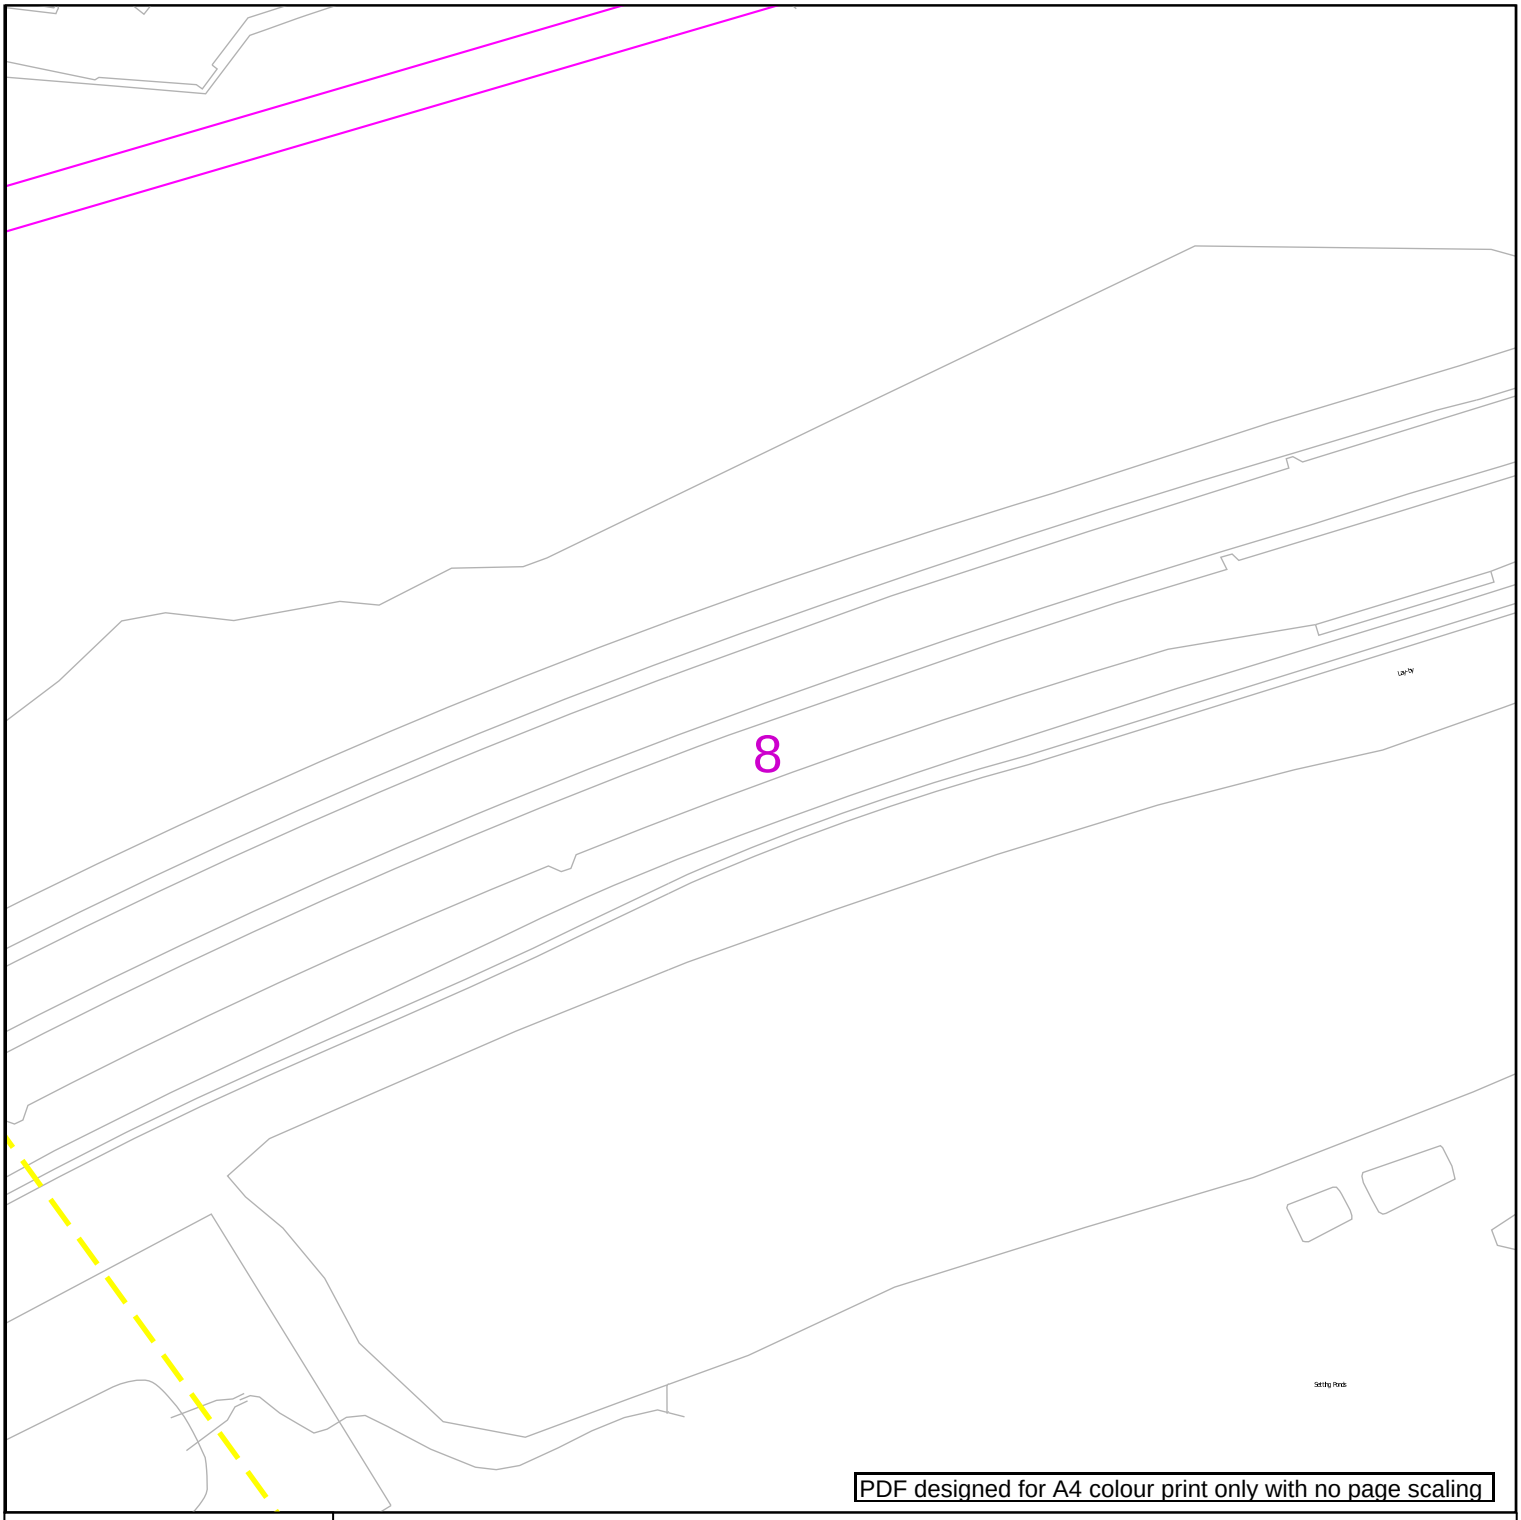

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer


Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

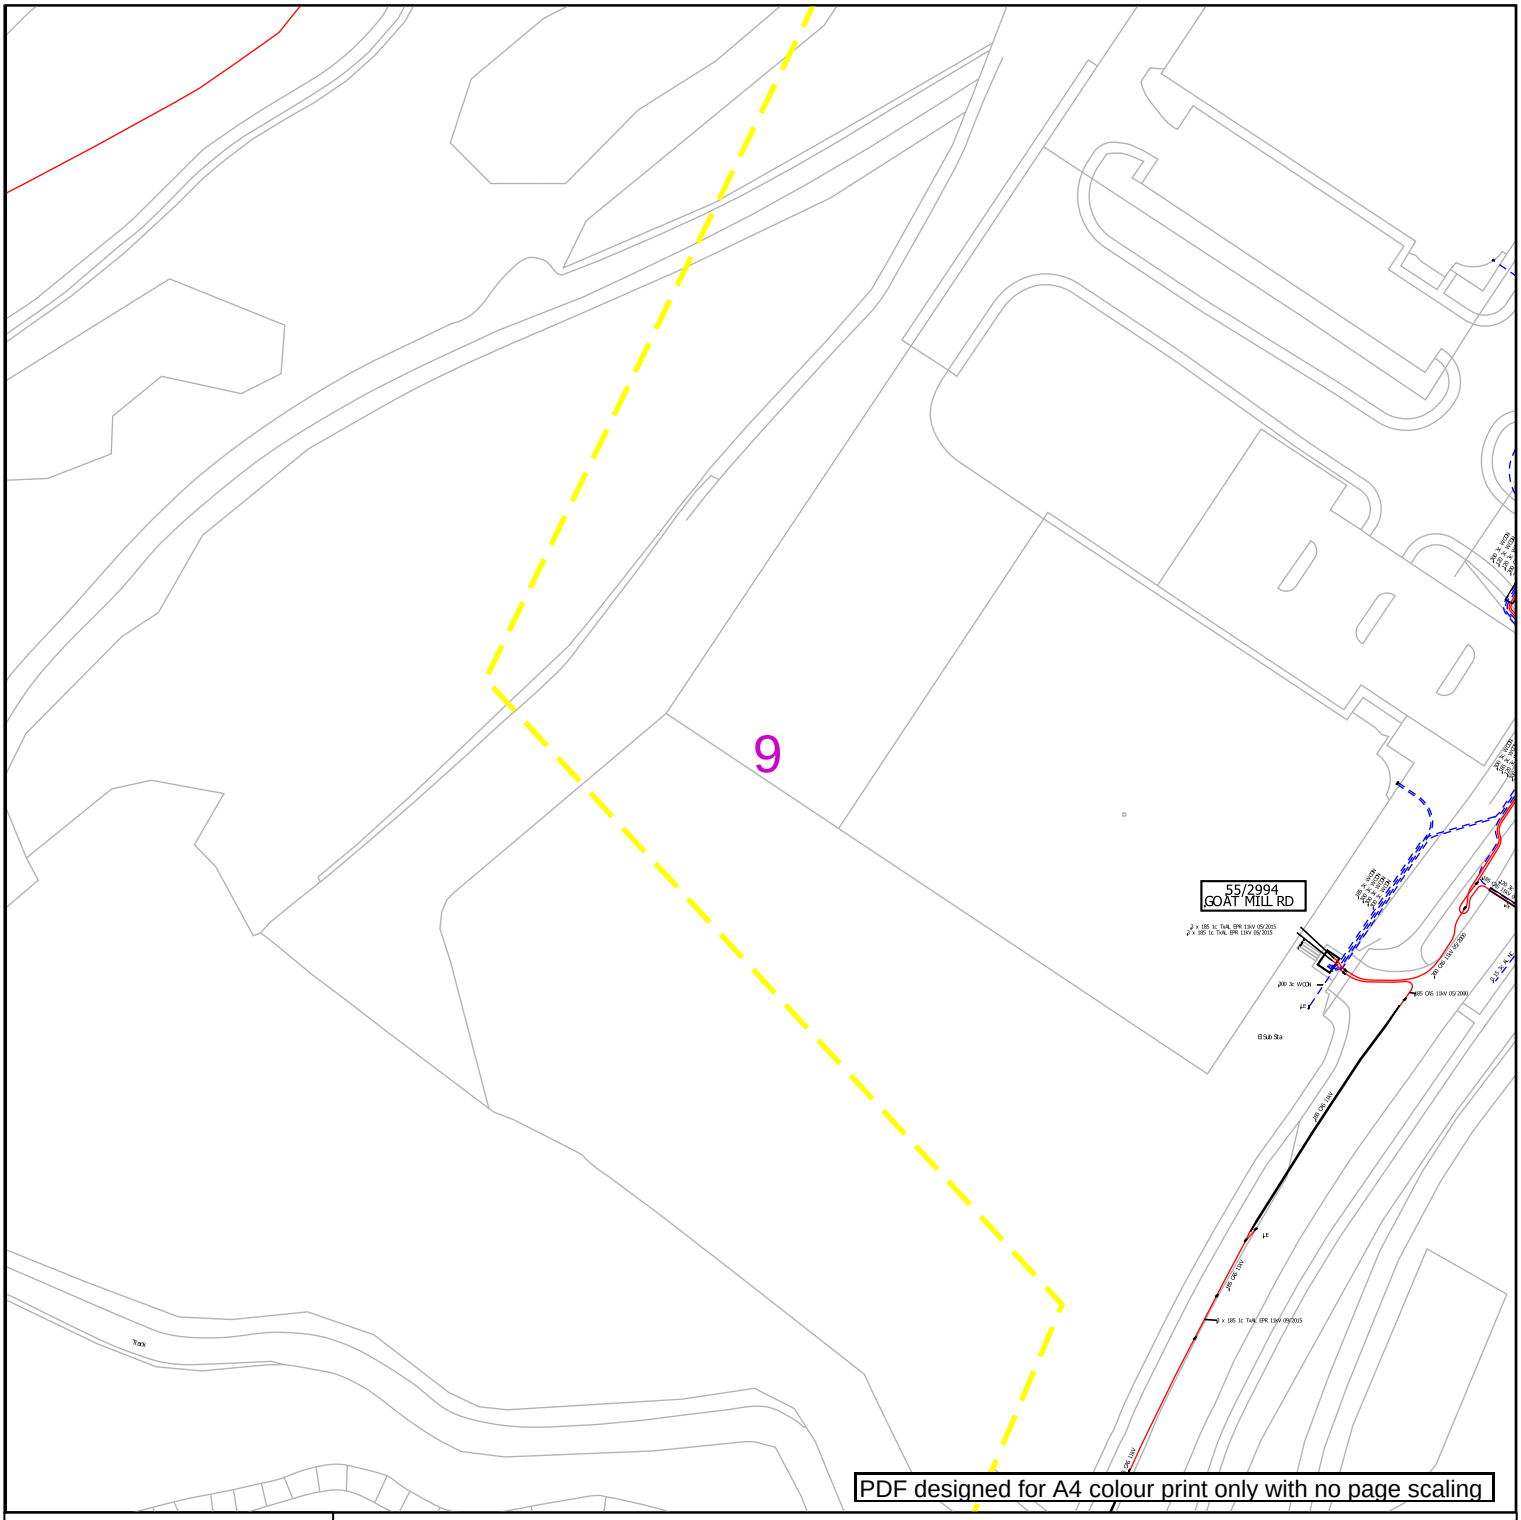

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer


Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

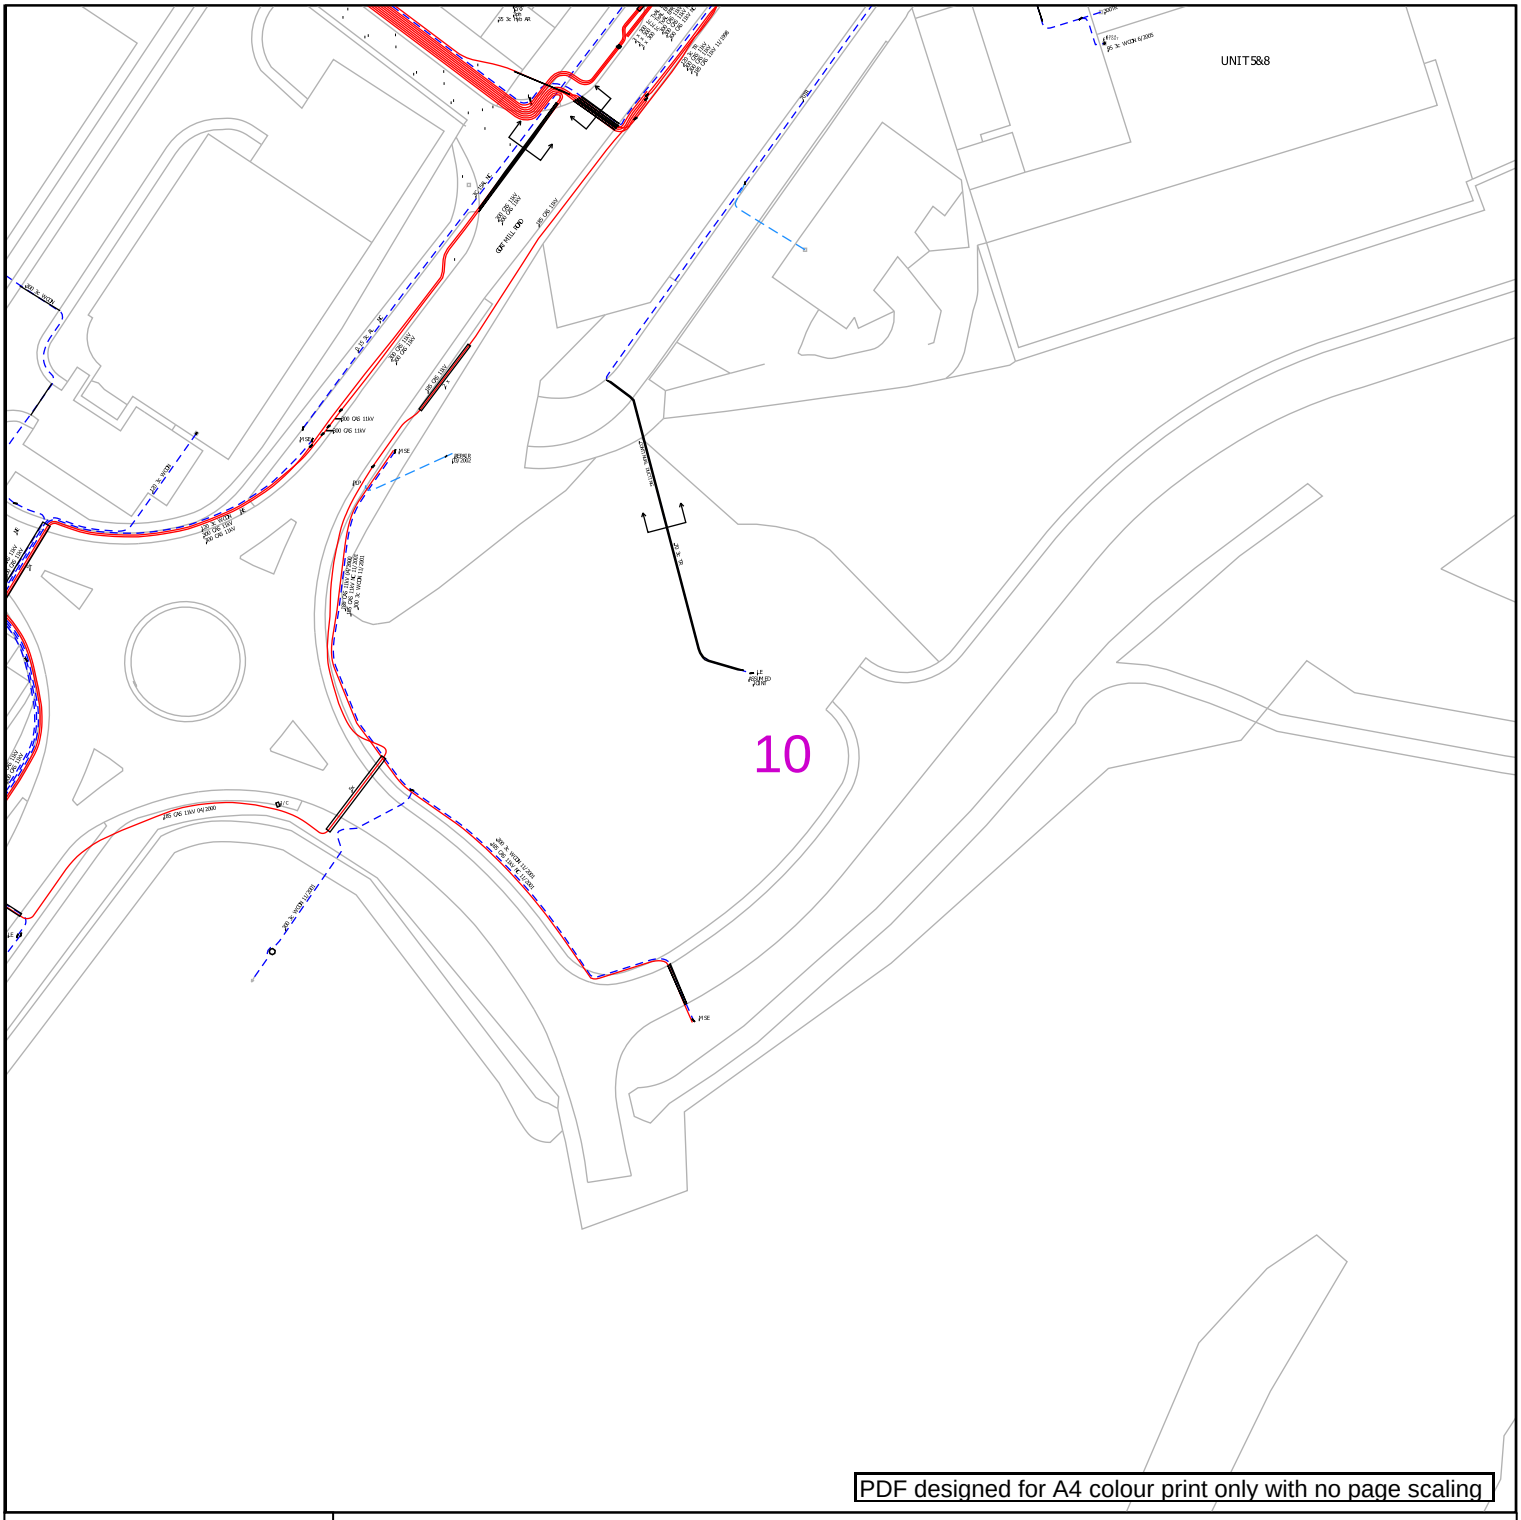

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer

Ground Mounted Transformer

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543


Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

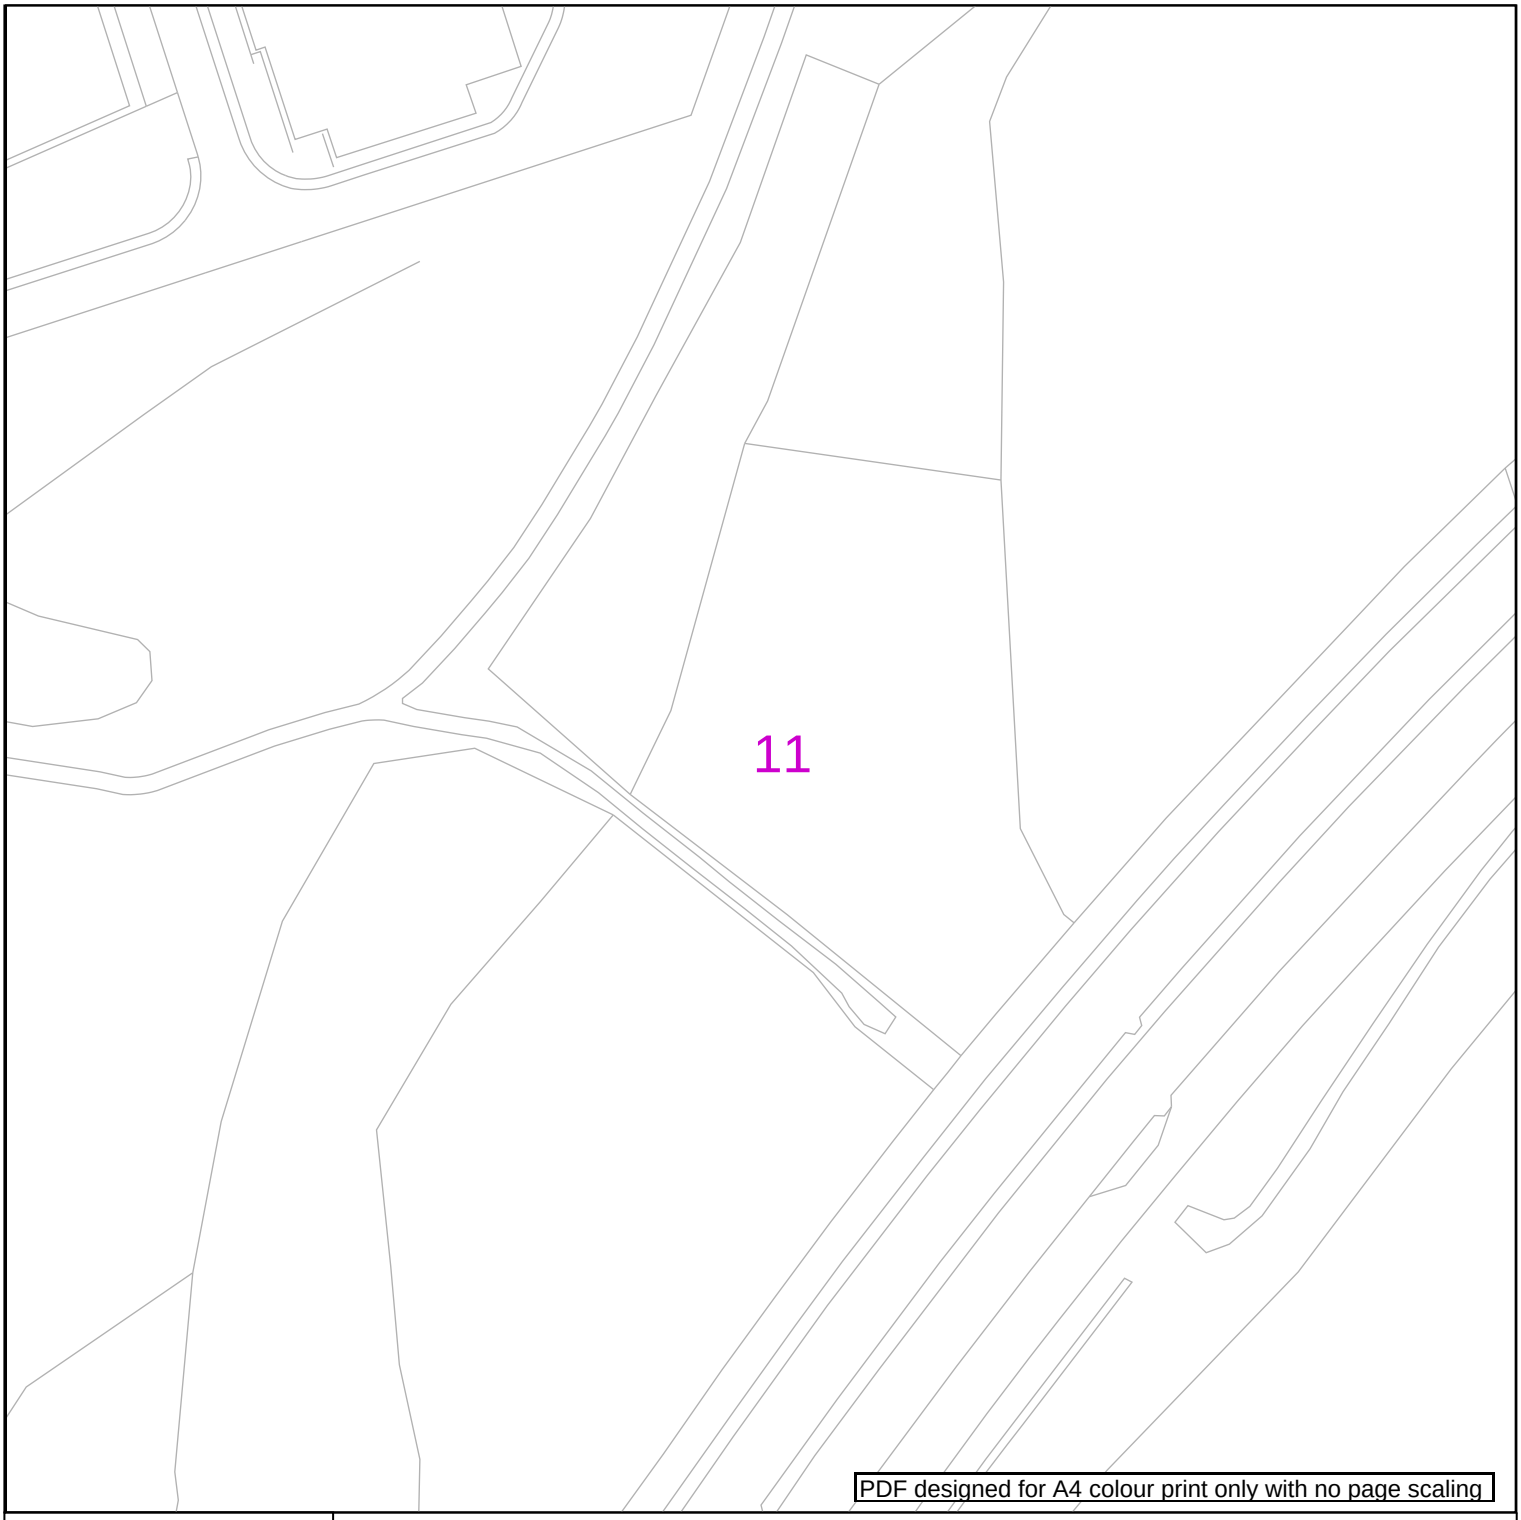

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables

PME Earth
Underground Earth


Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

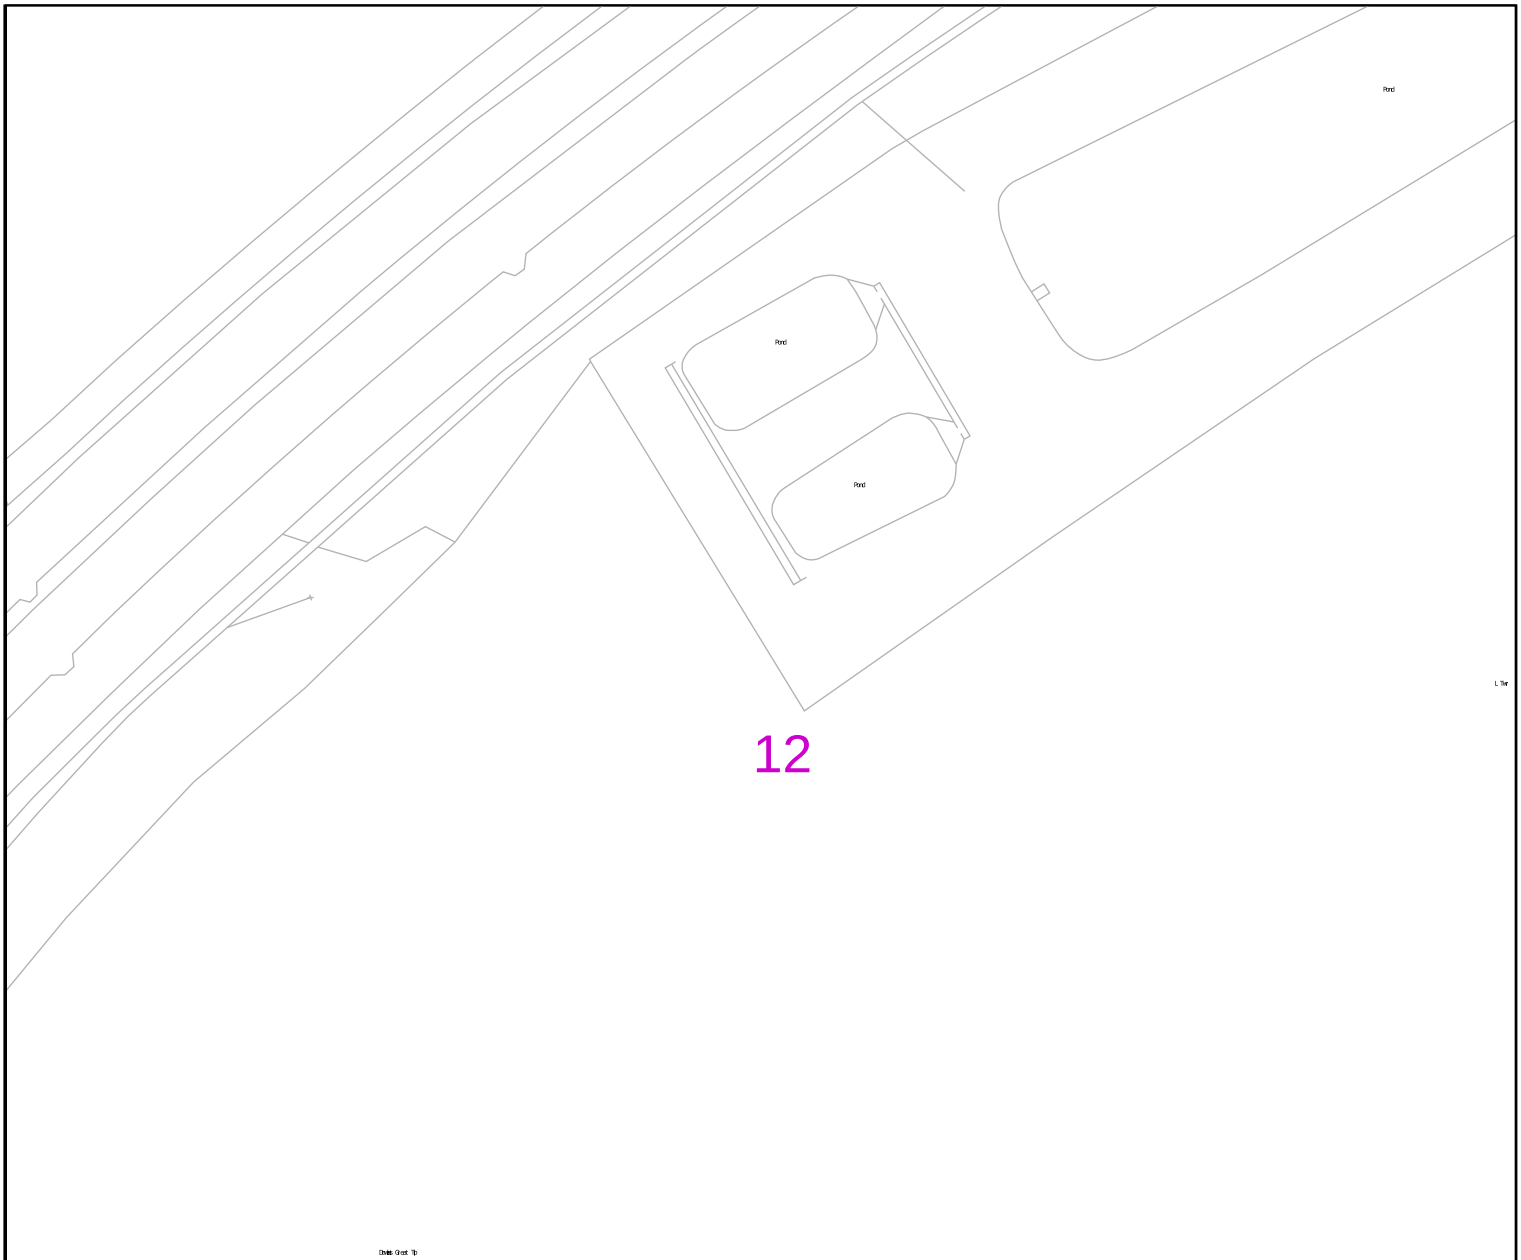

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables

PME Earth
Underground Earth


Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

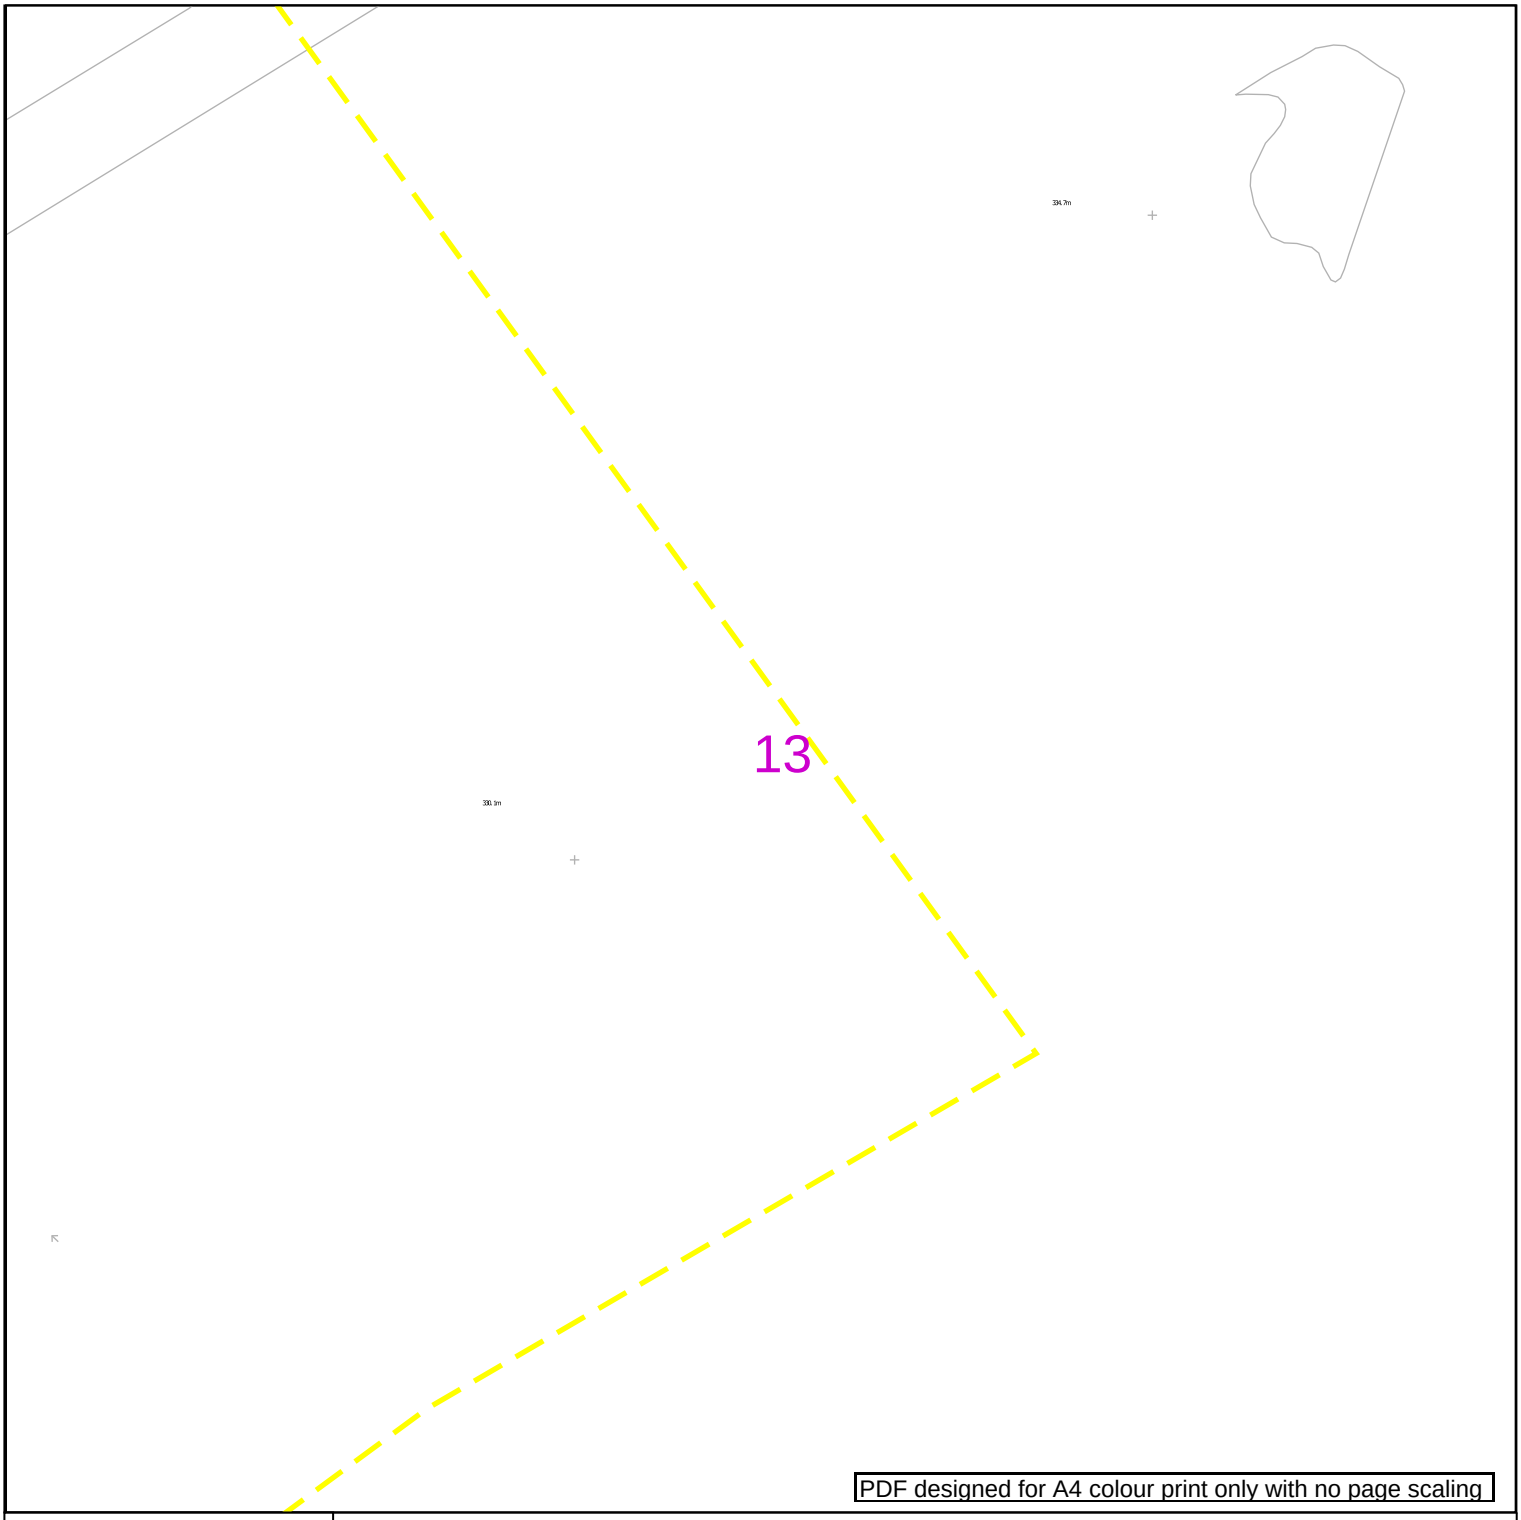

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables

PME Earth
Underground Earth

Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543


Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

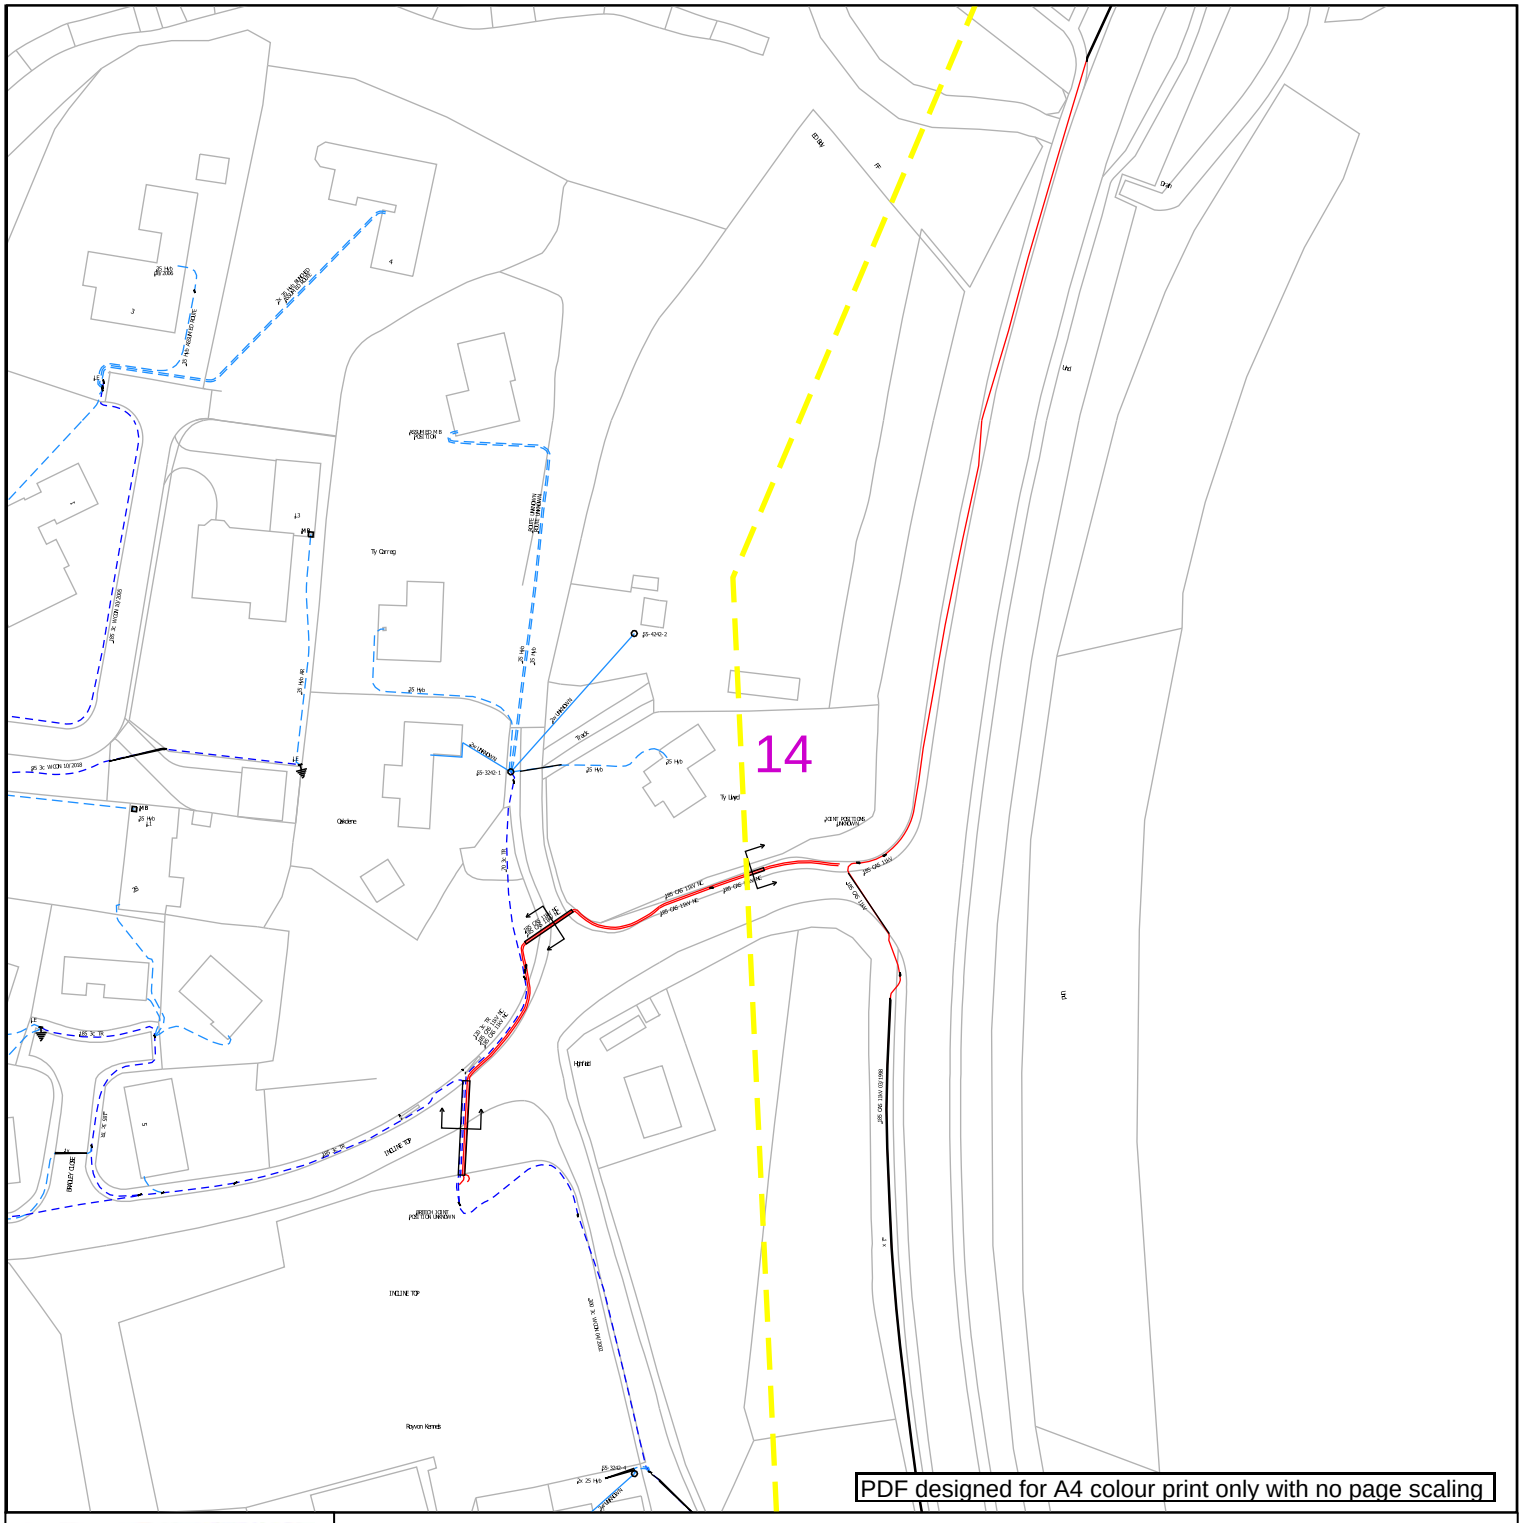

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer


Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

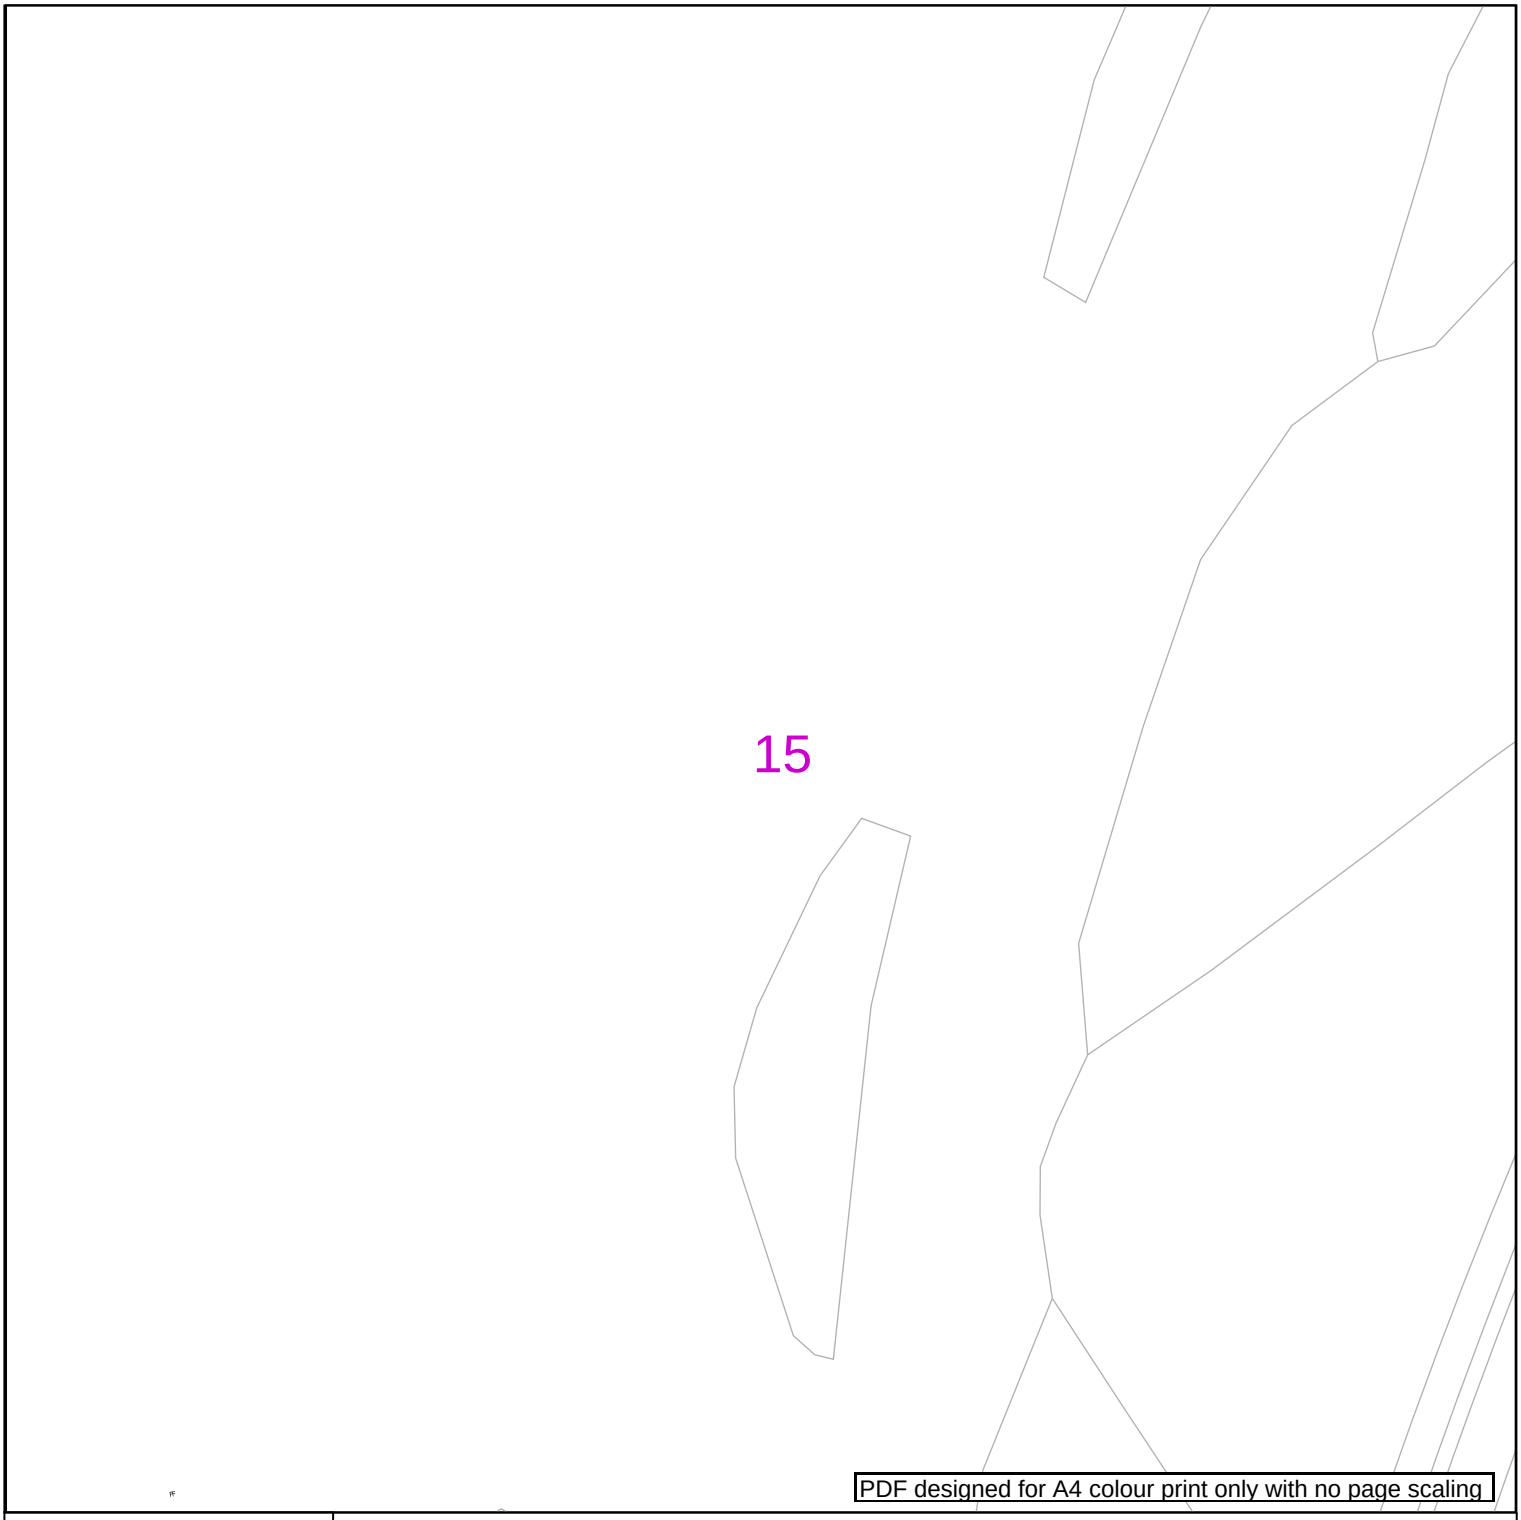

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables

PME Earth
Underground Earth


Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

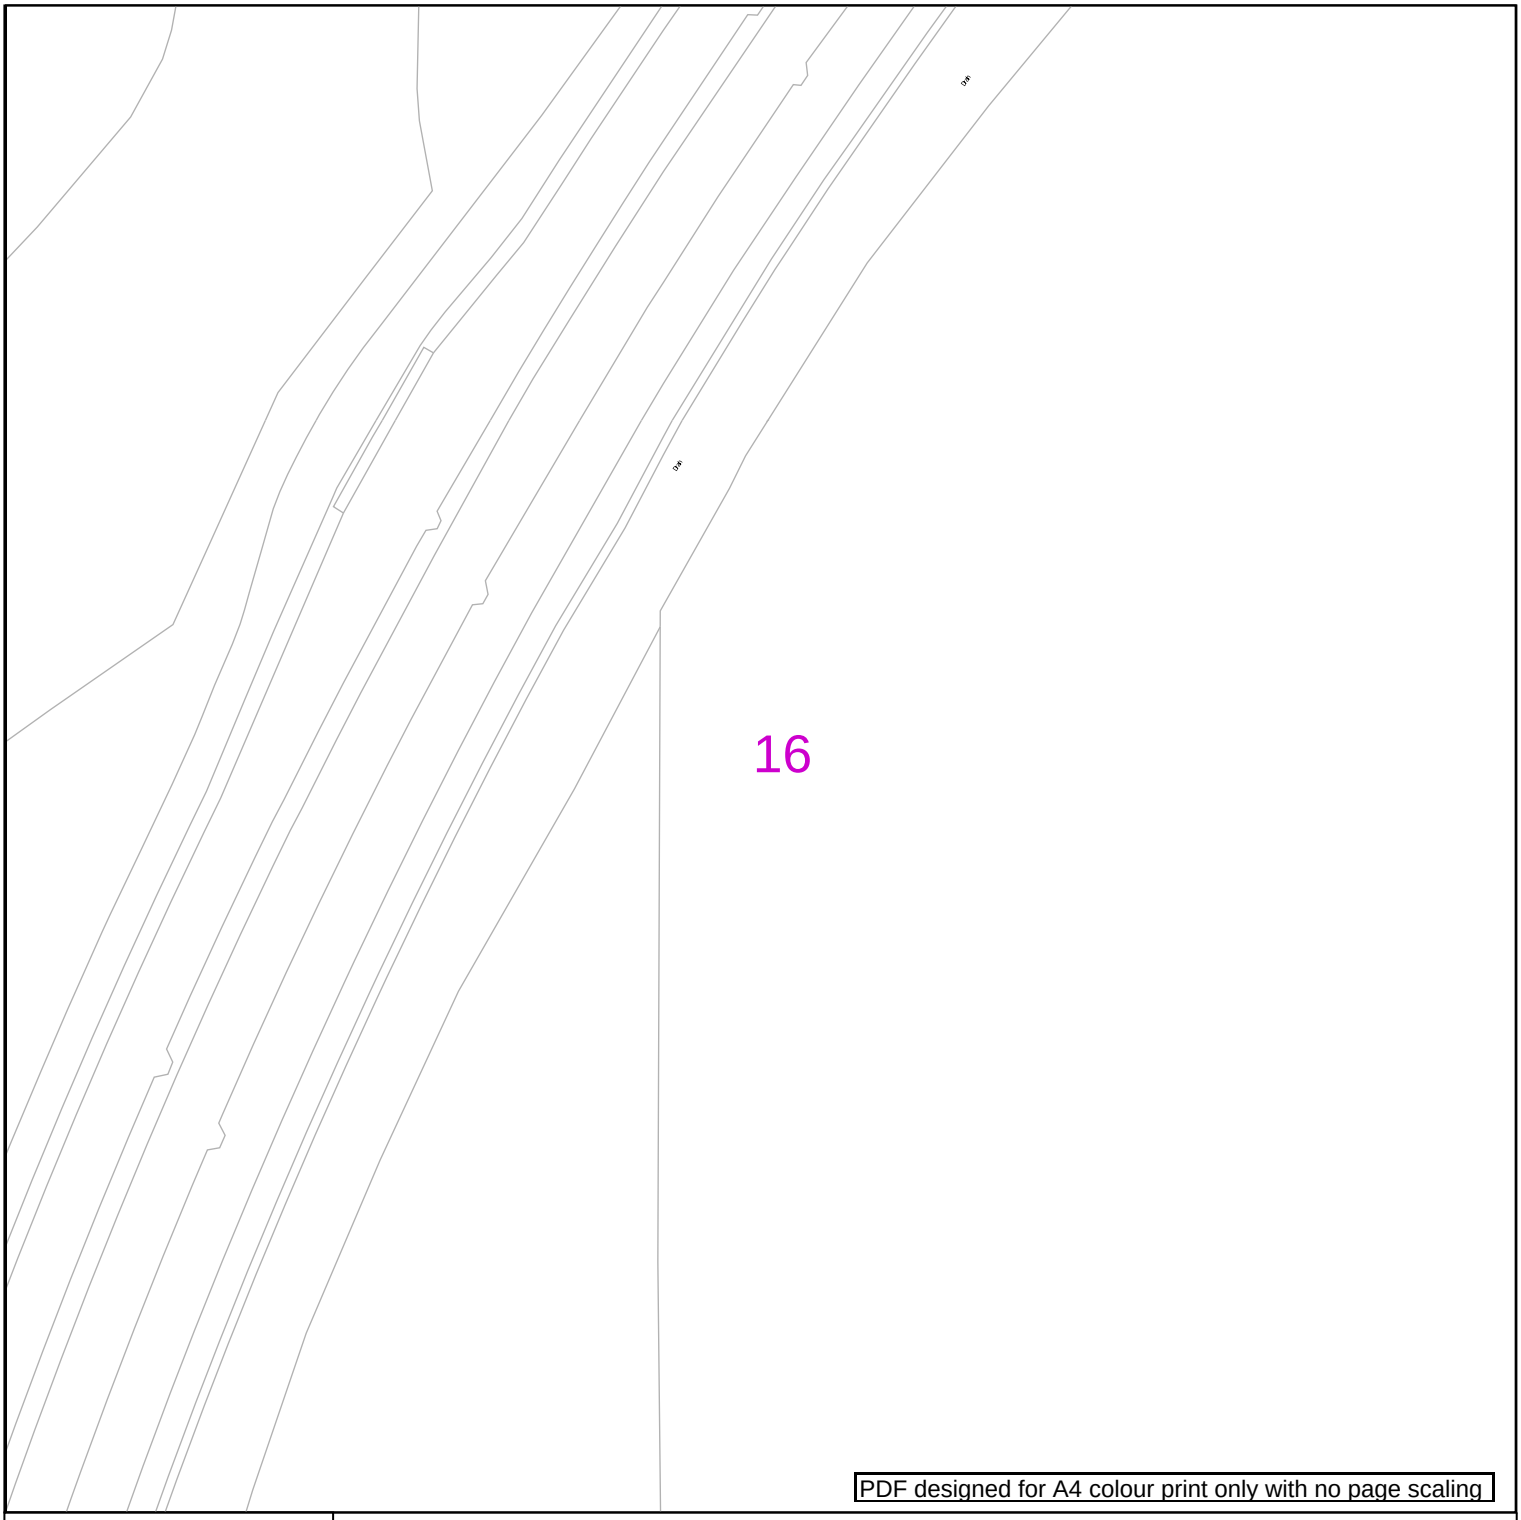

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables

PME Earth
Underground Earth


Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

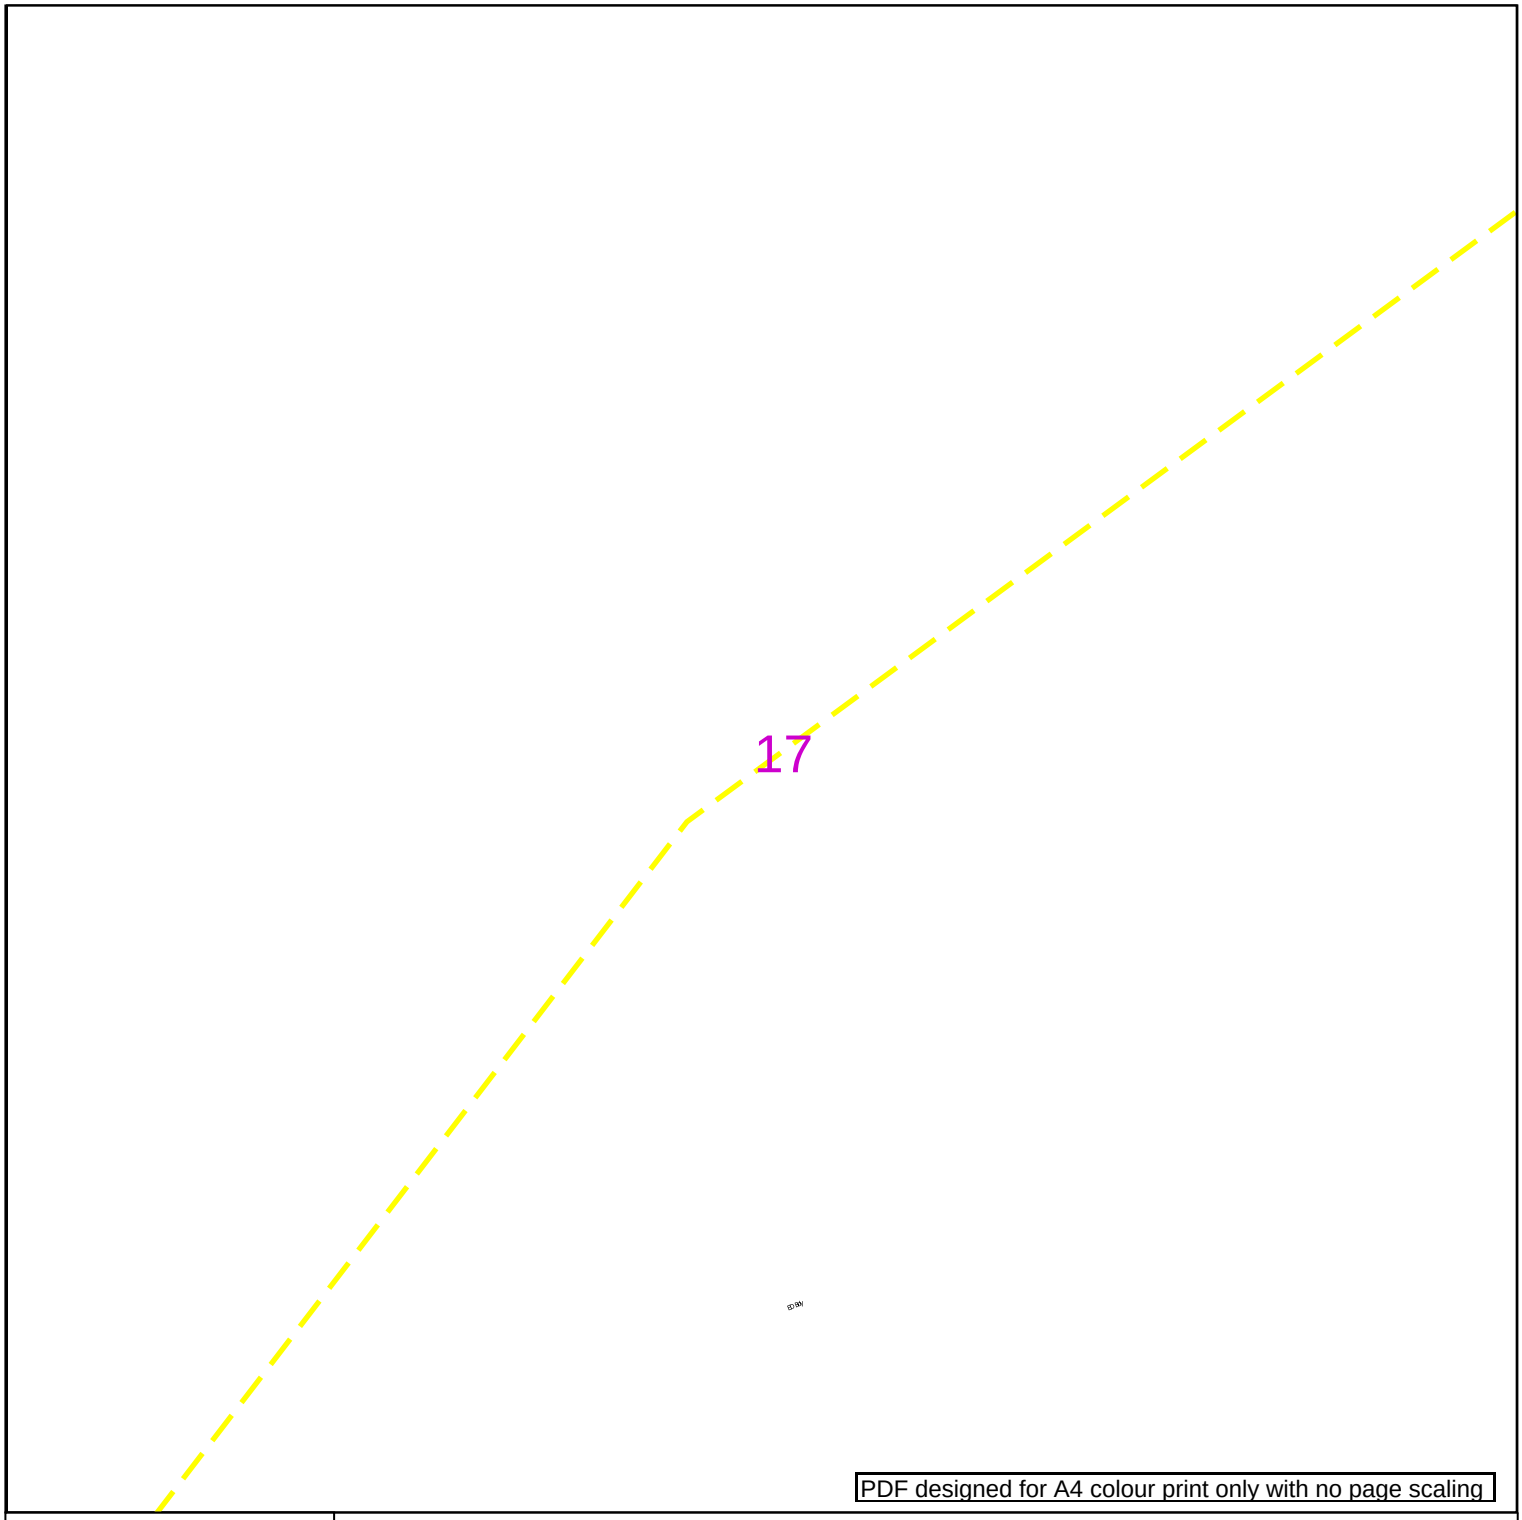

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables

PME Earth
Underground Earth

Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

18

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us


Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

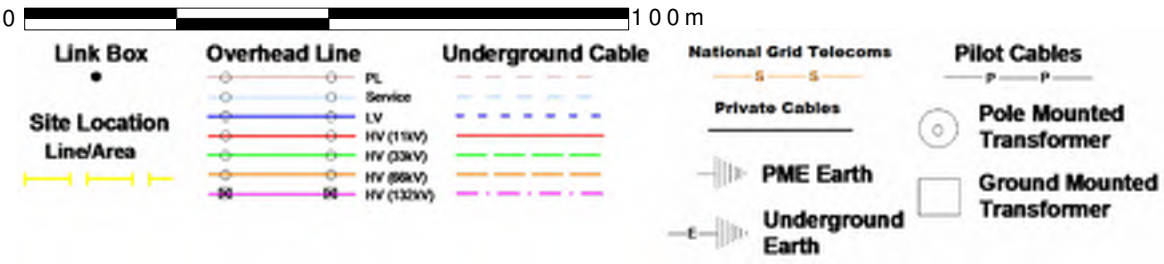


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

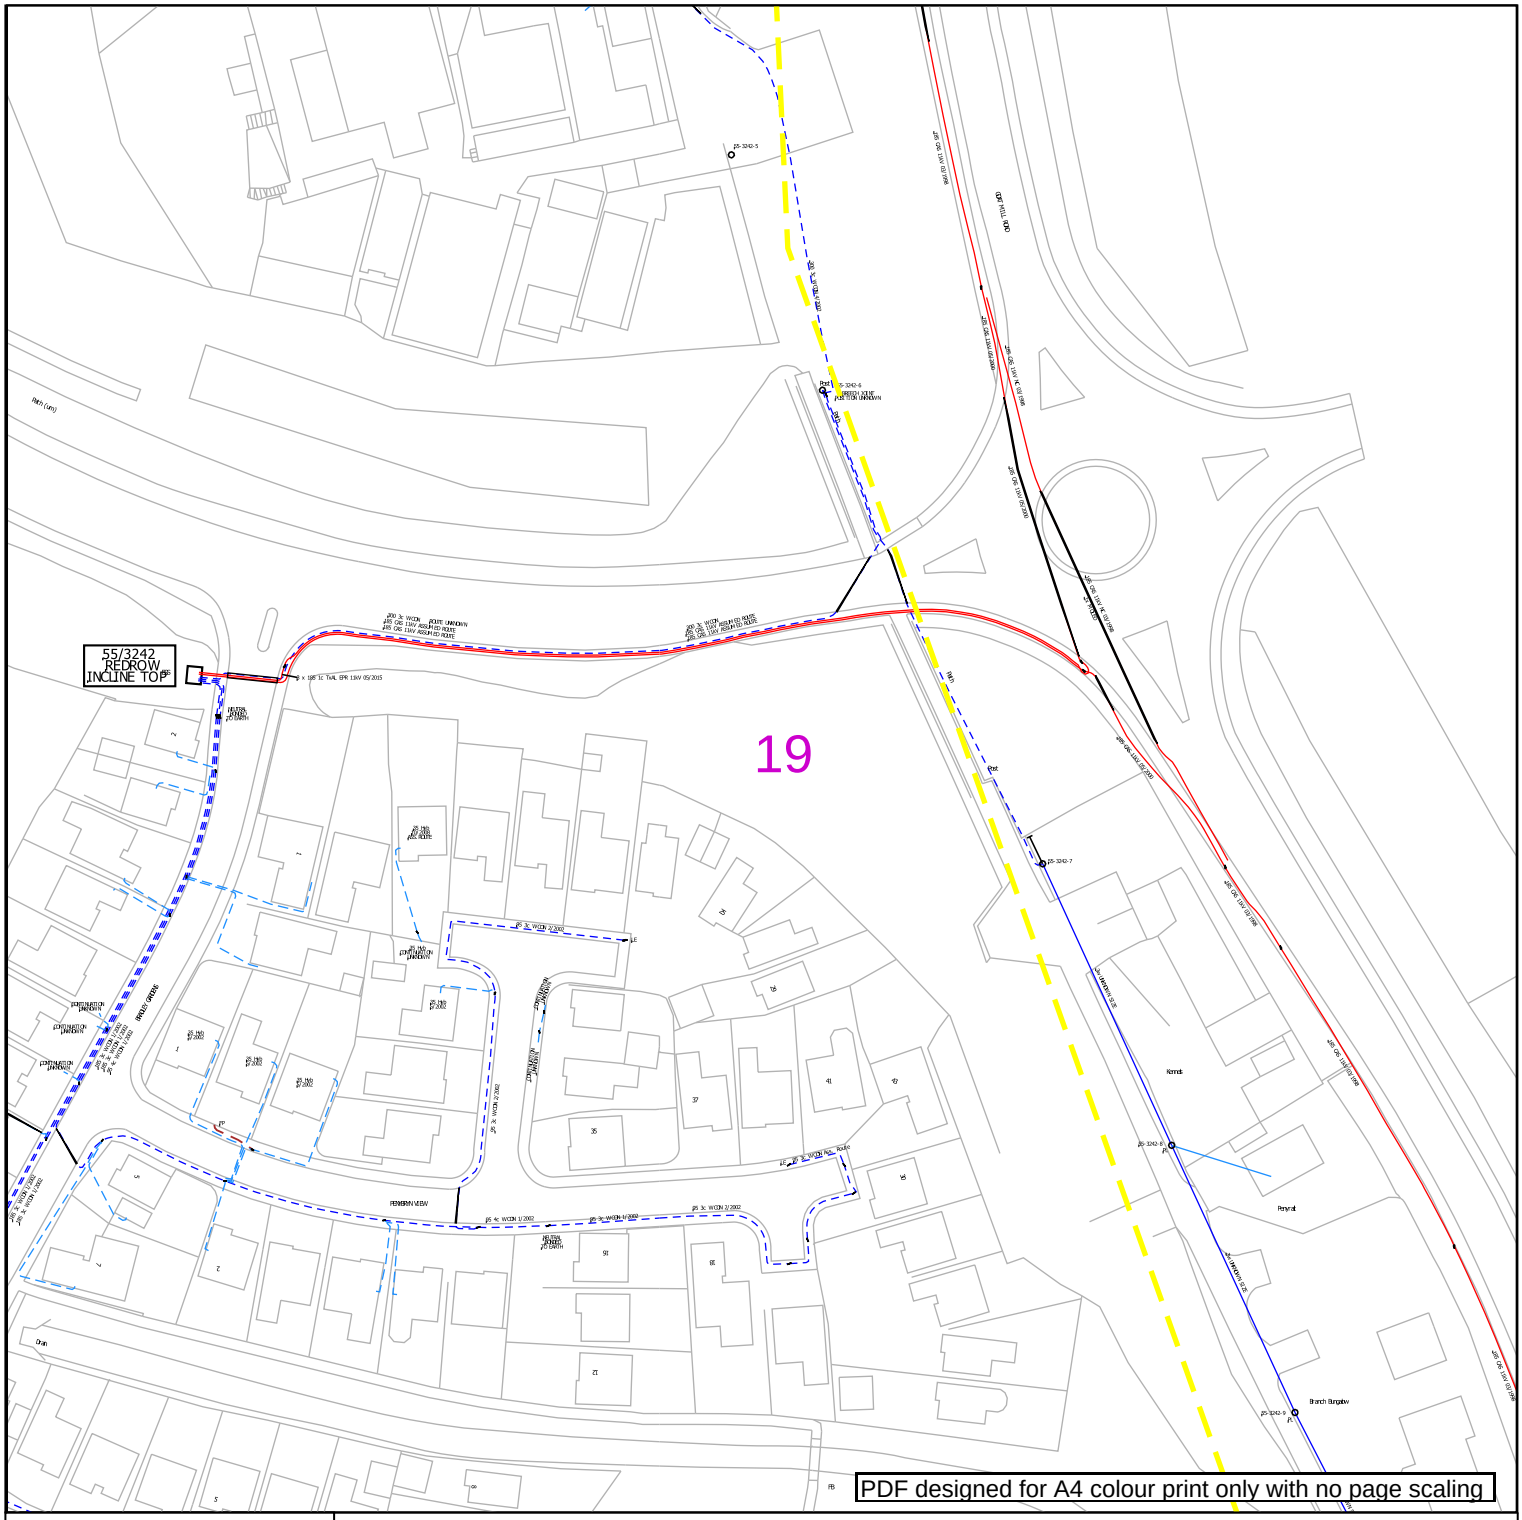

nationalgrid Electricity Distribution

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer

Ground Mounted Transformer

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543


Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

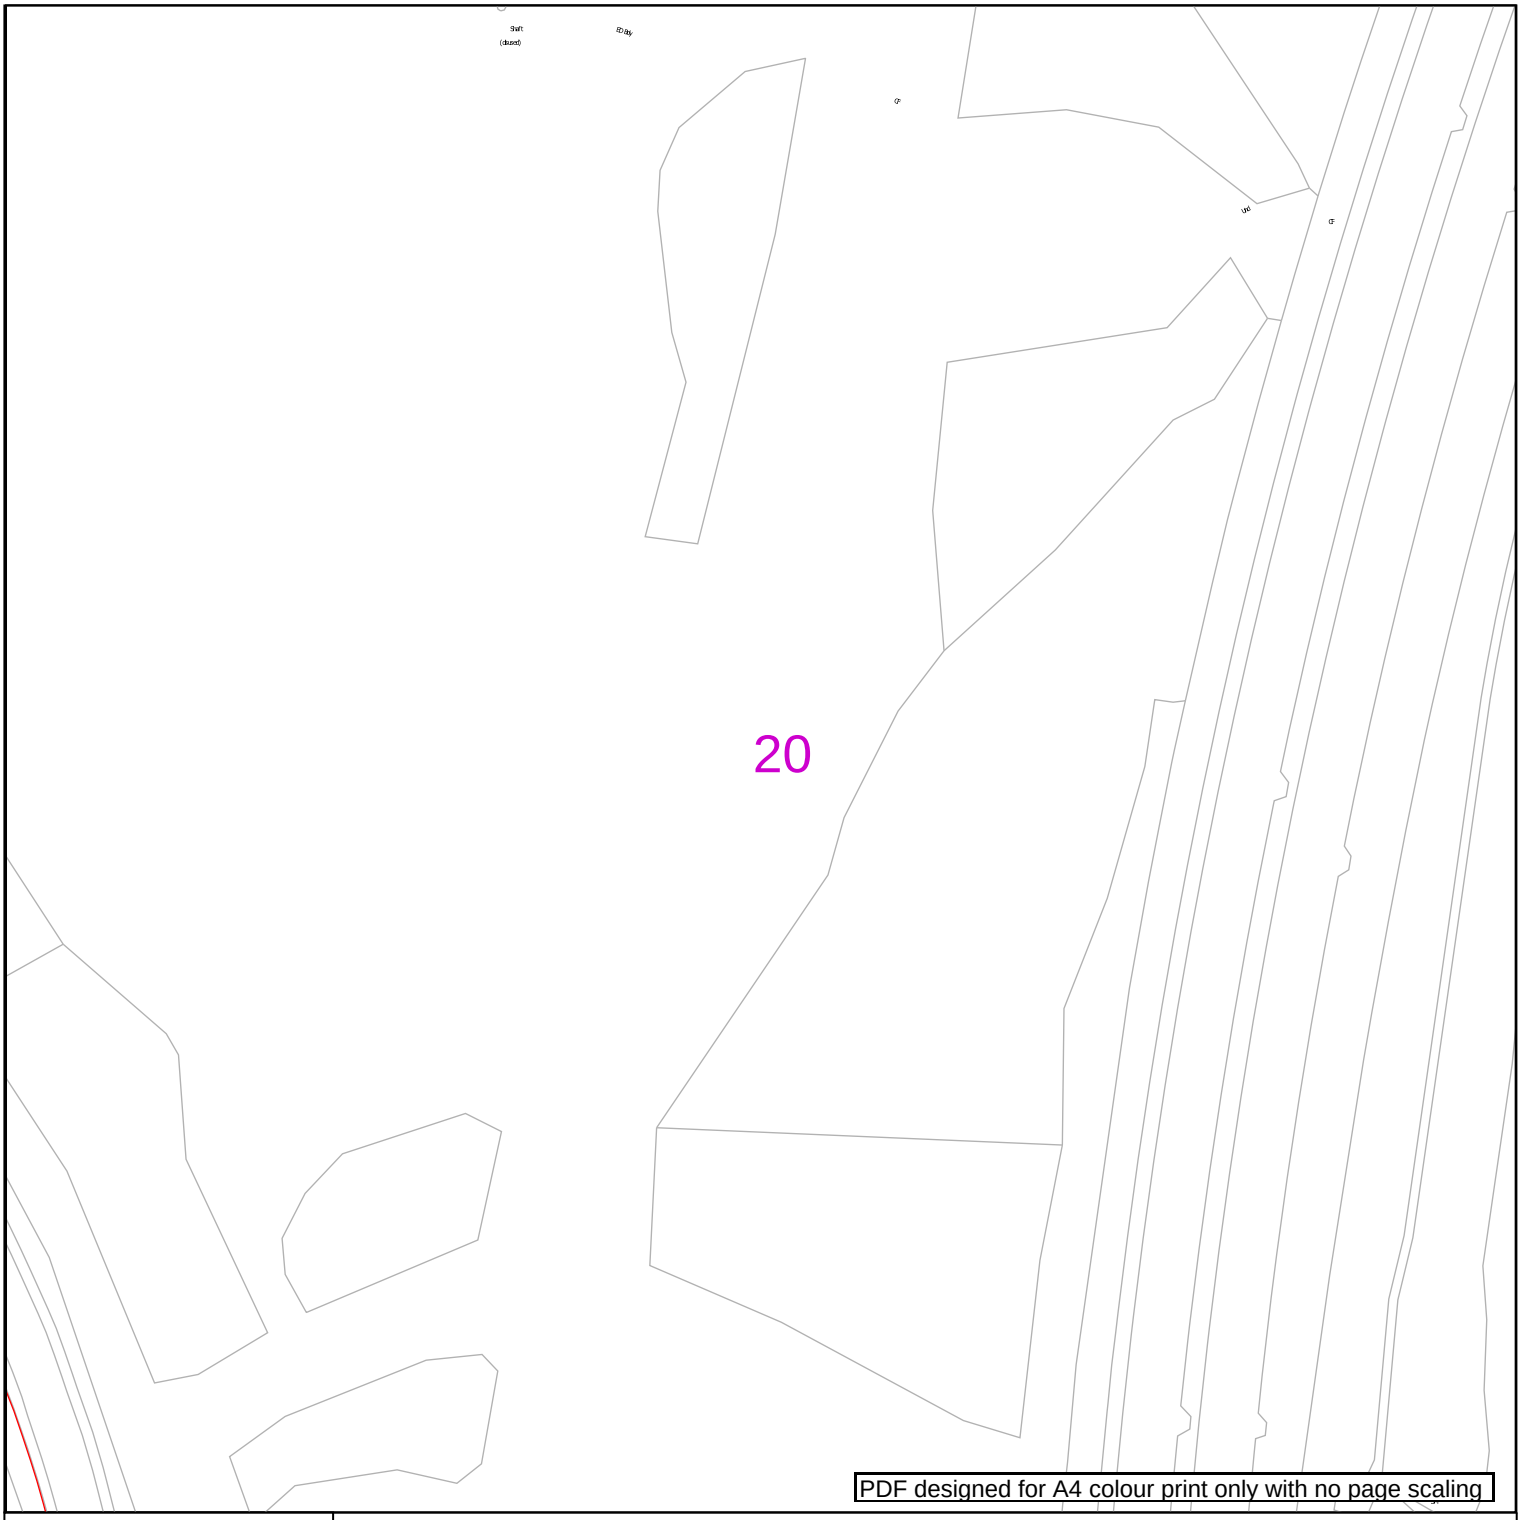

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables


Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer
PME Earth
Underground Earth

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

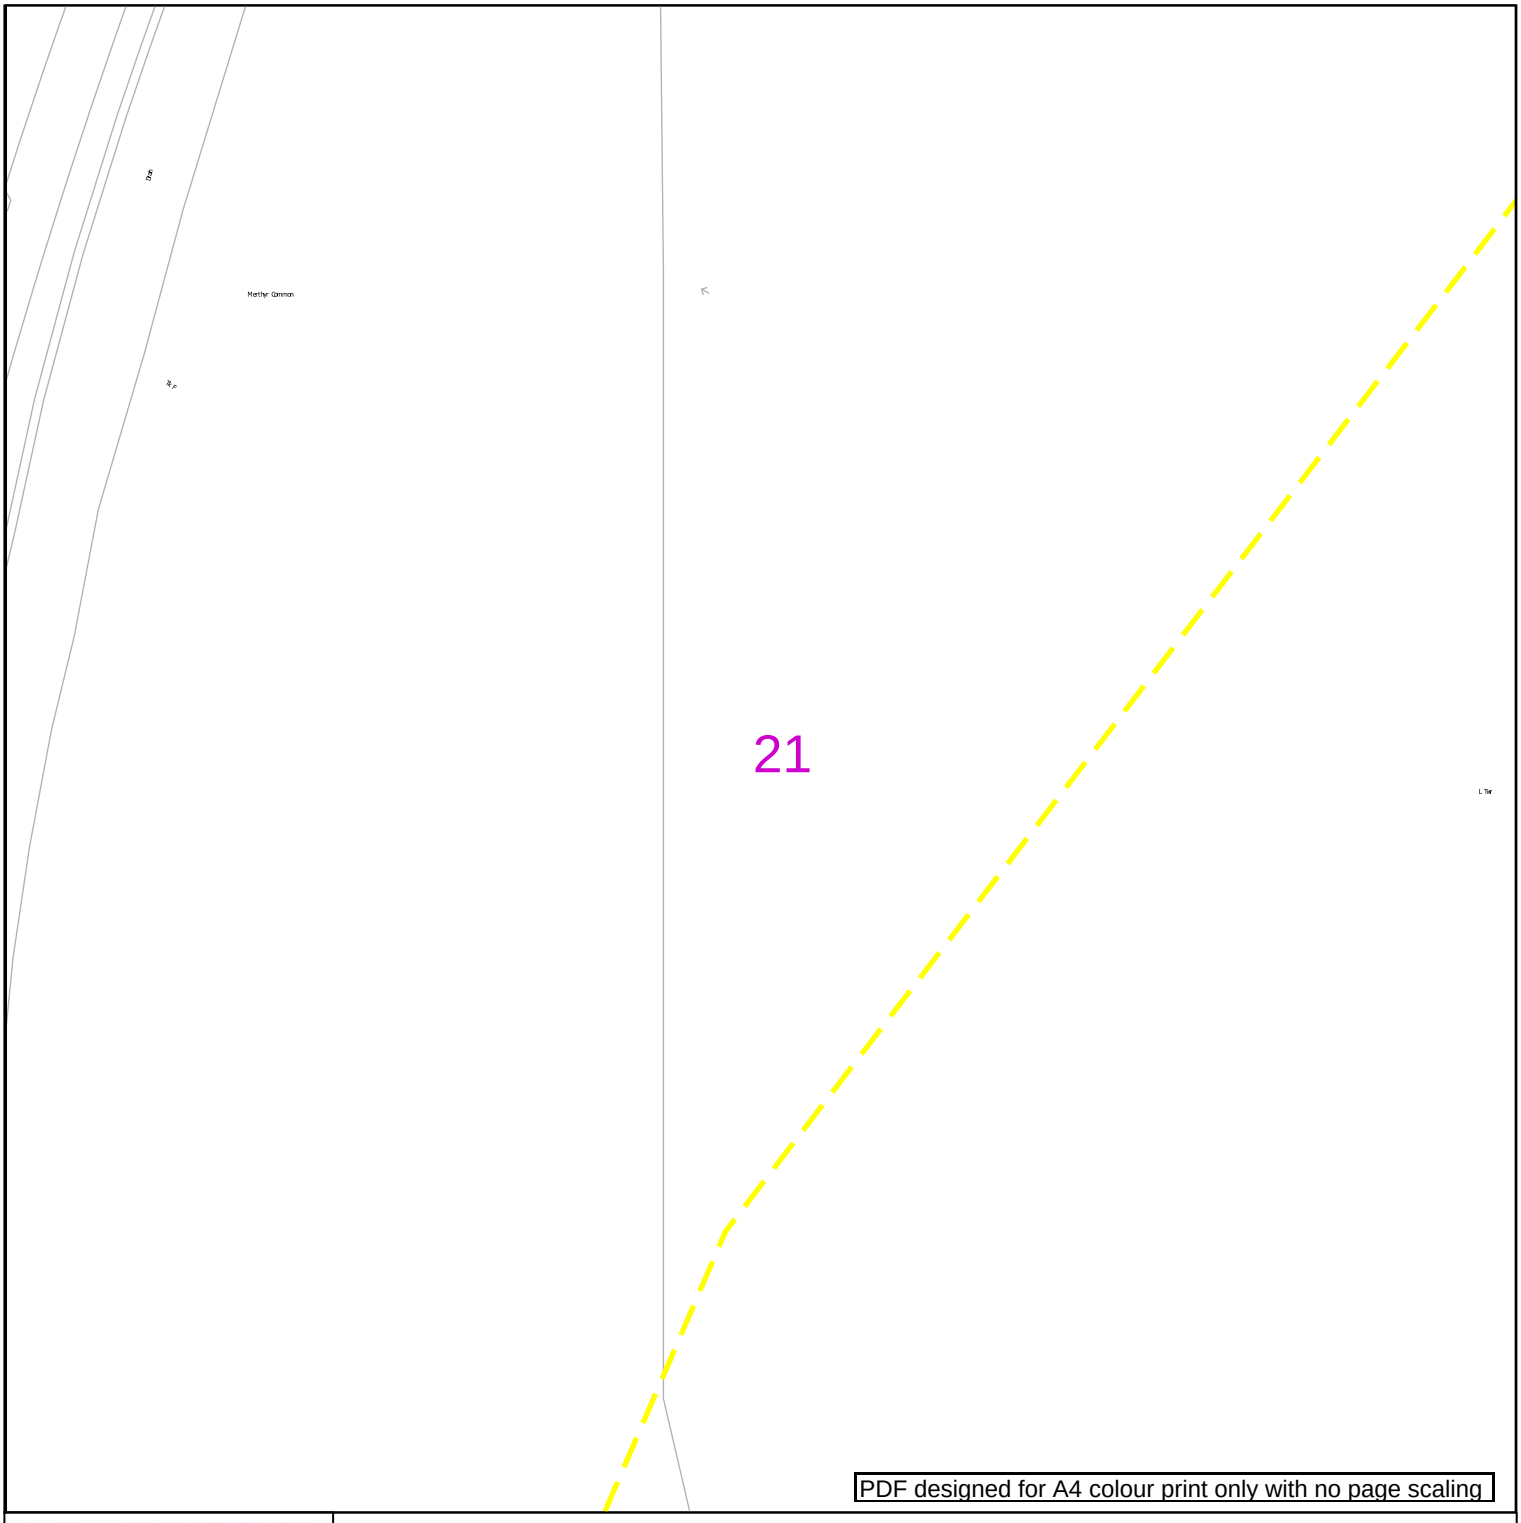

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables

PME Earth
Underground Earth


Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.



PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 1 0 0 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables

Pilot Cables

PME Earth
Underground Earth


Pole Mounted Transformer
Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

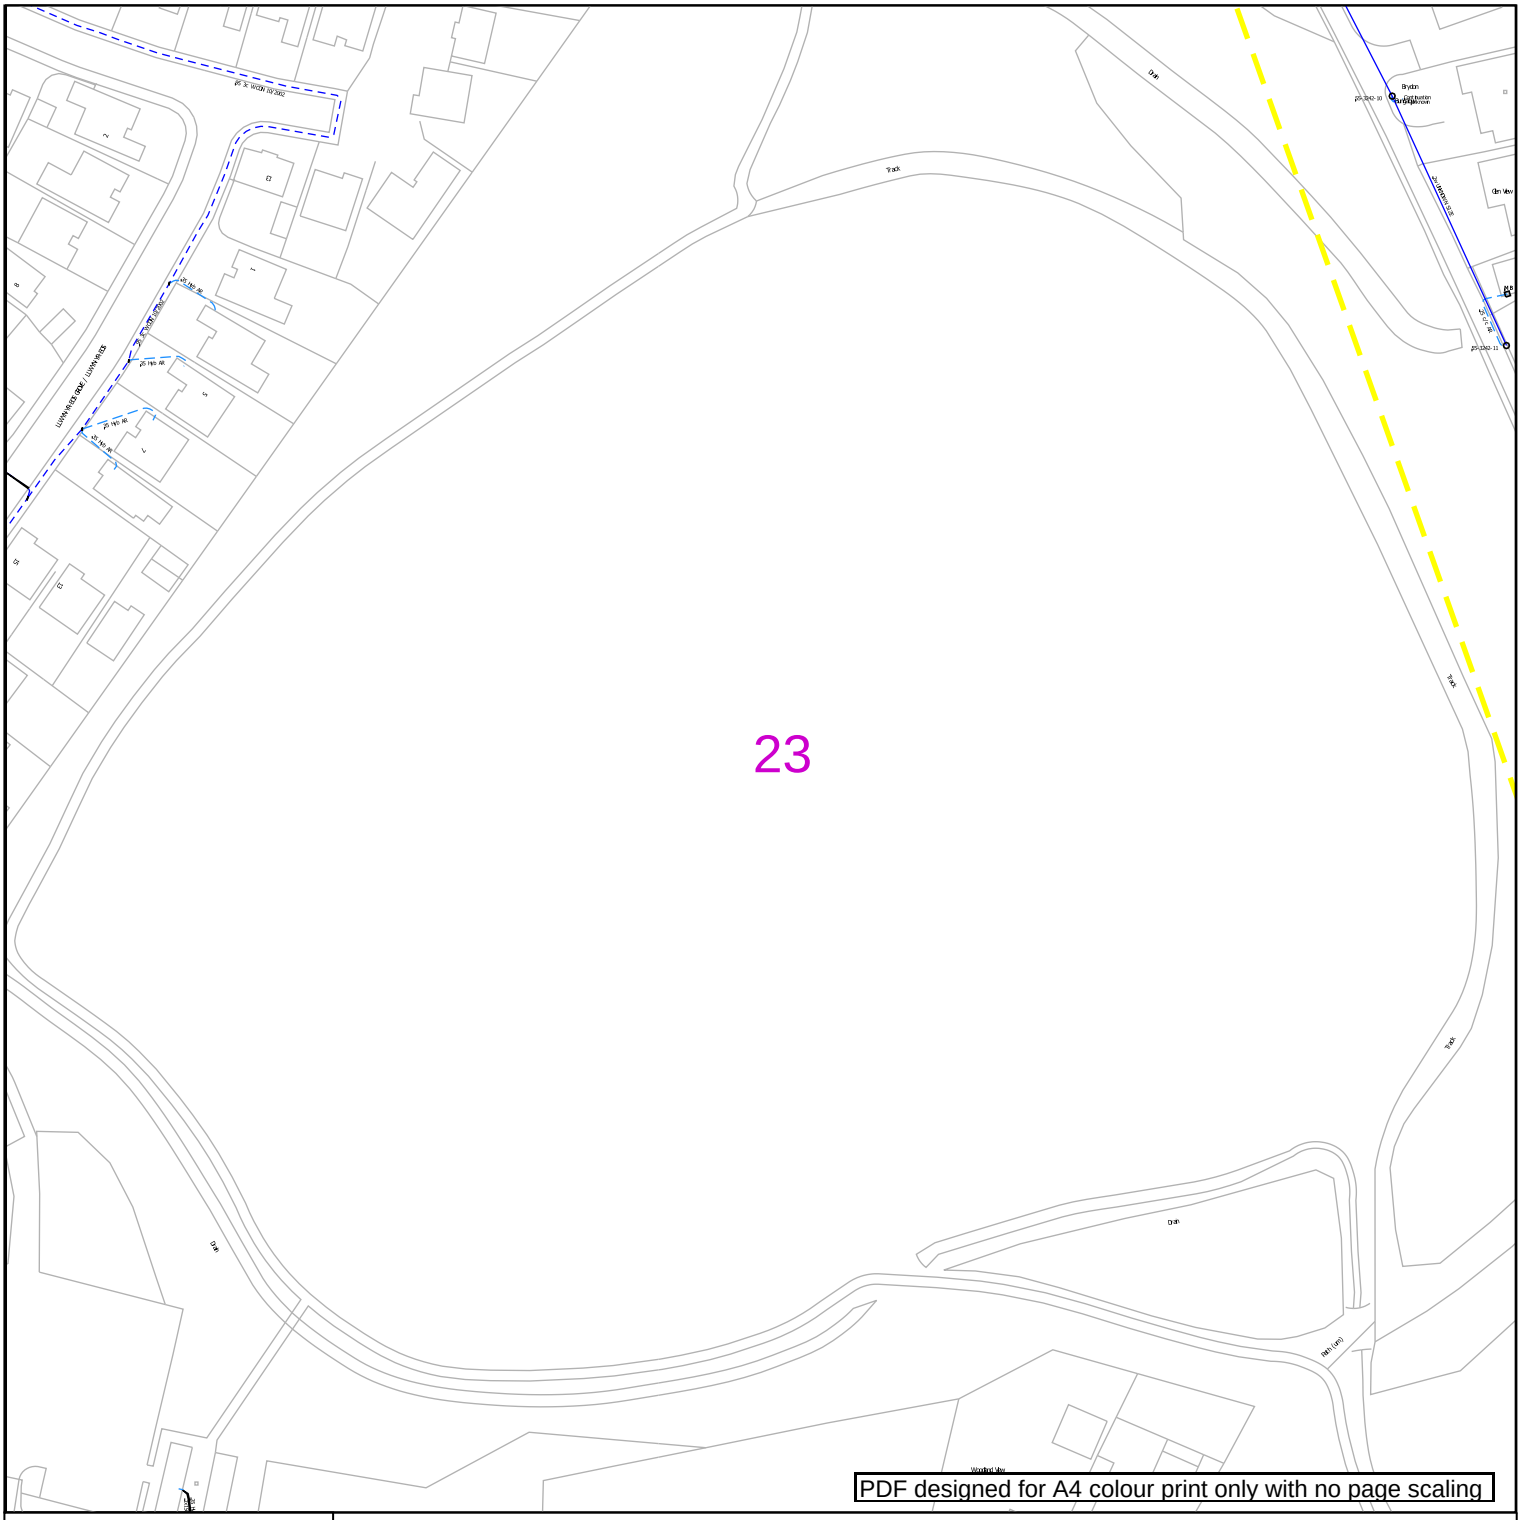

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables
PME Earth
Underground Earth


Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

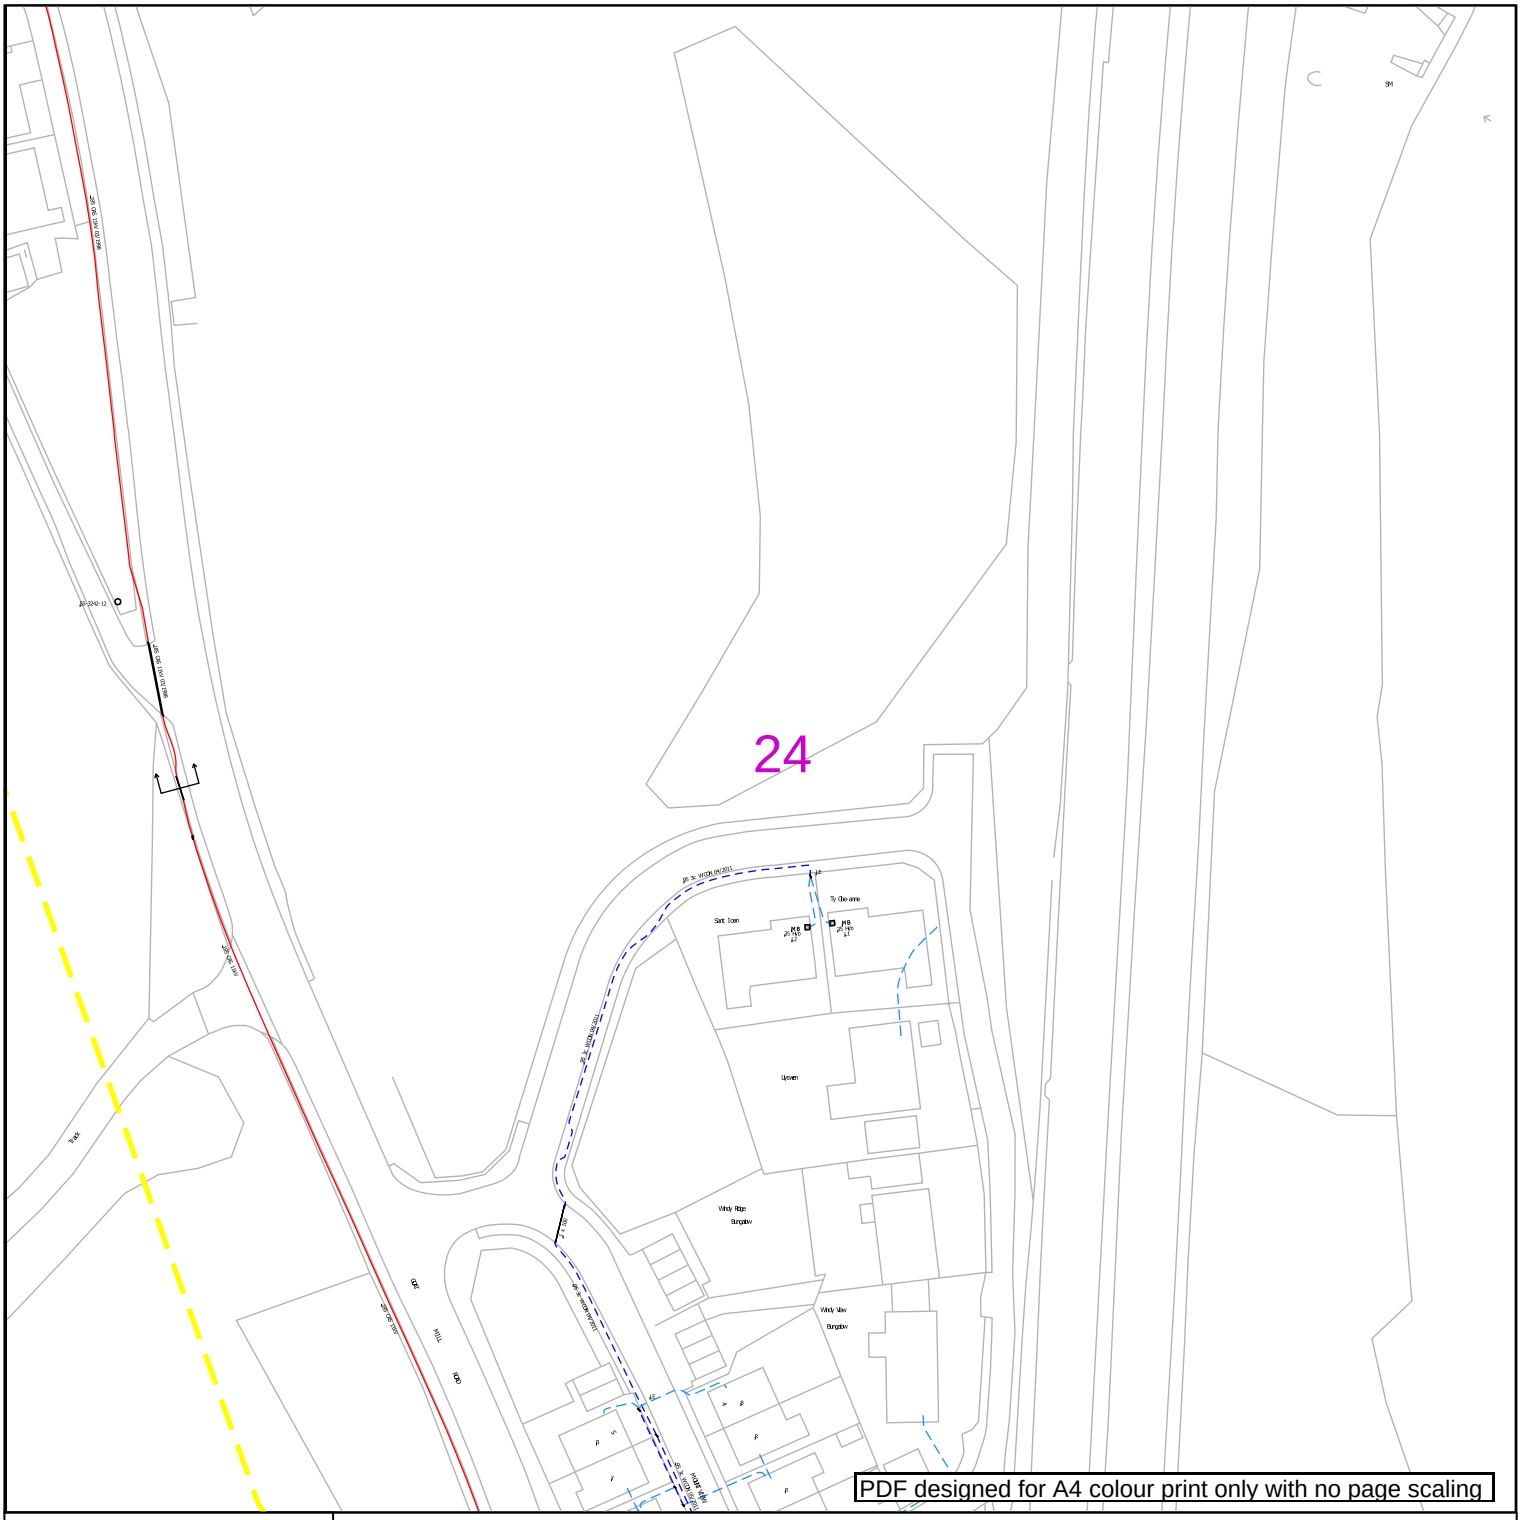

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer


Ground Mounted Transformer

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

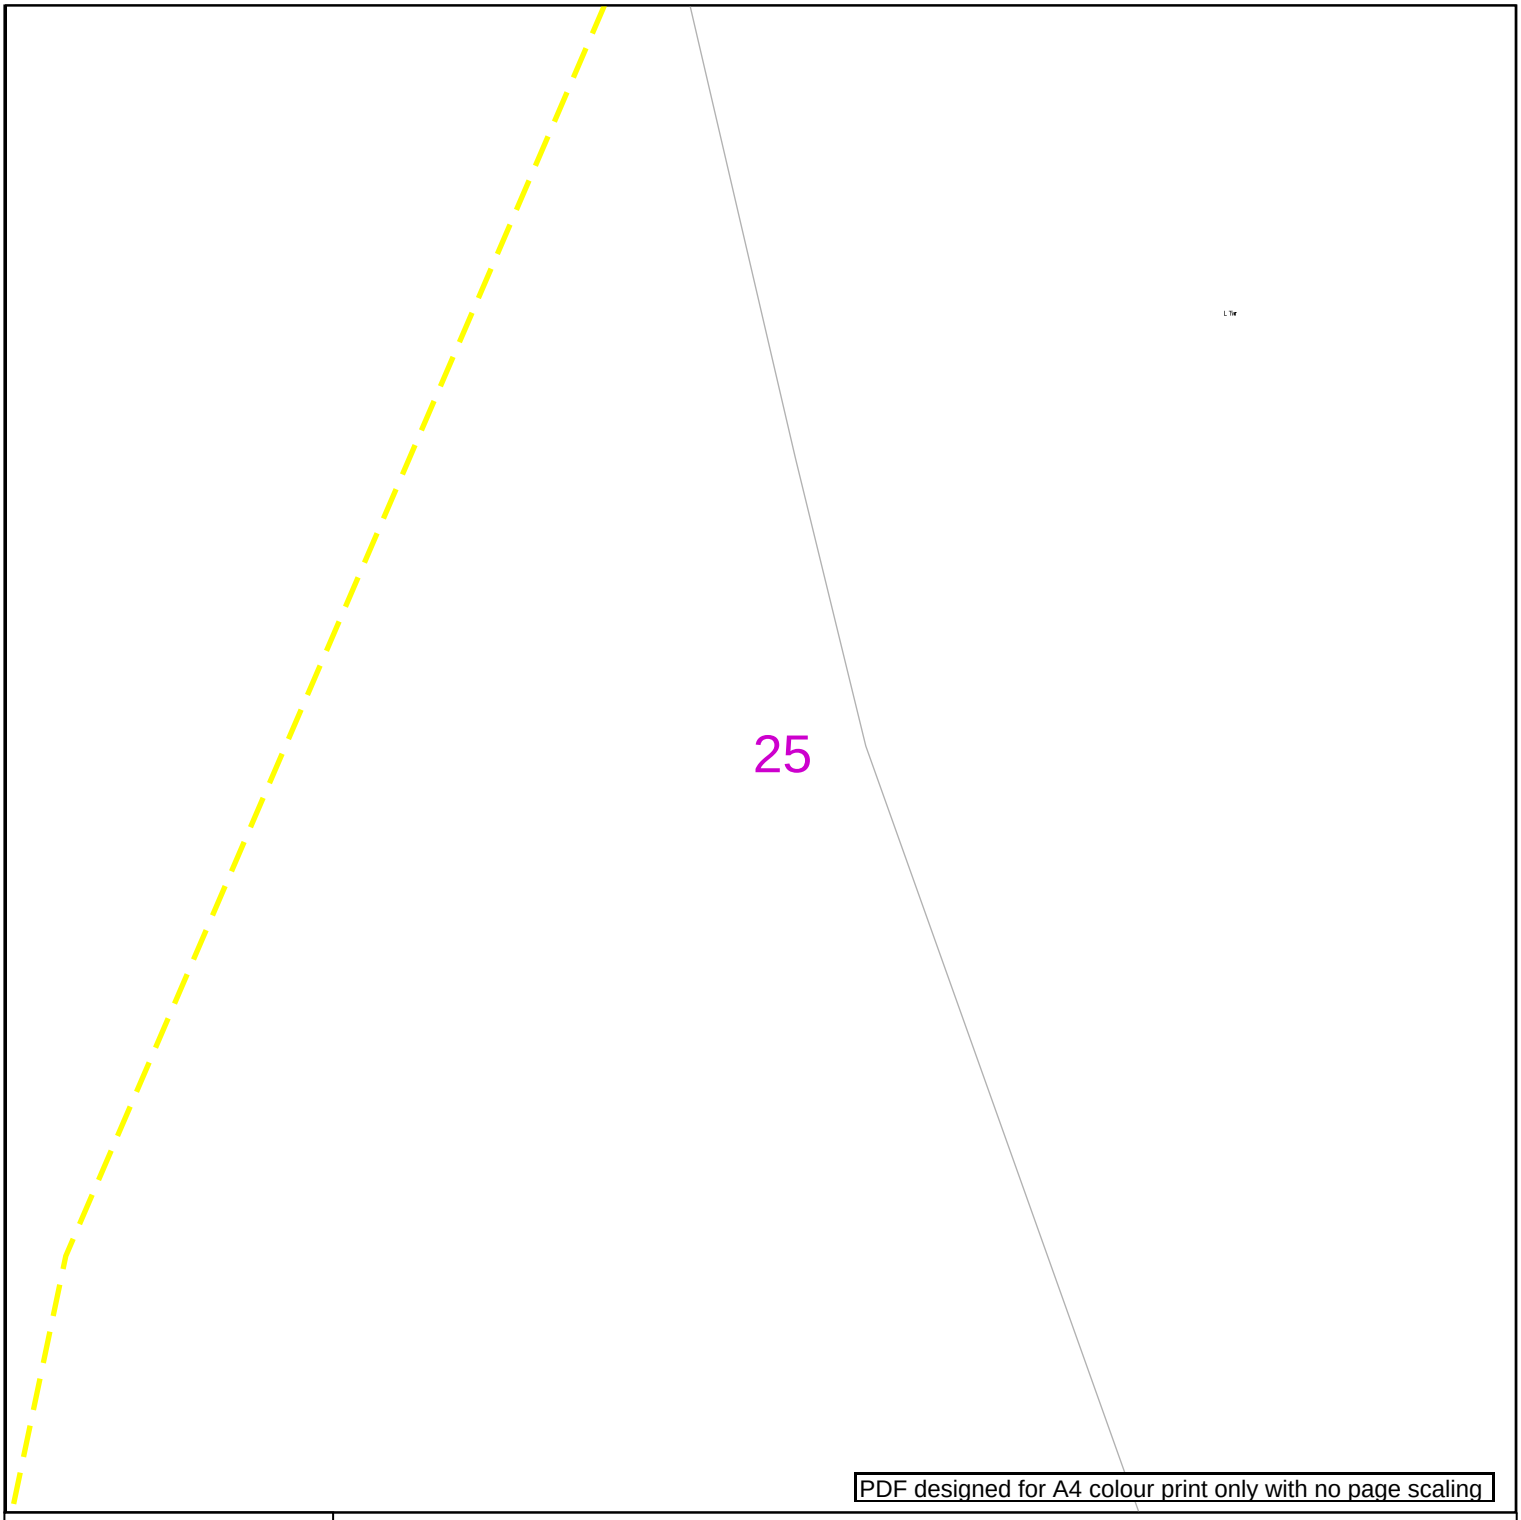

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms
Private Cables
PME Earth
Underground Earth

Pilot Cables
Pole Mounted Transformer
Ground Mounted Transformer

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543


Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

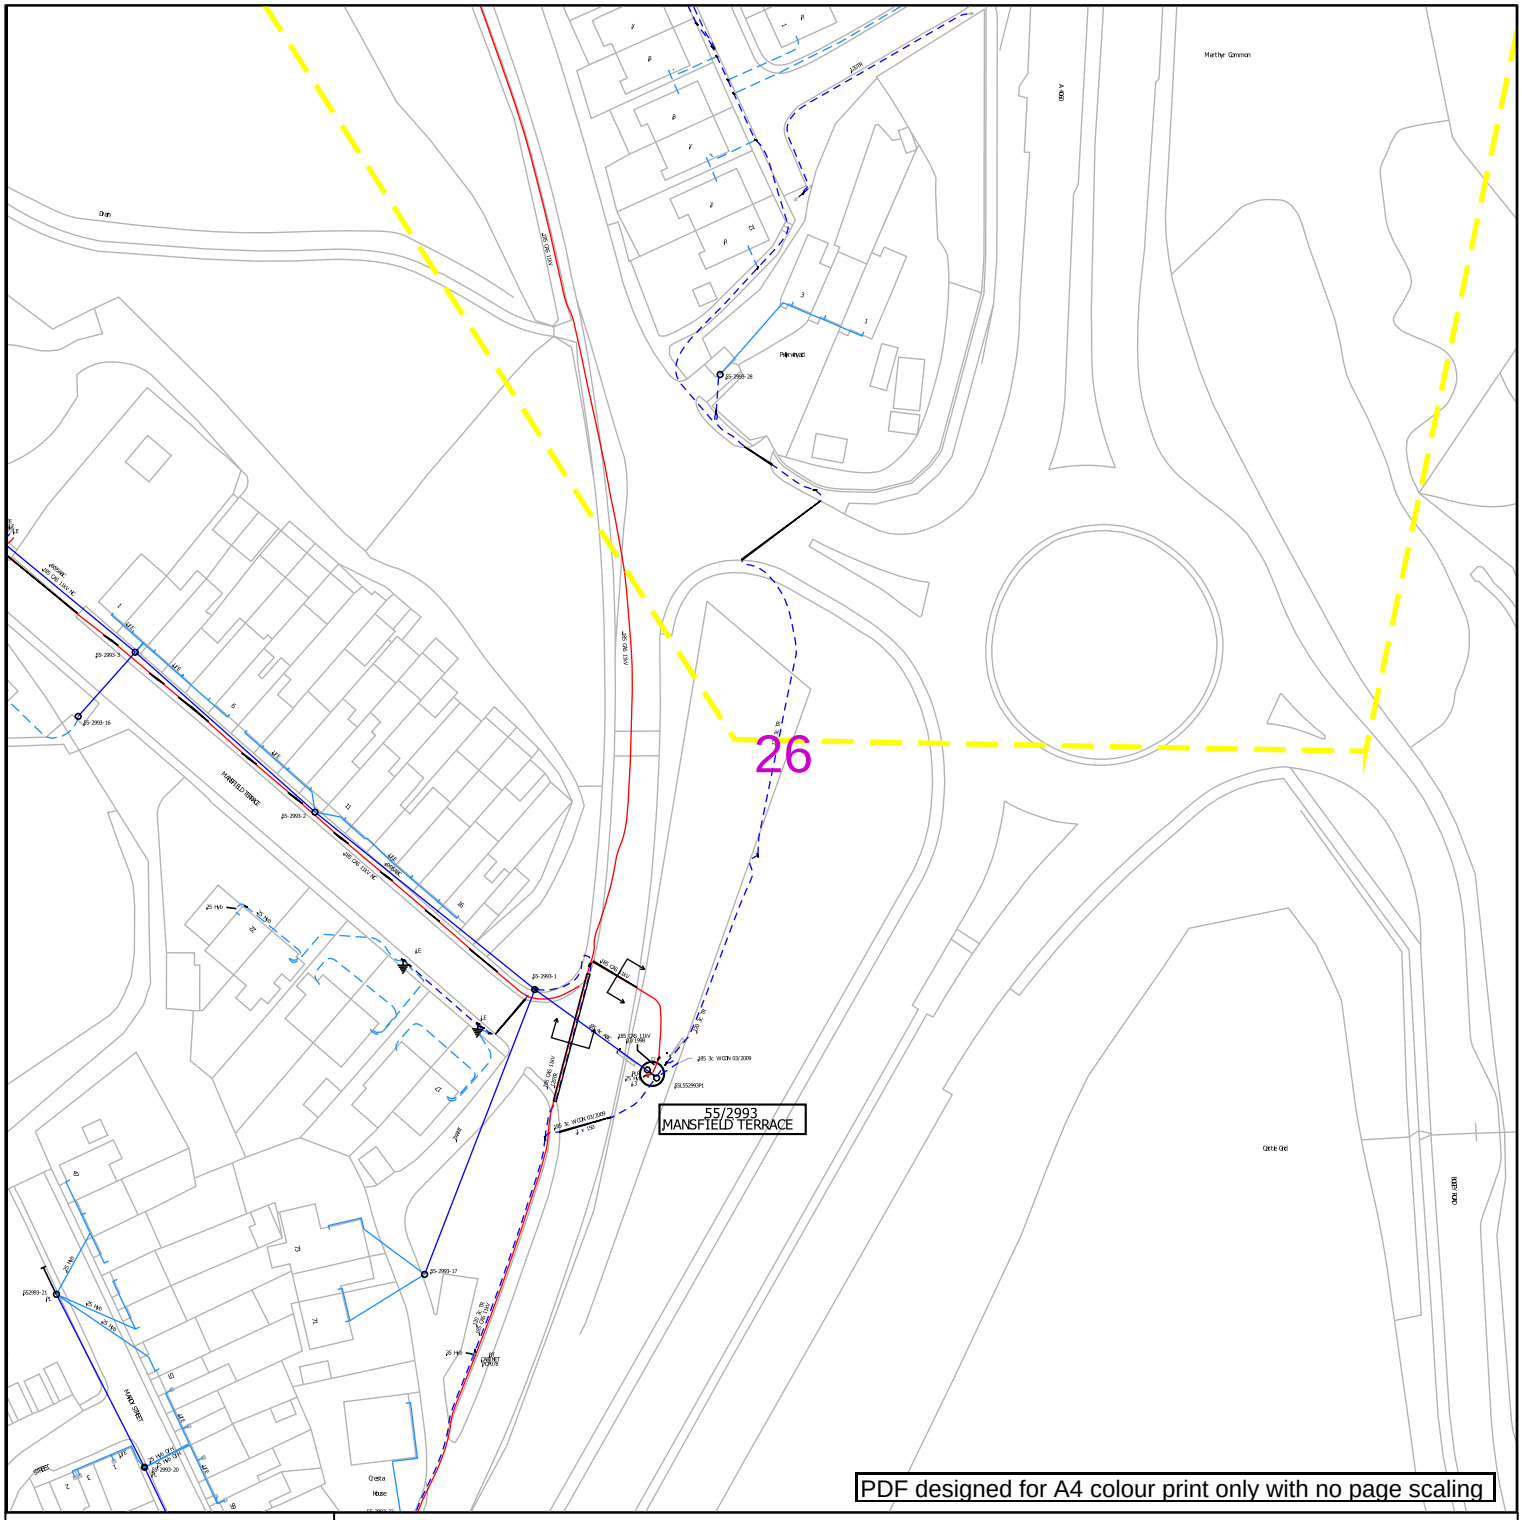

nationalgrid Electricity Distribution

0 100 m

Link Box
Site Location
Line/Area

Overhead Line
PL
Service
LV
HV (11kV)
HV (33kV)
HV (66kV)
HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer

Ground Mounted Transformer

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543


Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

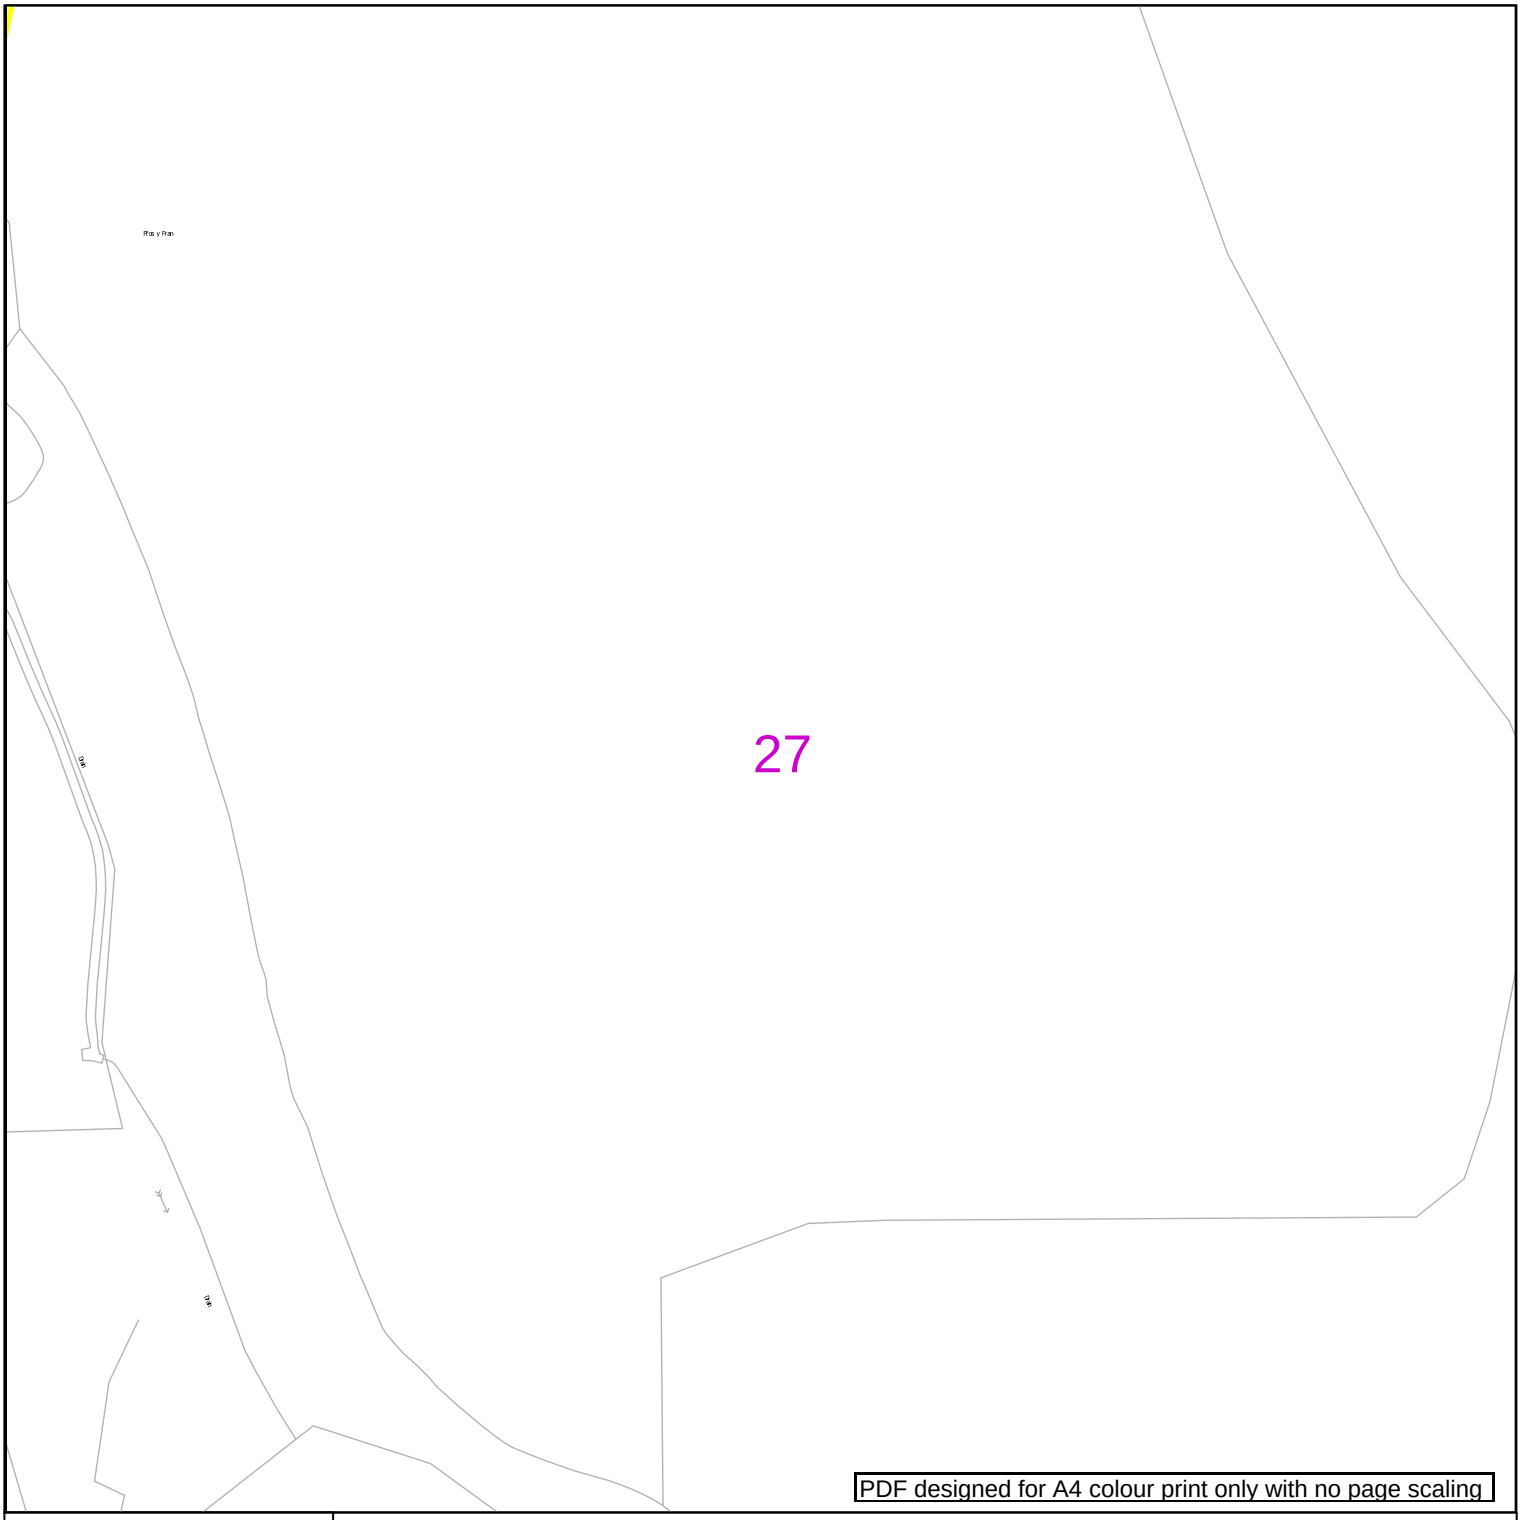

PDF designed for A4 colour print only with no page scaling

nationalgrid Electricity Distribution

0 100 m

Link Box

Site Location

Line/Area

Overhead Line

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer

Ground Mounted Transformer

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543


Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

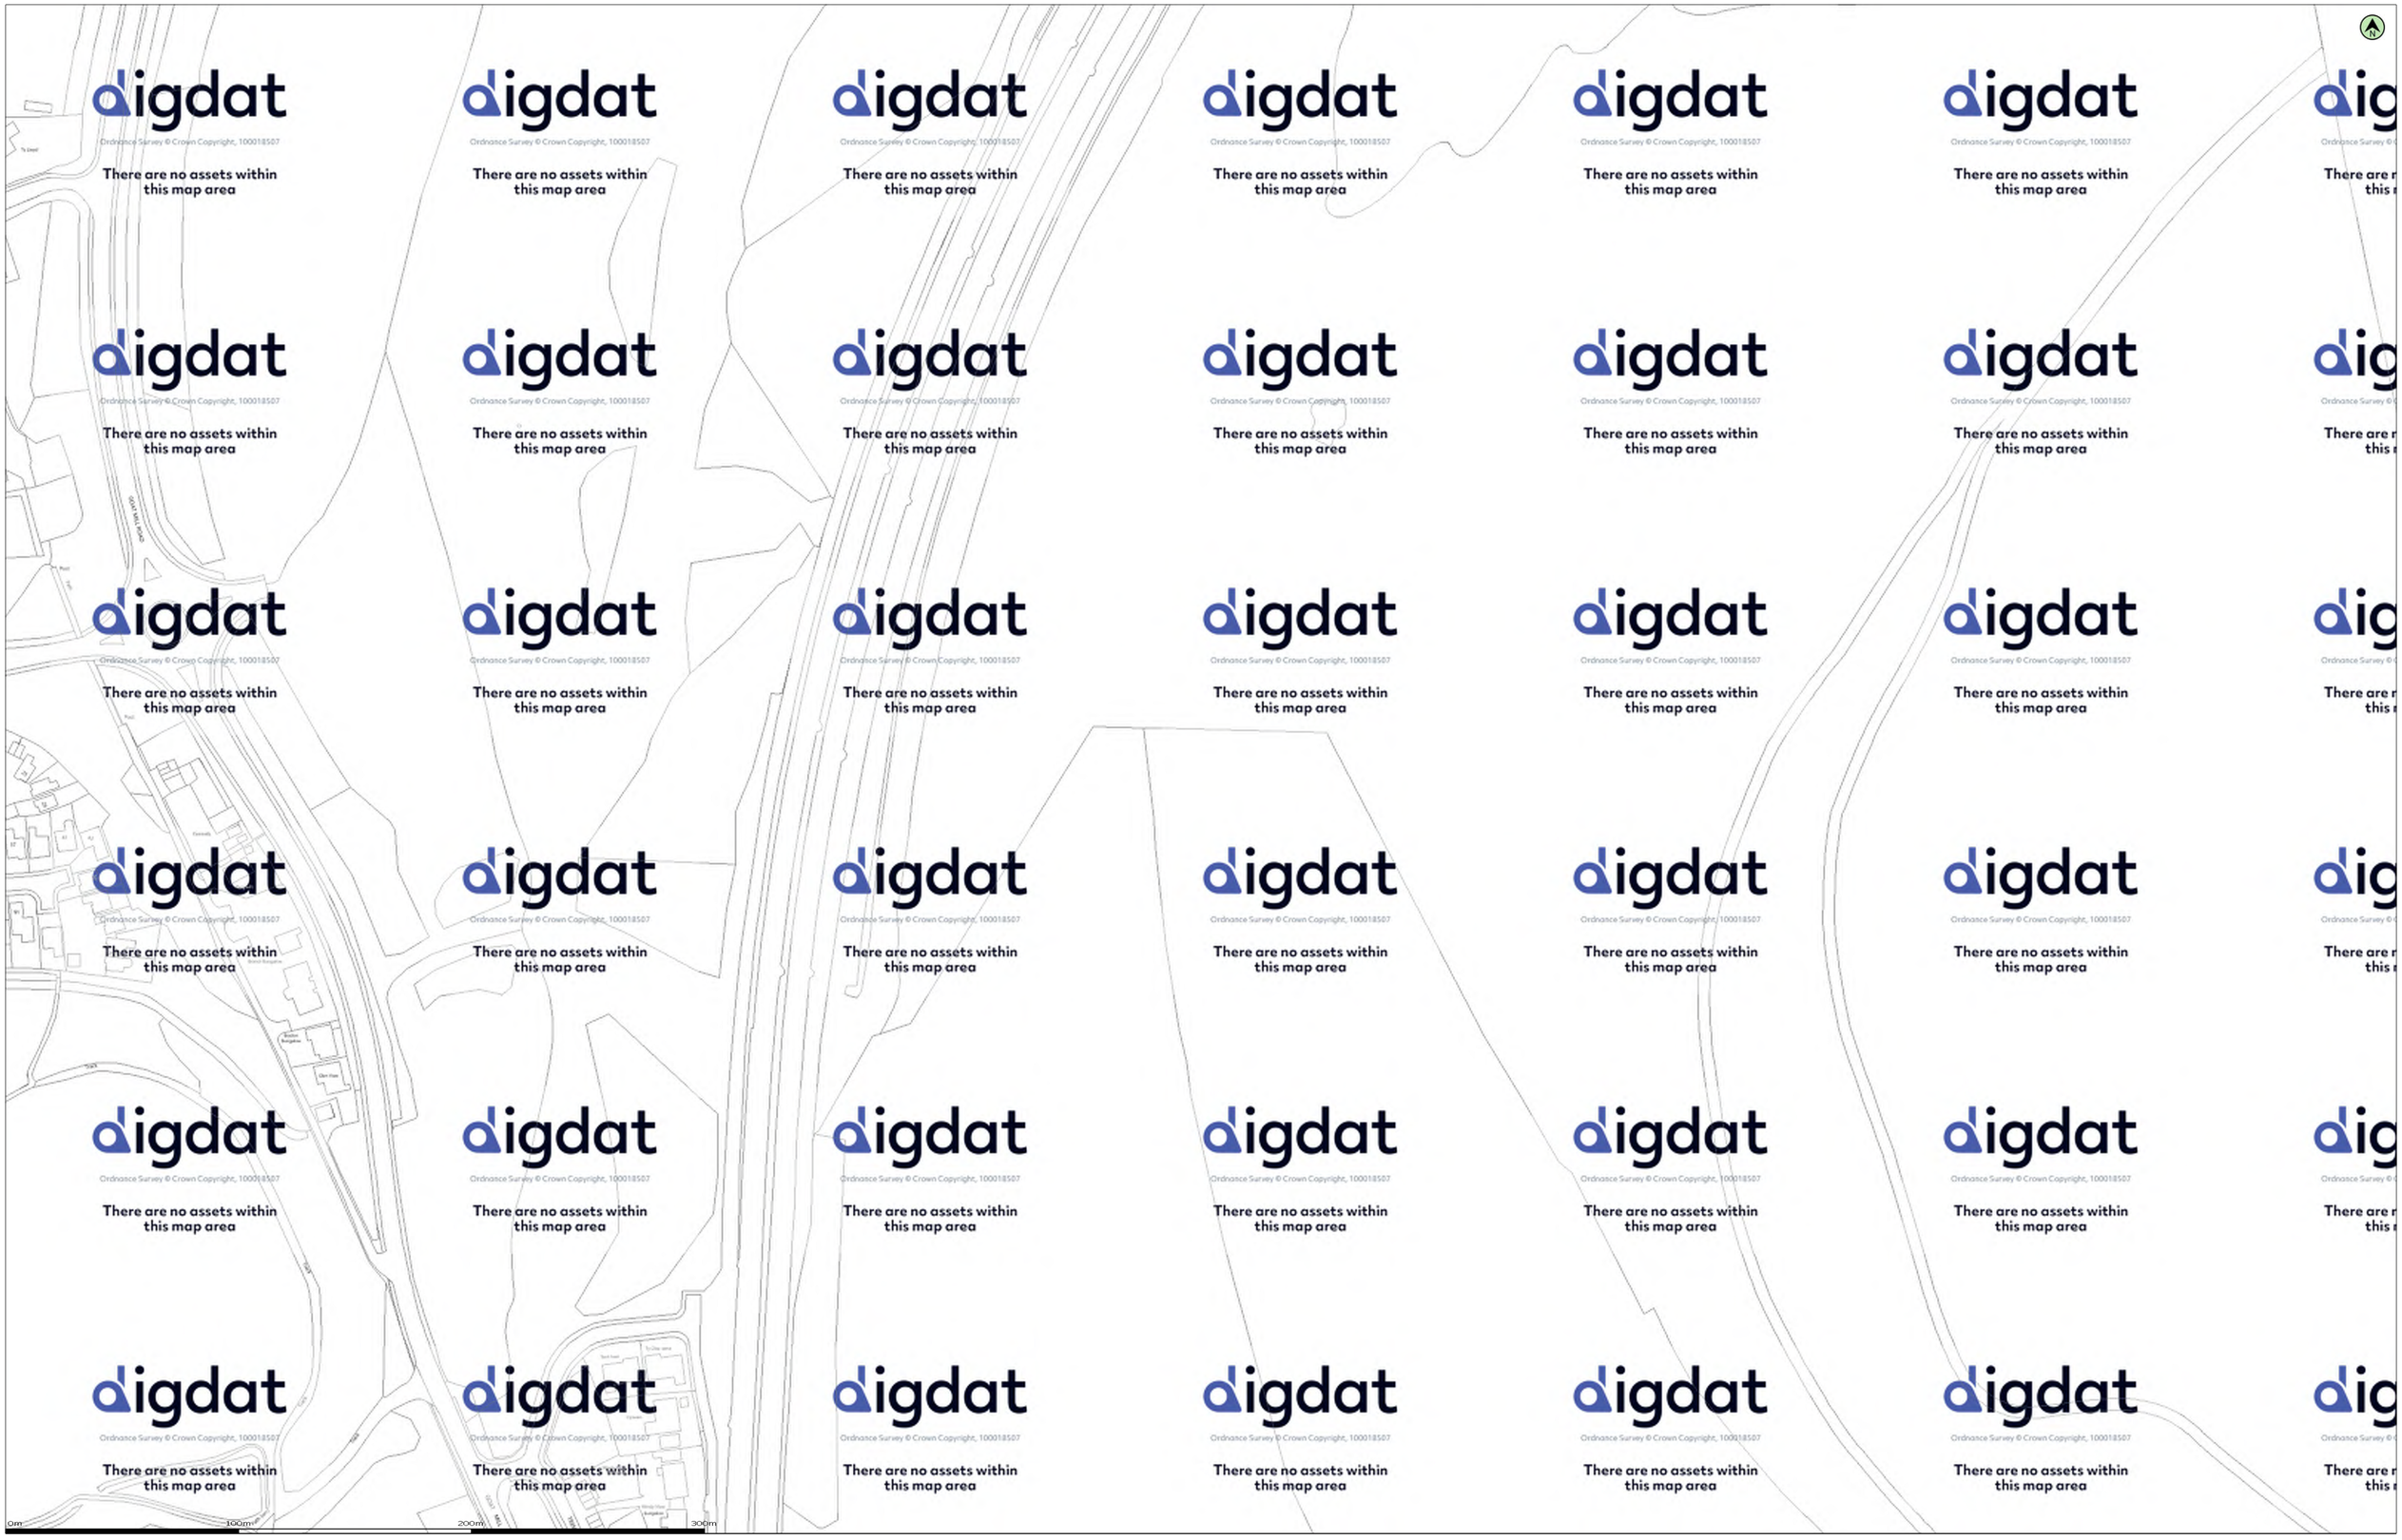

(c) Crown copyright and database rights 2023 Ordnance Survey 100019209 | Date: 27/11/23 | Scale: 1:1250 | Map Centre: 306516,206672 | Data updated: 02/10/23 | Our Ref: 1330885 - 2 | Telecoms Plan A1

Important Information - please read The purpose of this plan is to identify Virgin Media apparatus. We have tried to make it as accurate as possible but we cannot warrant its accuracy. In addition, we caution that within Virgin Media apparatus there may be instances where mains voltage power cables have been placed inside green, rather than black ducting. Further details can be found using the "Affected Postcodes.pdf", which can be downloaded from this website. Therefore, you must not rely solely on this plan if you are carrying out any excavation or other works in the vicinity of Virgin Media apparatus. The actual position of any underground service must be verified by cable detection equipment, etc. and established on site before any mechanical plant is used. Accordingly, unless it is due to the negligence of Virgin Media, its employees or agents, Virgin Media will not have any liability for any omissions or inaccuracies in the plan or for any loss or damage caused or arising from the use of and/or any reliance on this plan. This plan is produced by Virgin Media Limited (c) Crown copyright and database rights 2023 Ordnance Survey 100019209.

Duct, Trench | Chamber / Pole | Cabinet

lee.munro@wsp.com

P02


digdat
Ordnance Survey © Crown Copyright, 100018507
There are no assets within this map area
Ffordd Llan Mor
Bryn Bungalow
Llan Mor
Bryn Bungalow
Ffordd
Ffordd
Ty'n Llwyn-onn
Llan Mor
Glyn Teg
Windy Ridge Bungalow
Windy View Bungalow
Ffordd
Ffordd
Ffordd
Ffordd
Cwm a Bryn
Yew Bungalow
Ffordd
Ffordd
Ffordd
Ffordd



digdat
Ordnance Survey © Crown Copyright, 100018507
There are no assets within this map area

(c) Crown copyright and database rights 2023 Ordnance Survey 100019209 | Date: 27/11/23 | Scale: 1:1250 | Map Centre: 306581,207292 | Data updated: 02/10/23 | Our Ref: 1330885 - 1 | Telecoms Plan A1


Important Information - please read The purpose of this plan is to identify Virgin Media apparatus. We have tried to make it as accurate as possible but we cannot warrant its accuracy. In addition, we caution that within Virgin Media apparatus there may be instances where mains voltage power cables have been placed inside green, rather than black ducting. Further details can be found using the "Affected Postcodes.pdf", which can be downloaded from this website. Therefore, you must not rely solely on this plan if you are carrying out any excavation or other works in the vicinity of Virgin Media apparatus. The actual position of any underground service must be verified by cable detection equipment, etc. and established on site before any mechanical plant is used. Accordingly, unless it is due to the negligence of Virgin Media, its employees or agents, Virgin Media will not have any liability for any omissions or inaccuracies in the plan or for any loss or damage caused or arising from the use of and/or any reliance on this plan. This plan is produced by Virgin Media Limited (c) Crown copyright and database rights 2023 Ordnance Survey 100019209.

Duct, Trench | Chamber / Pole | Cabinet

lee.munro@wsp.com

P01

Virgin media

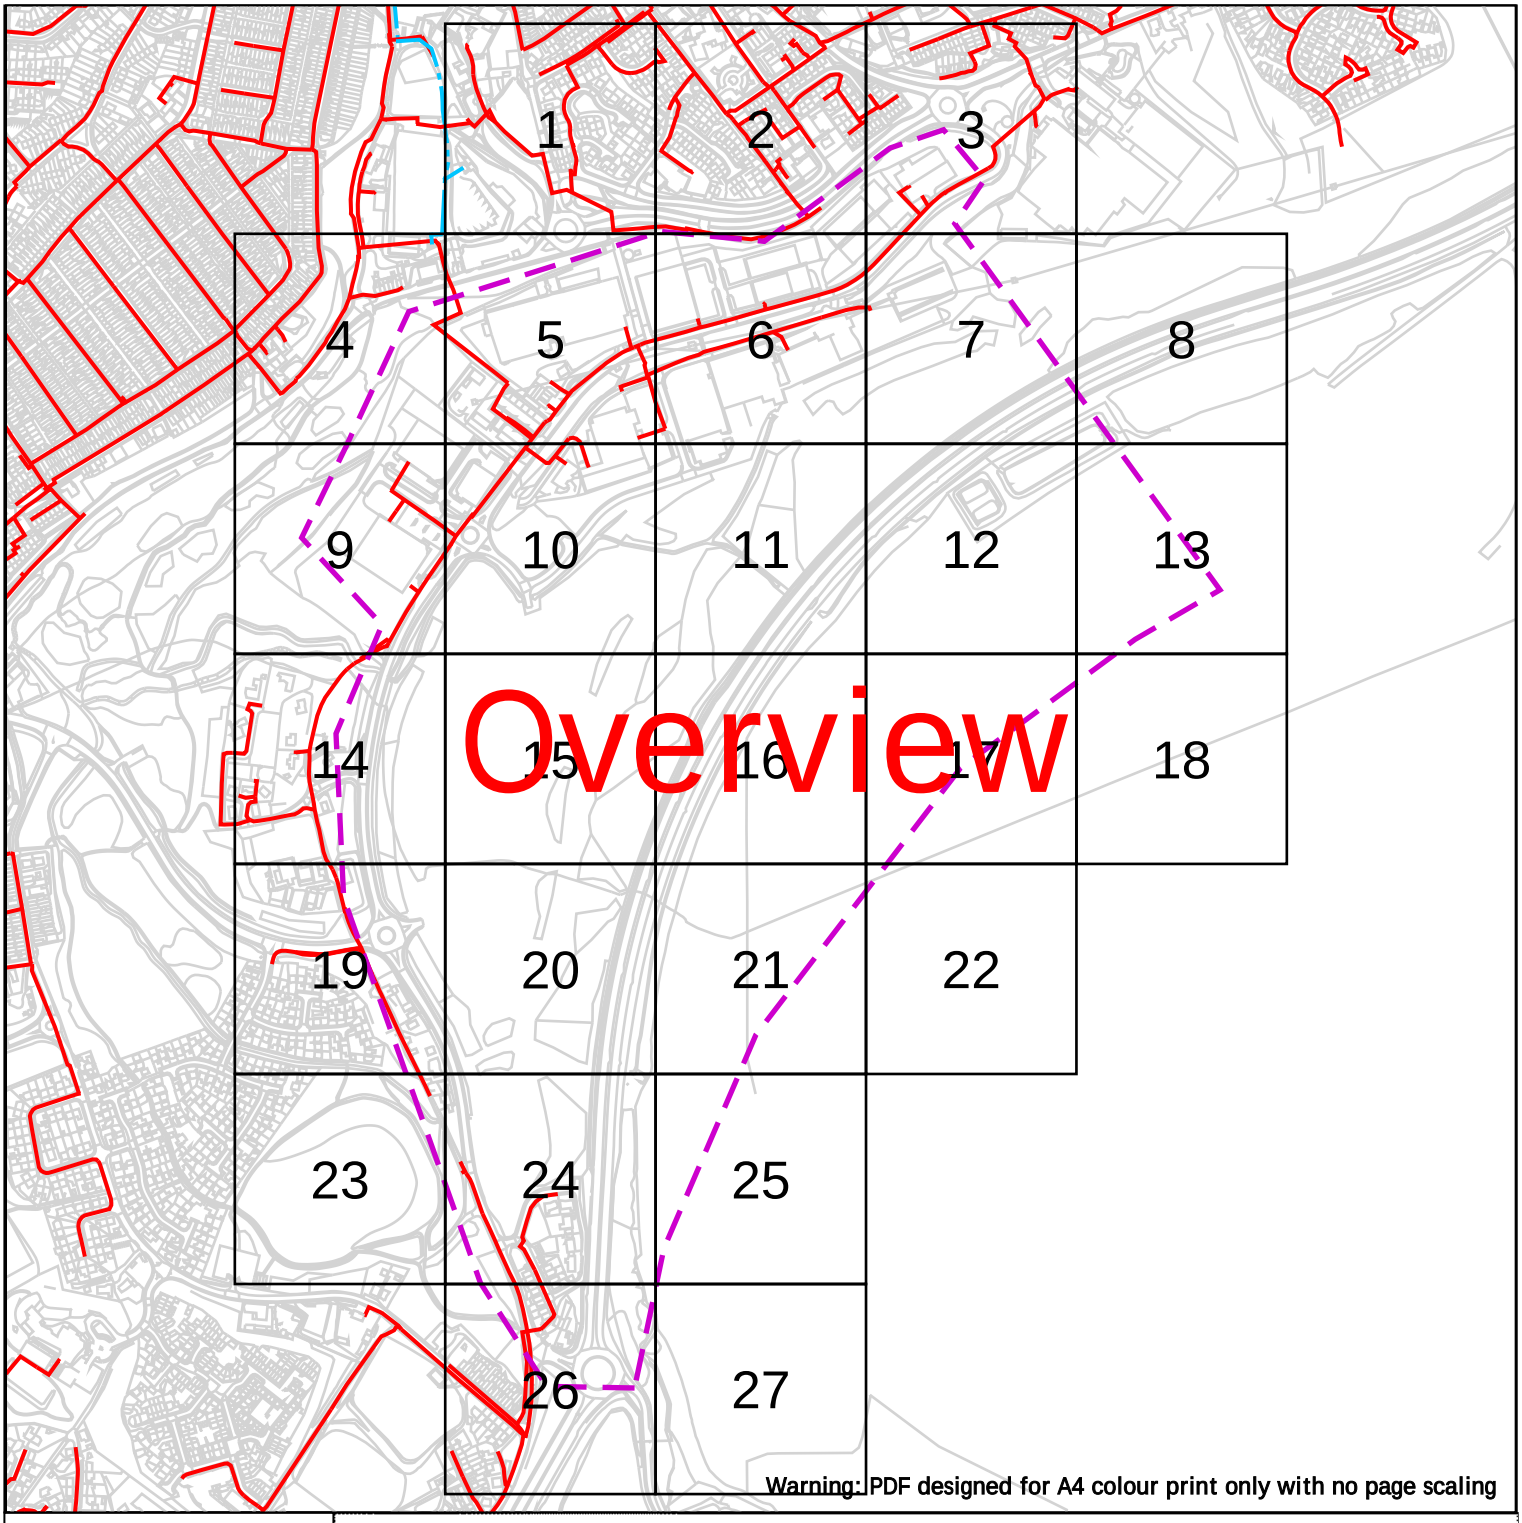

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:8969 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

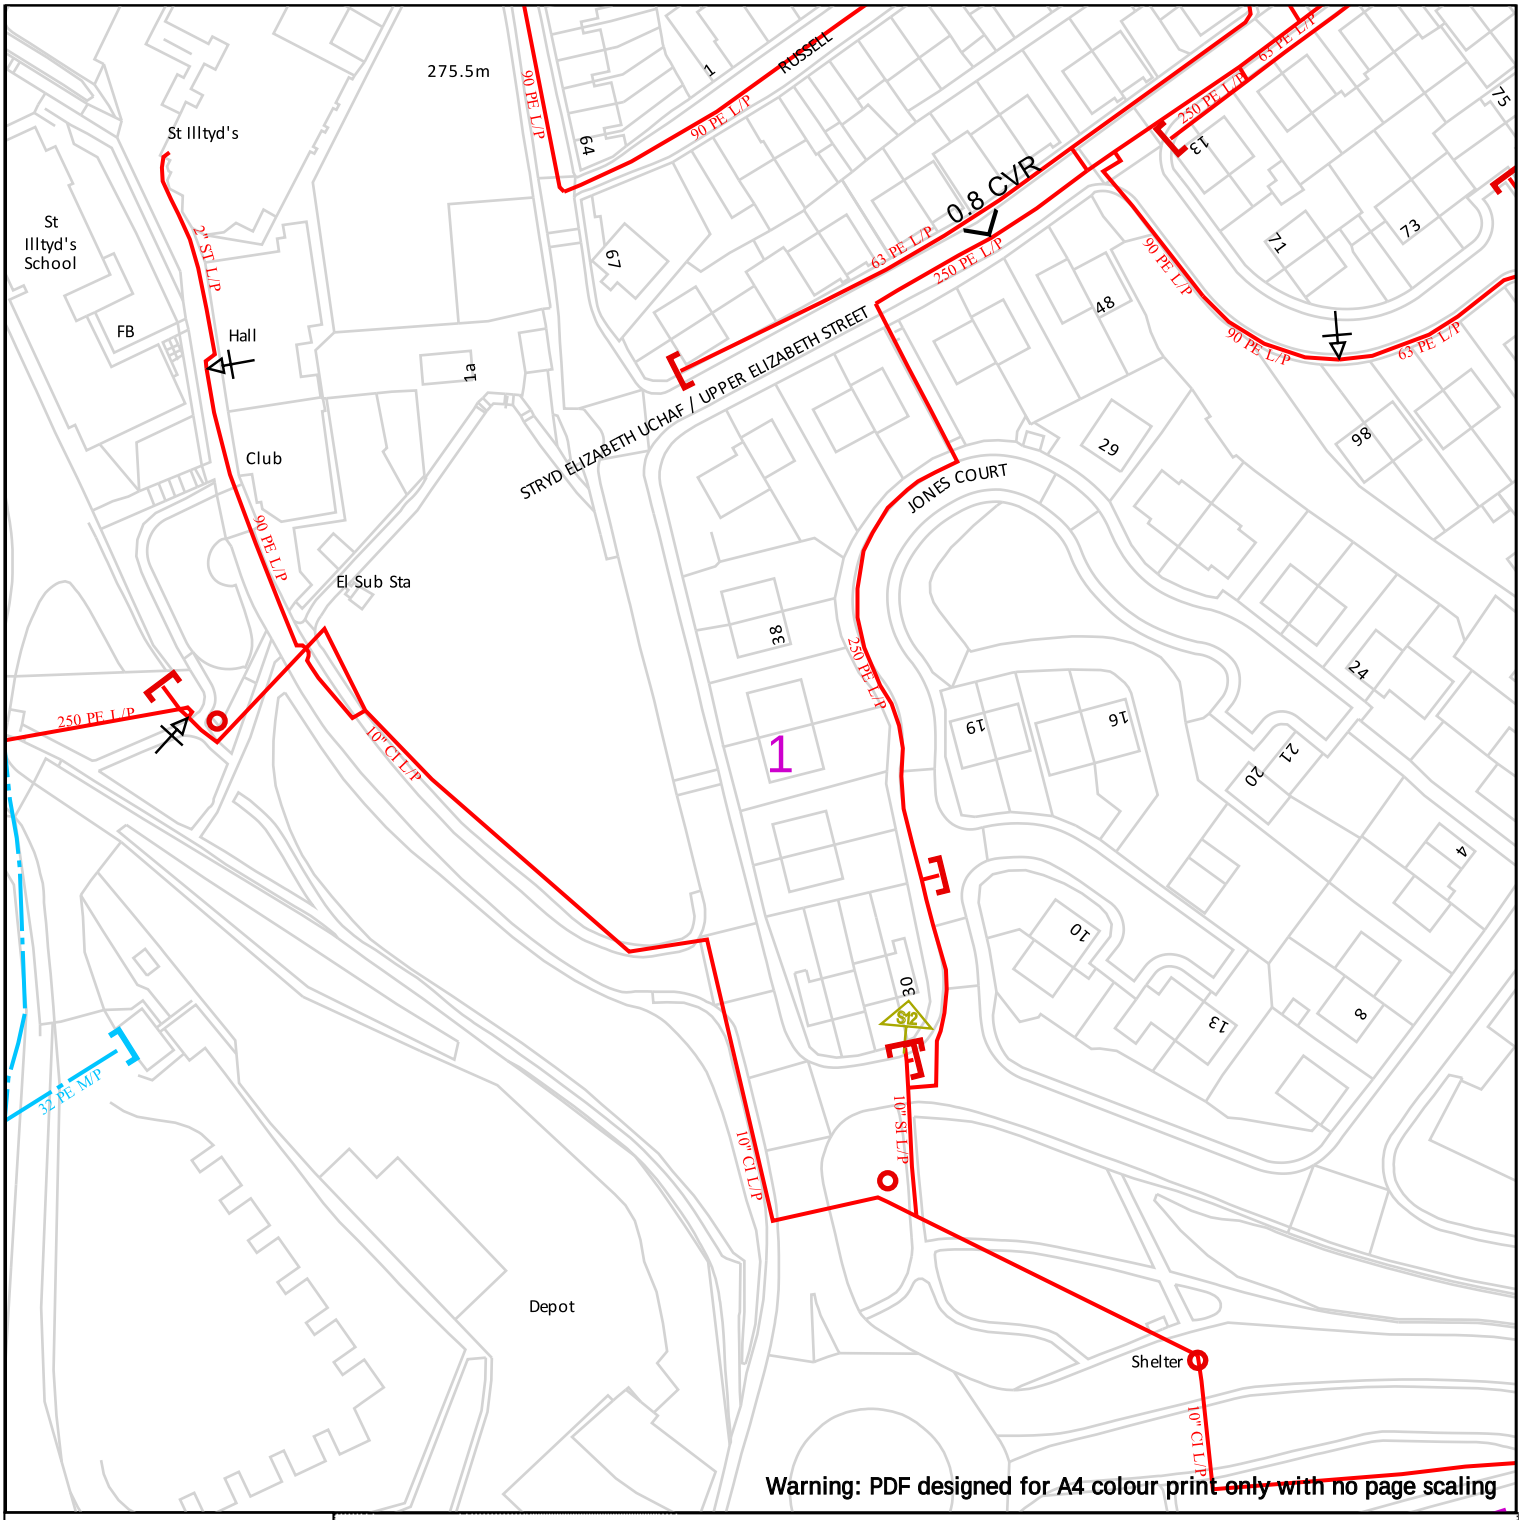

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

Change of Diameter | Line/Fire Valve | End Cap | Governor Station | Depth of cover

Contact Us

Mapping Enquiries:
All areas 02920 278 912

General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Dial before you dig
Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

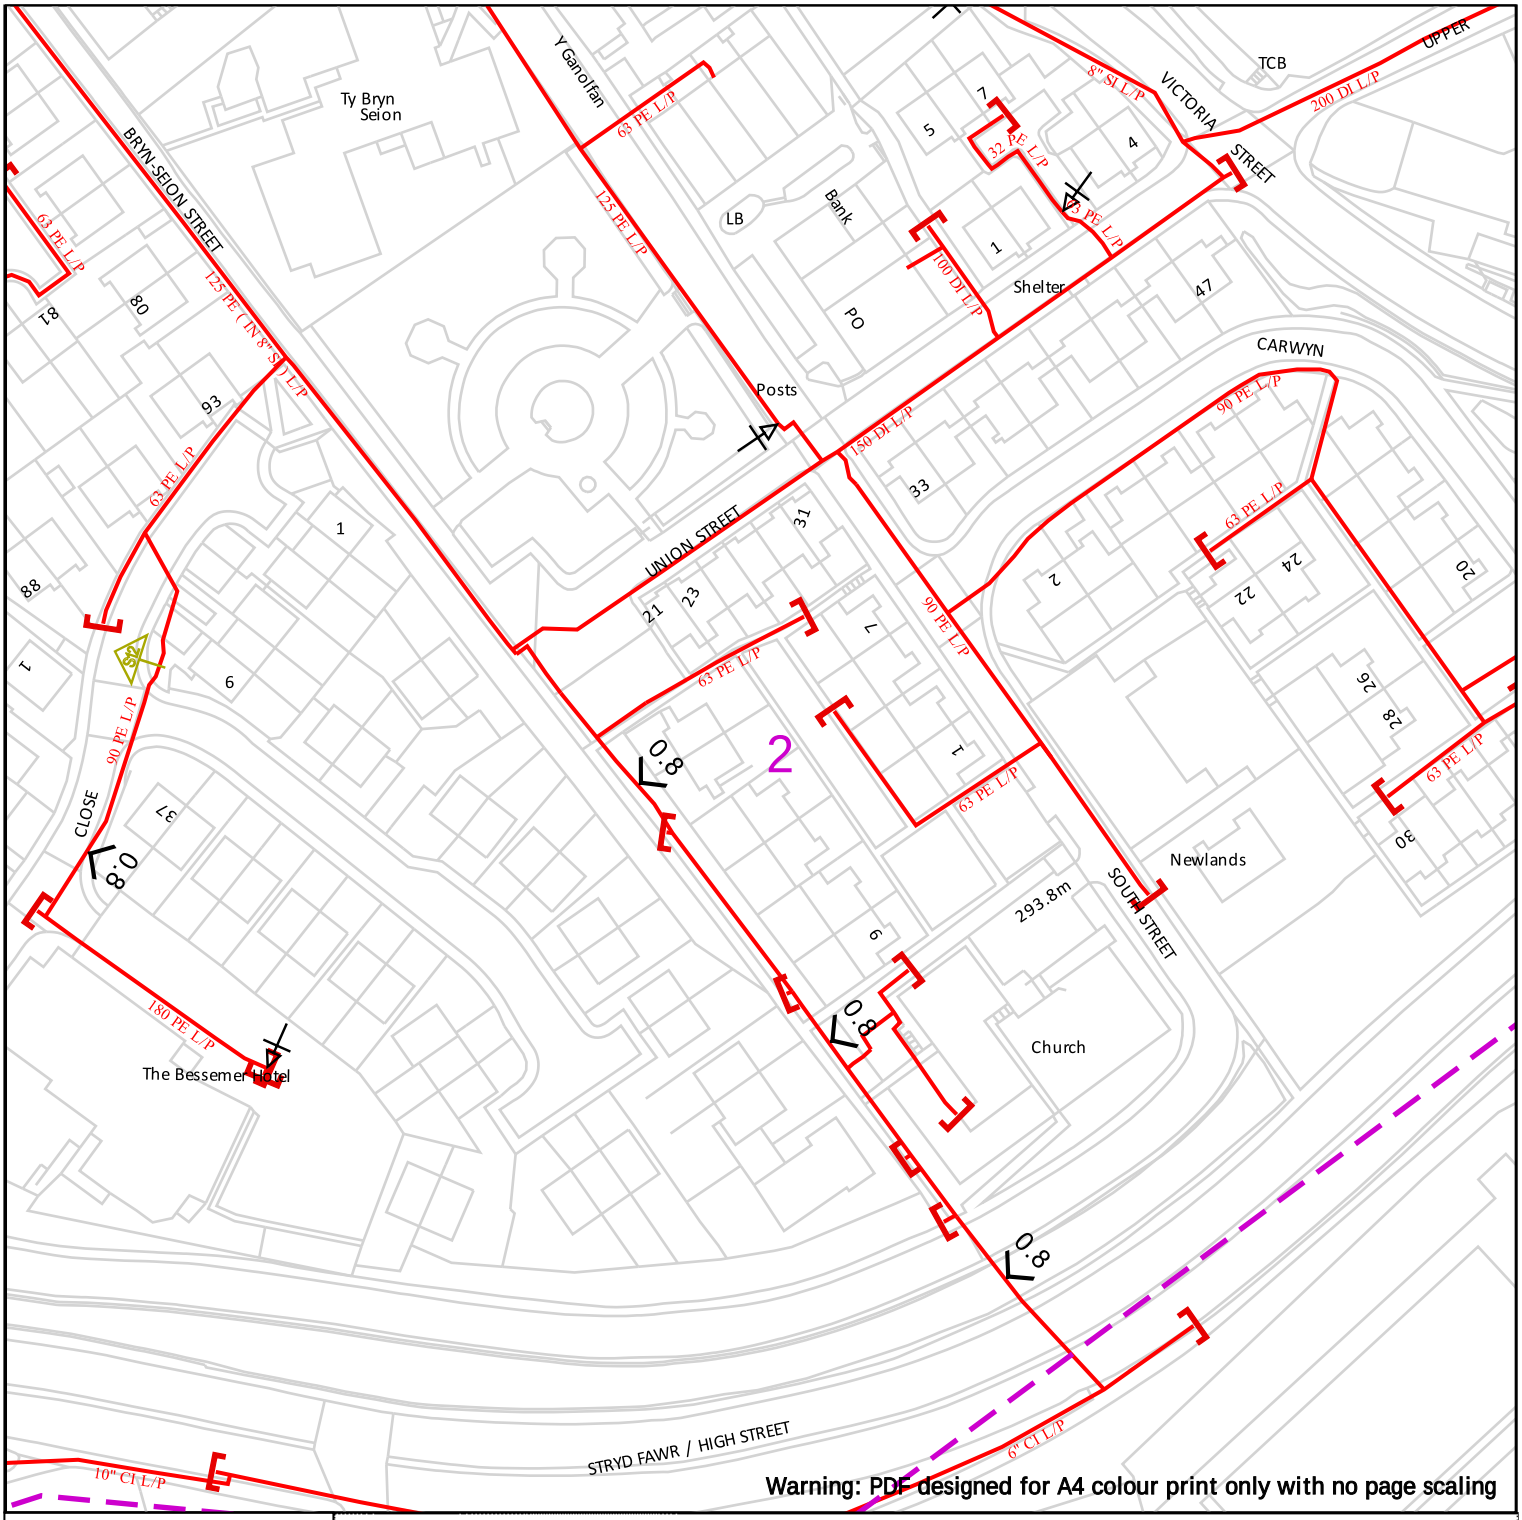

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Dial before you dig
Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

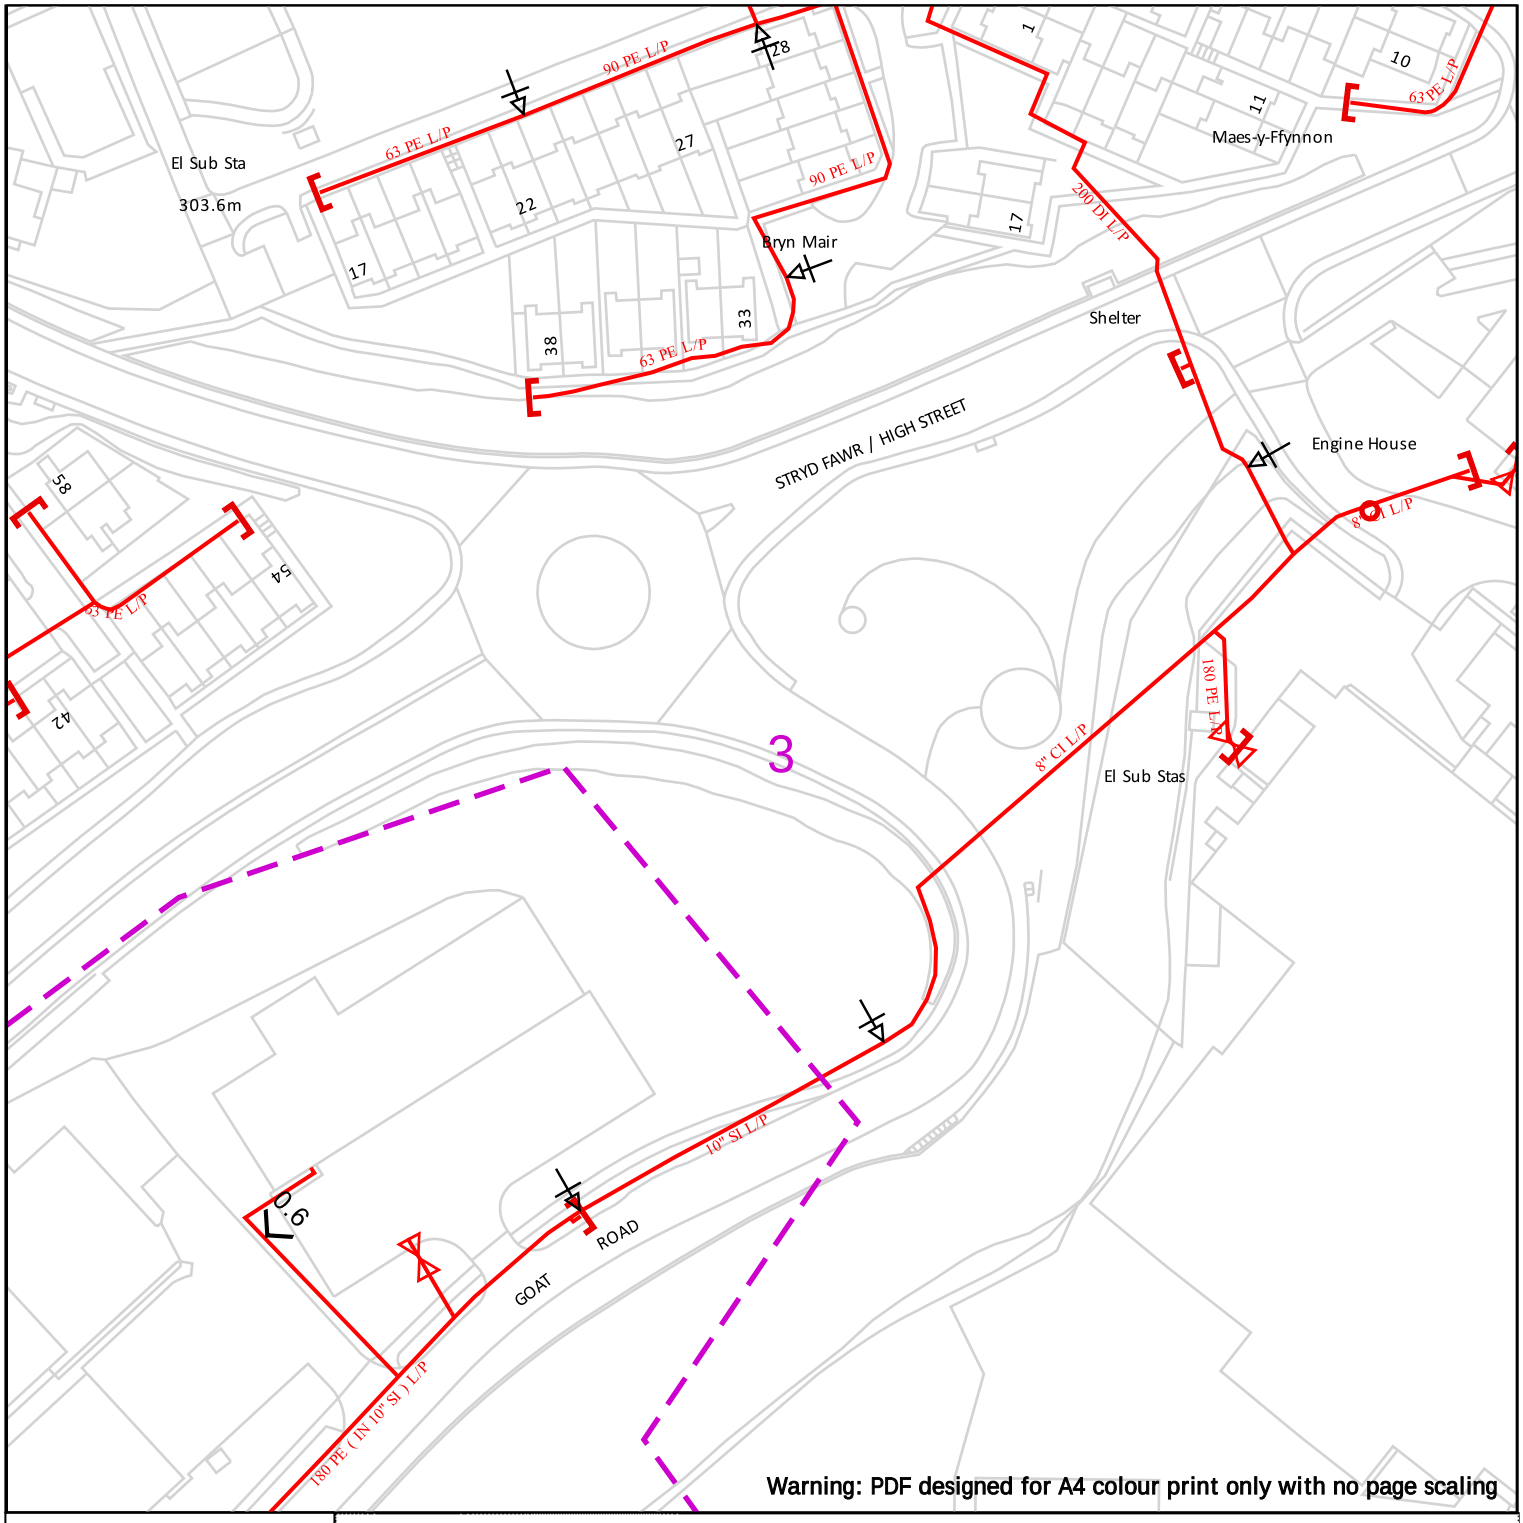

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

Change of Diameter
End Cap
Depth of cover
Line/Fire Valve
Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial before you dig
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

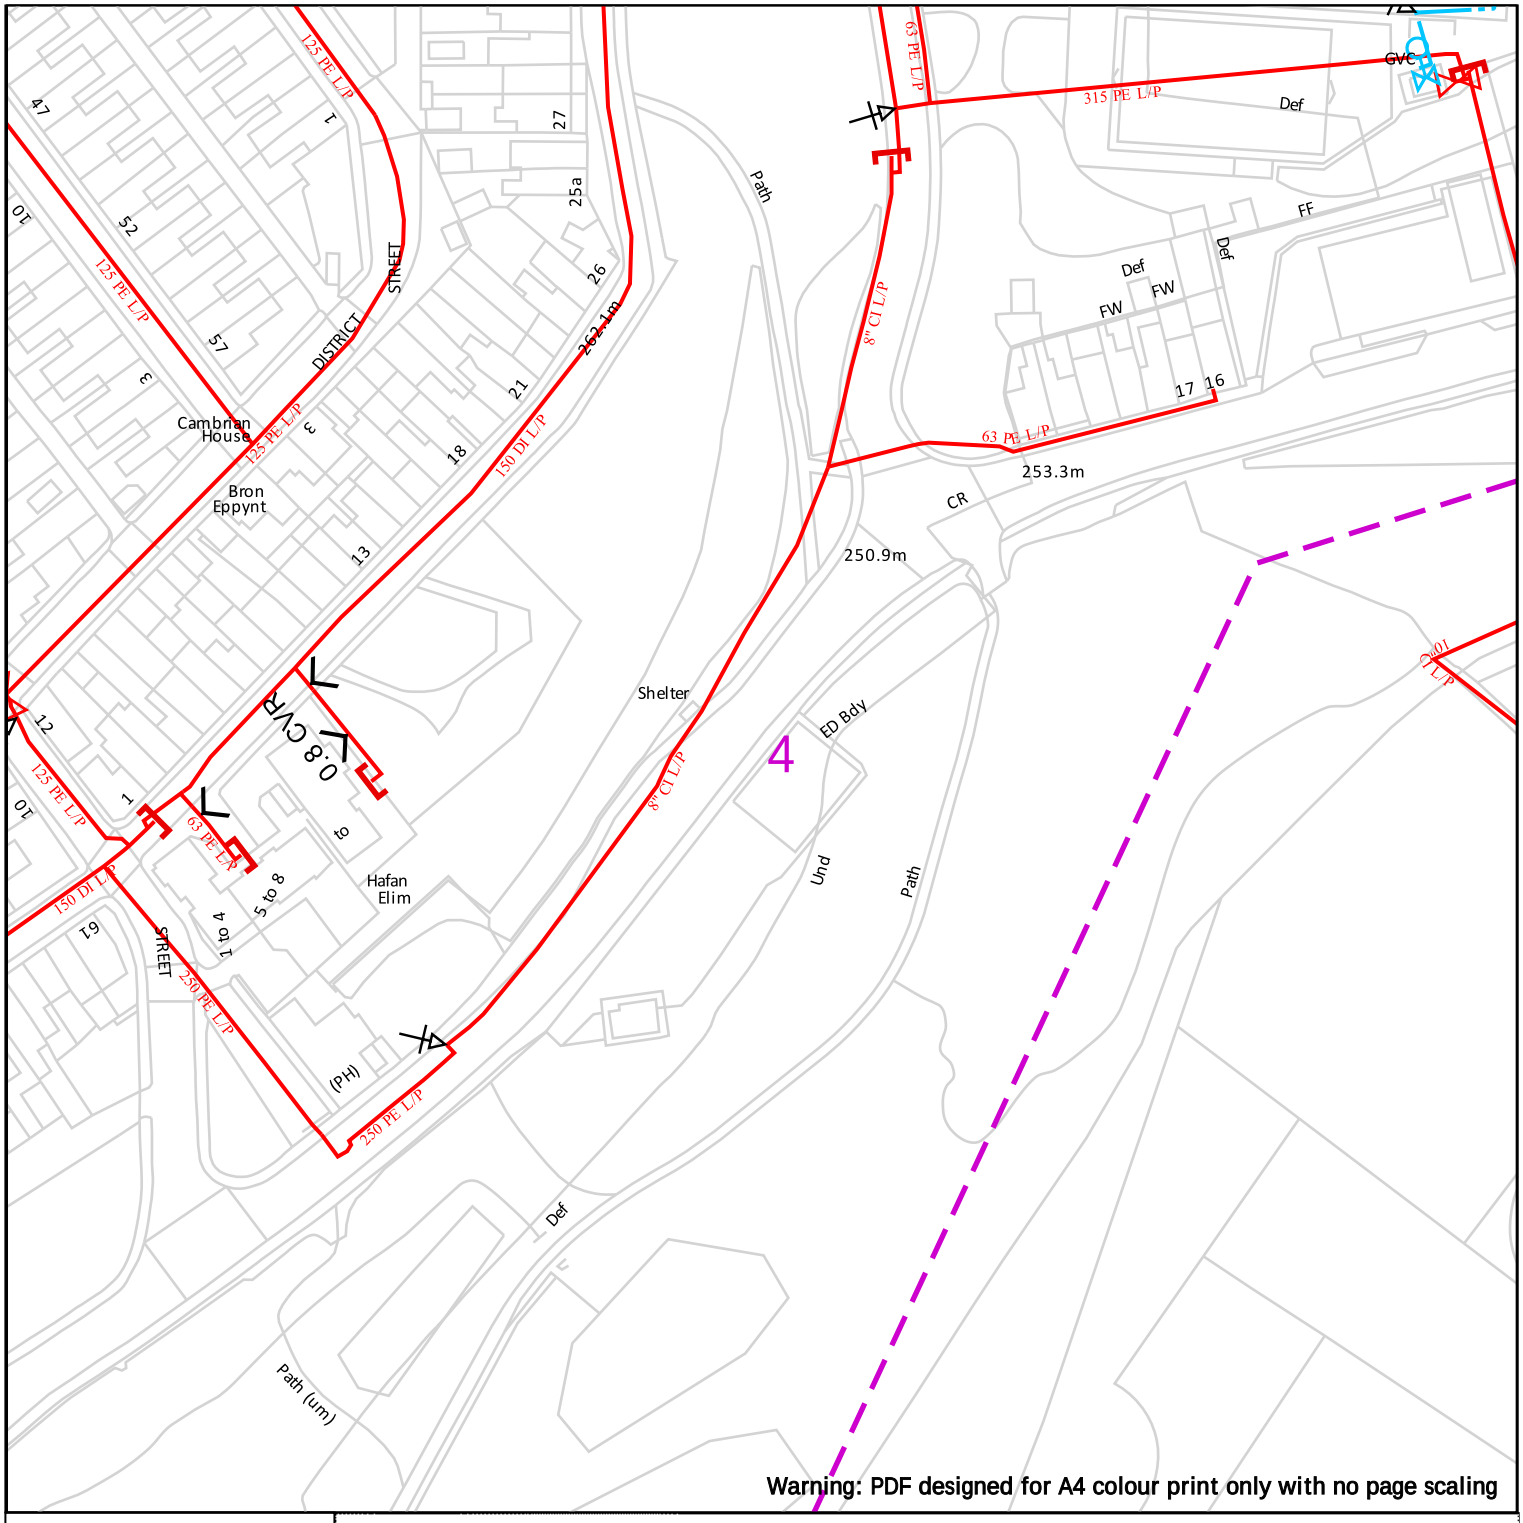

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

Change of Diameter
End Cap
Depth of cover
Line/Fire Valve
Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

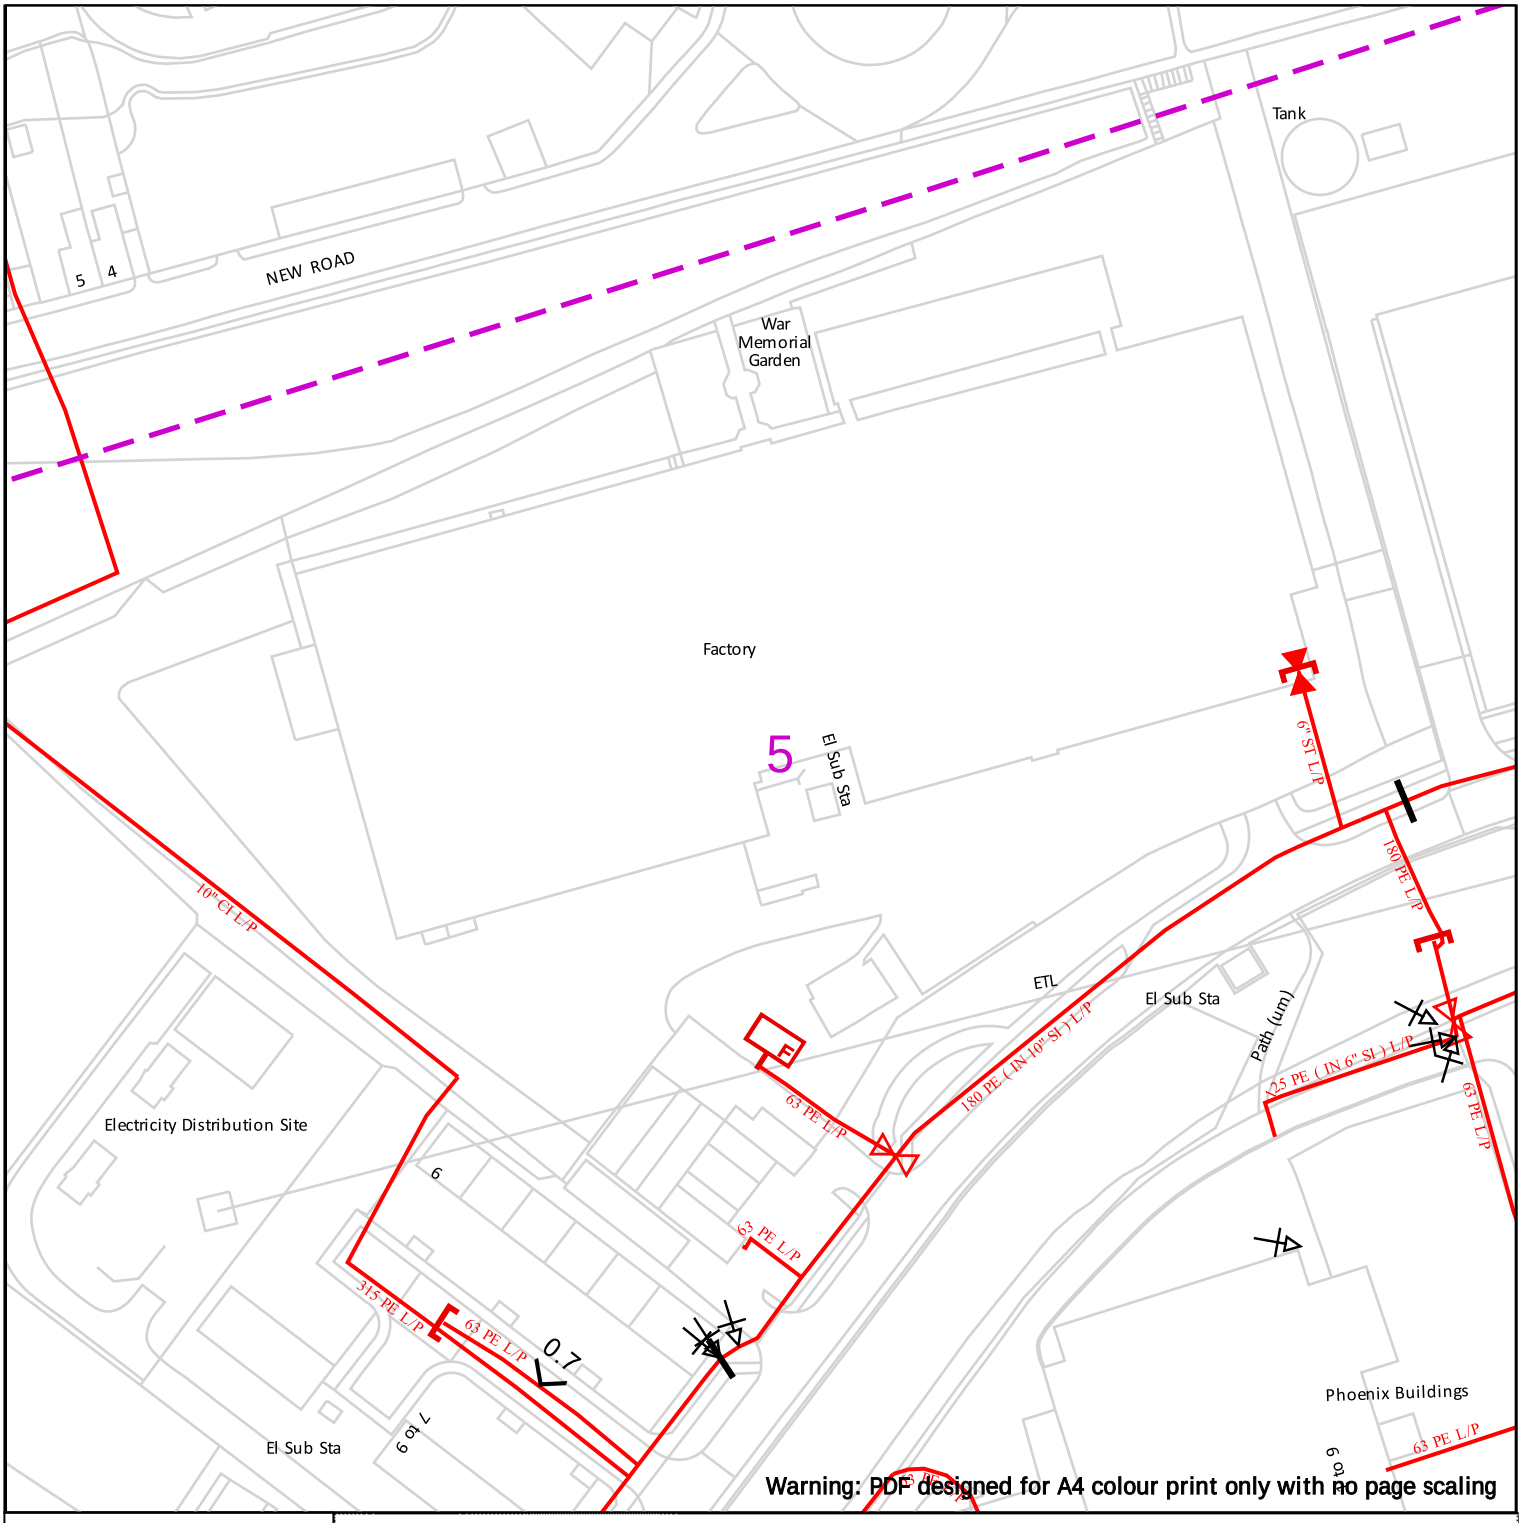

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

Change of Diameter
End Cap
Depth of cover
Line/Fire Valve
Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Dial before you dig

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

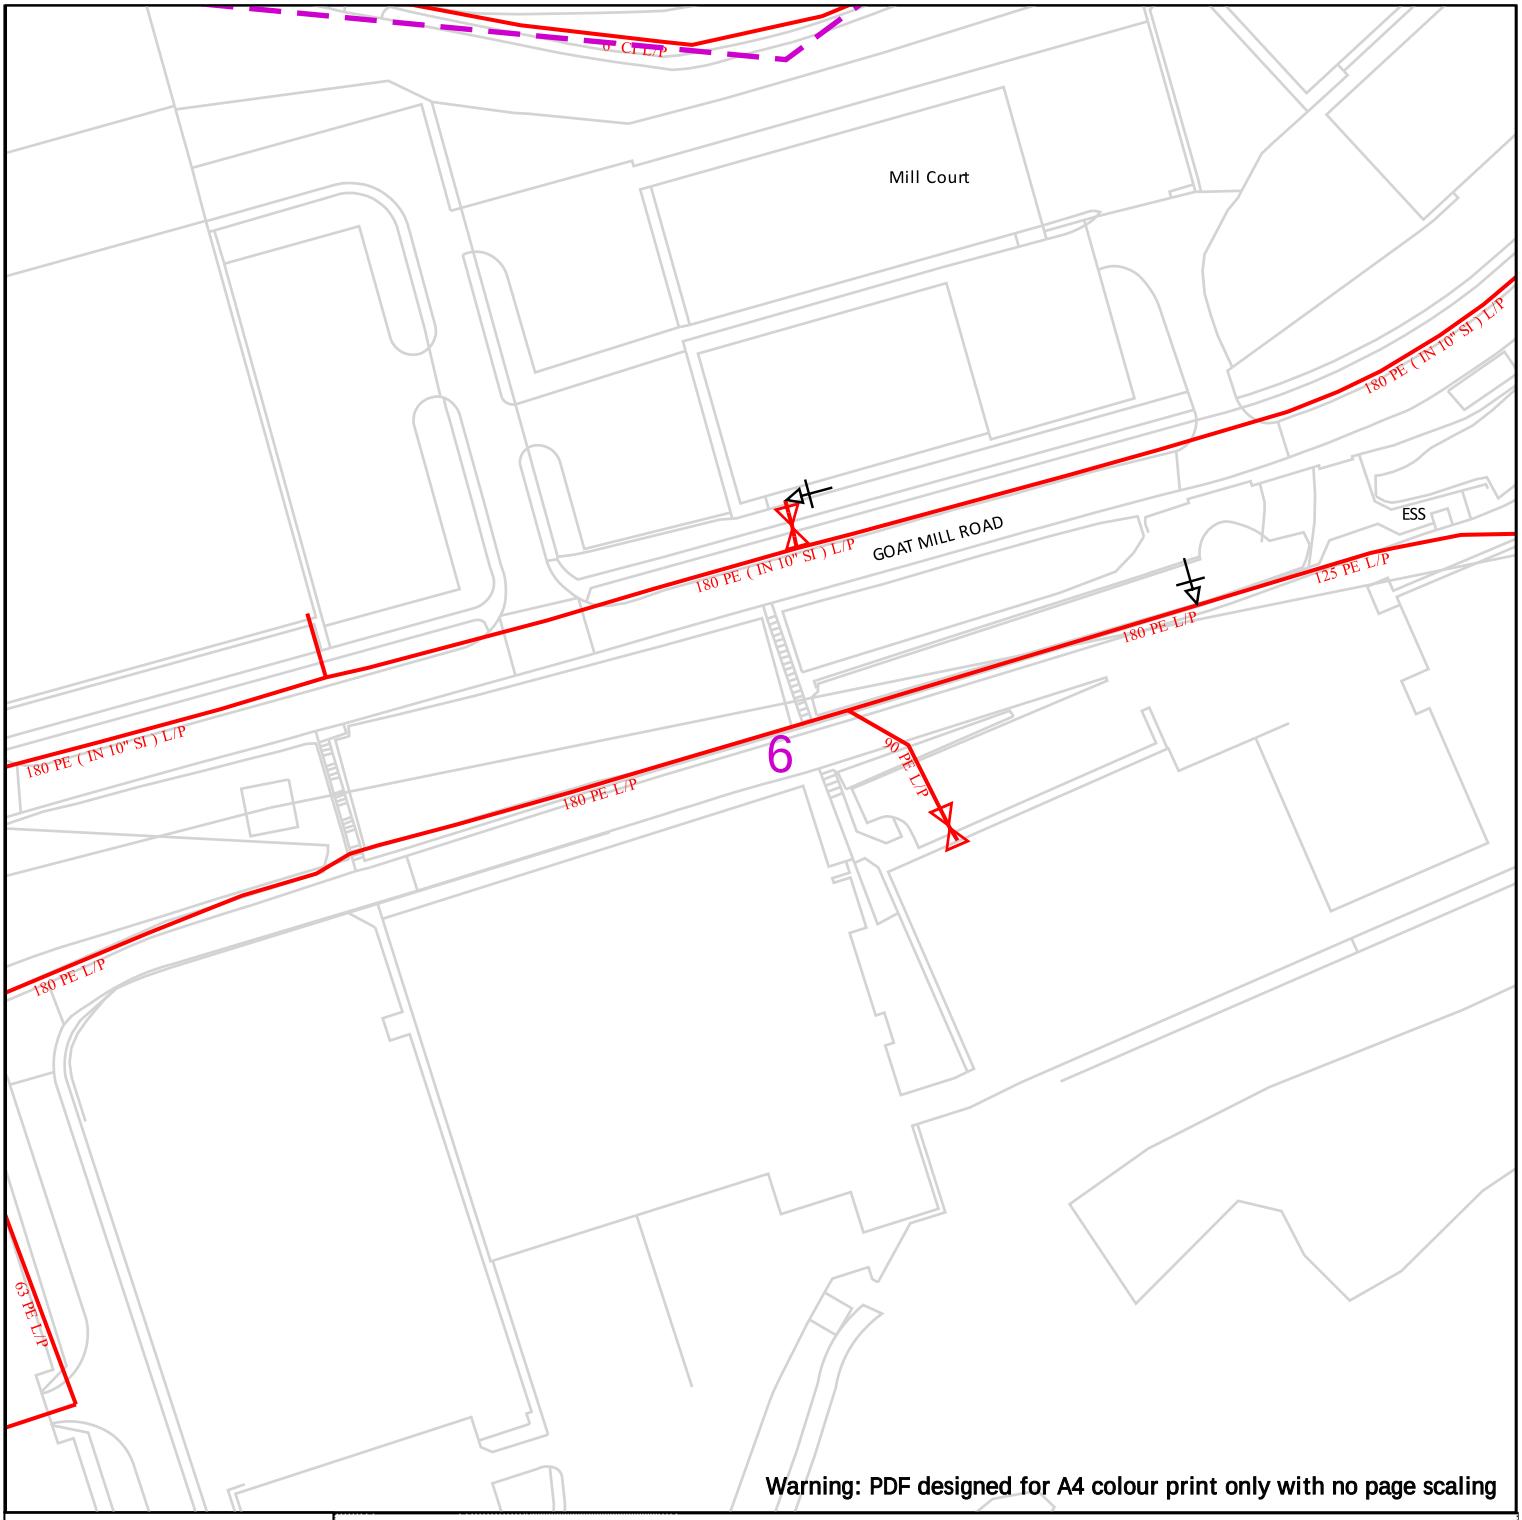

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Dial before you dig
Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

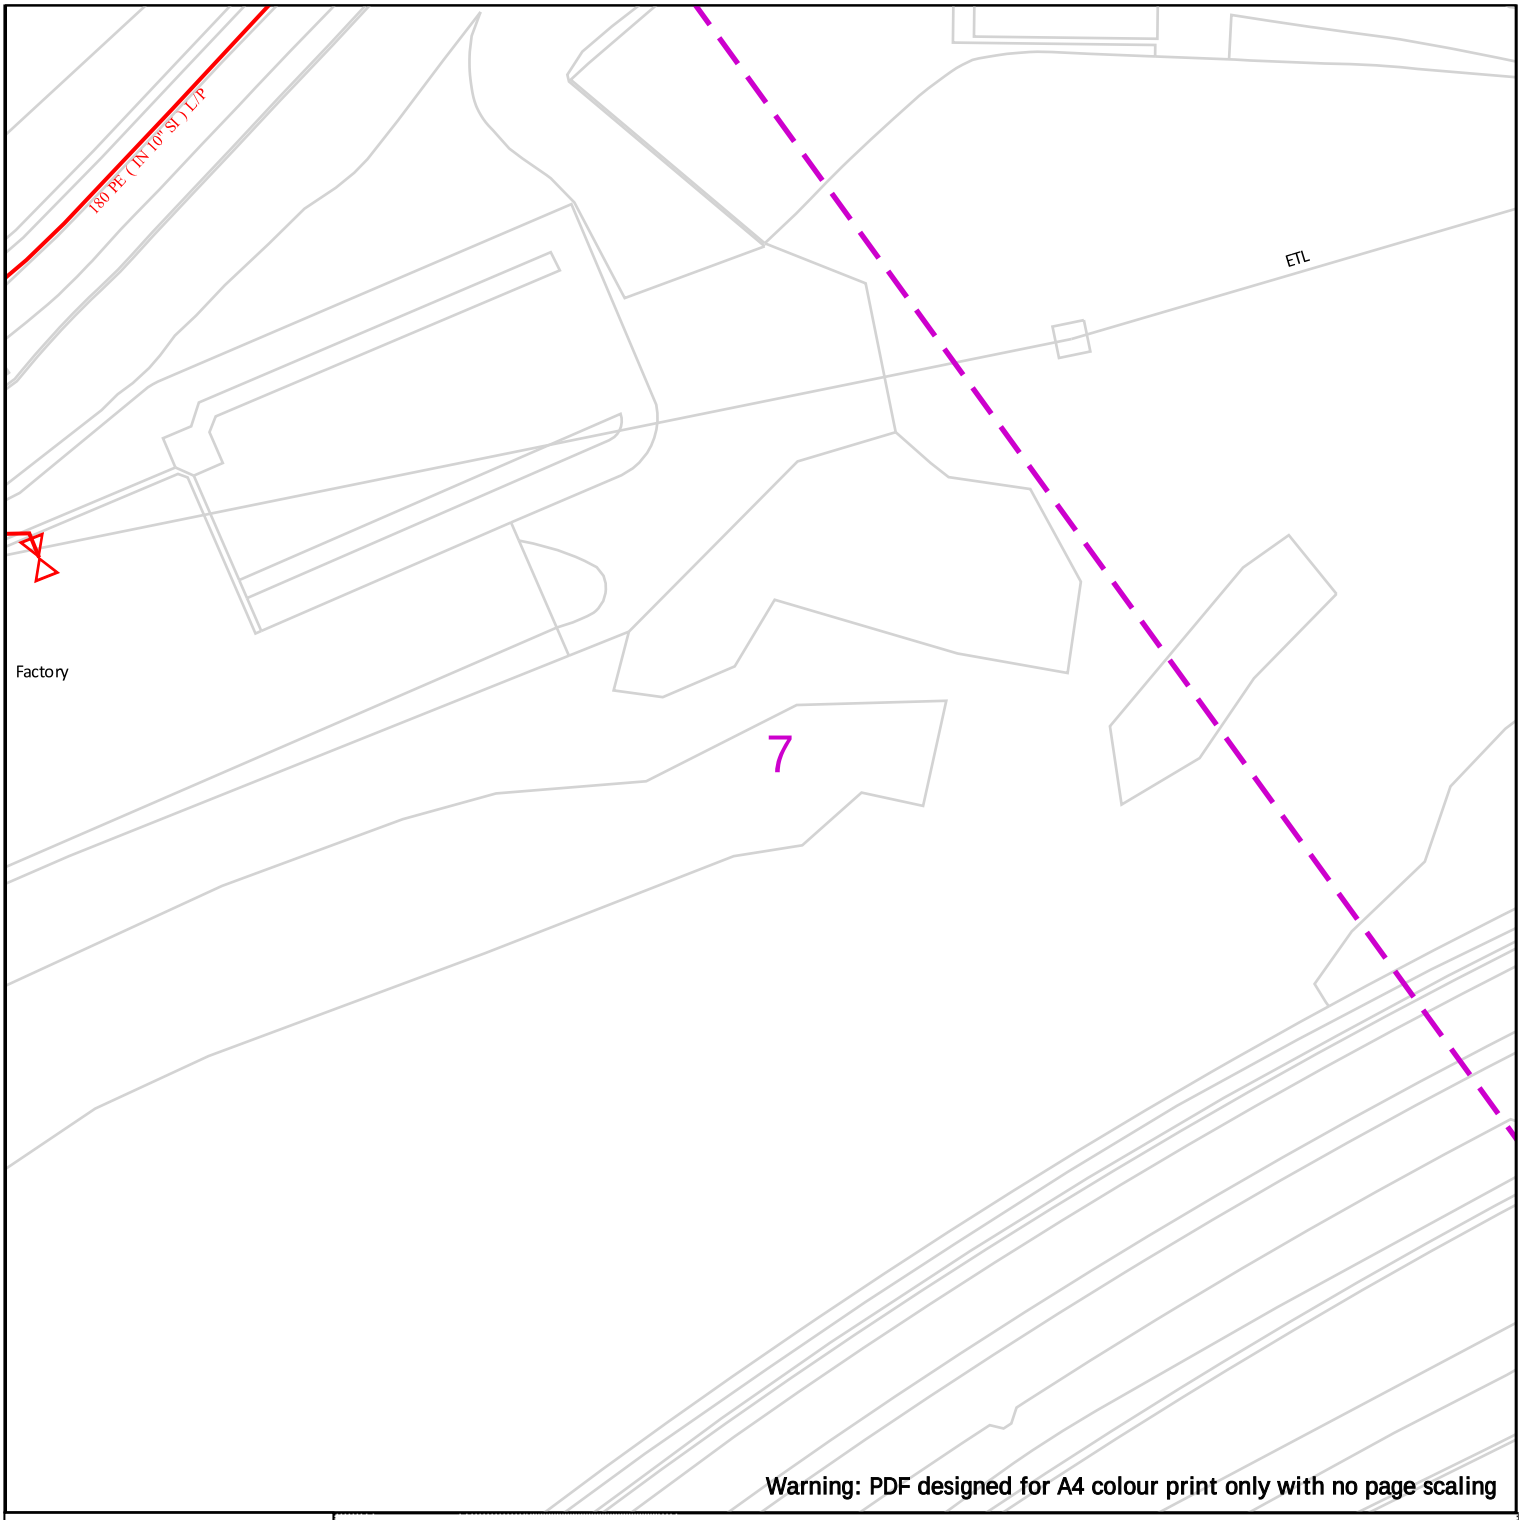

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.



Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

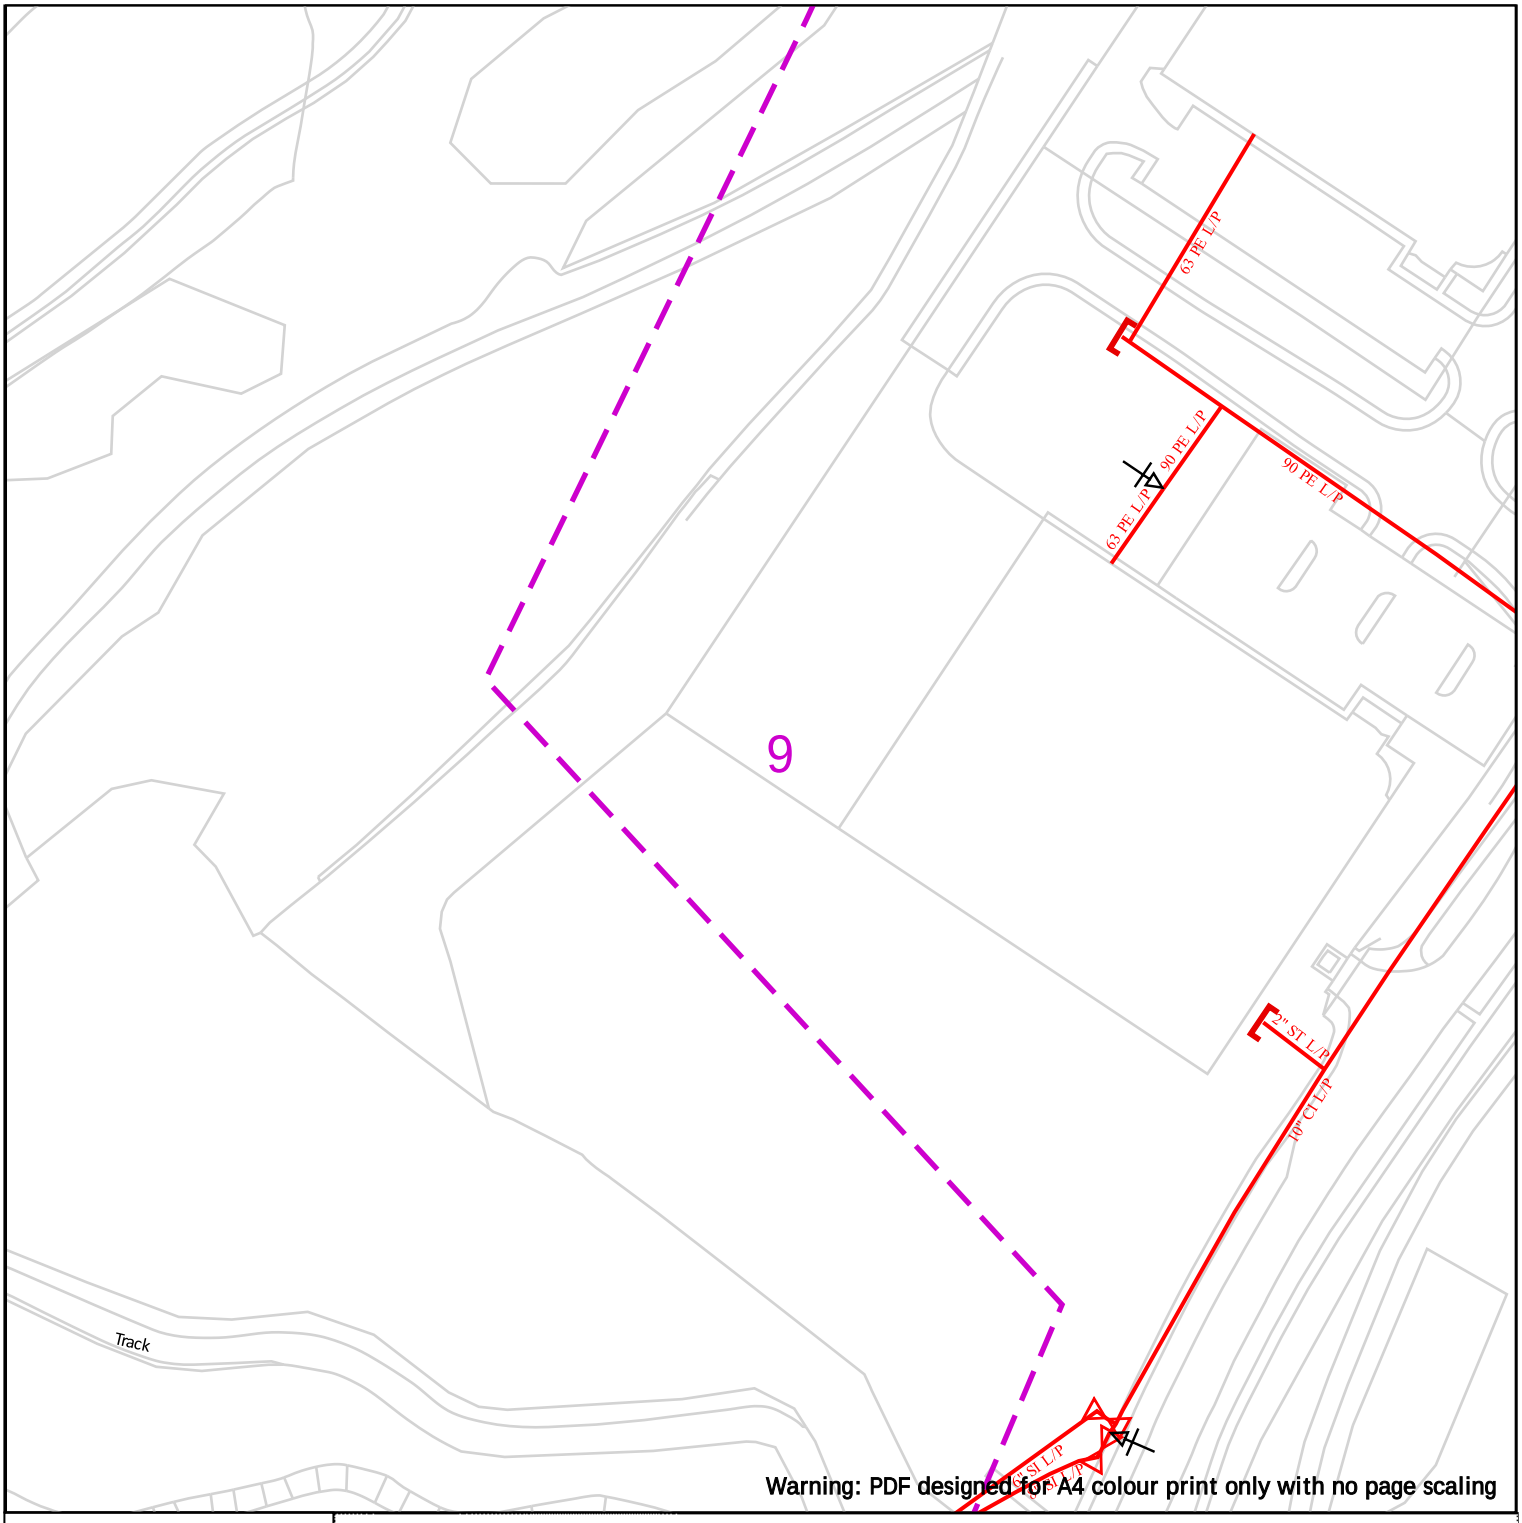

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

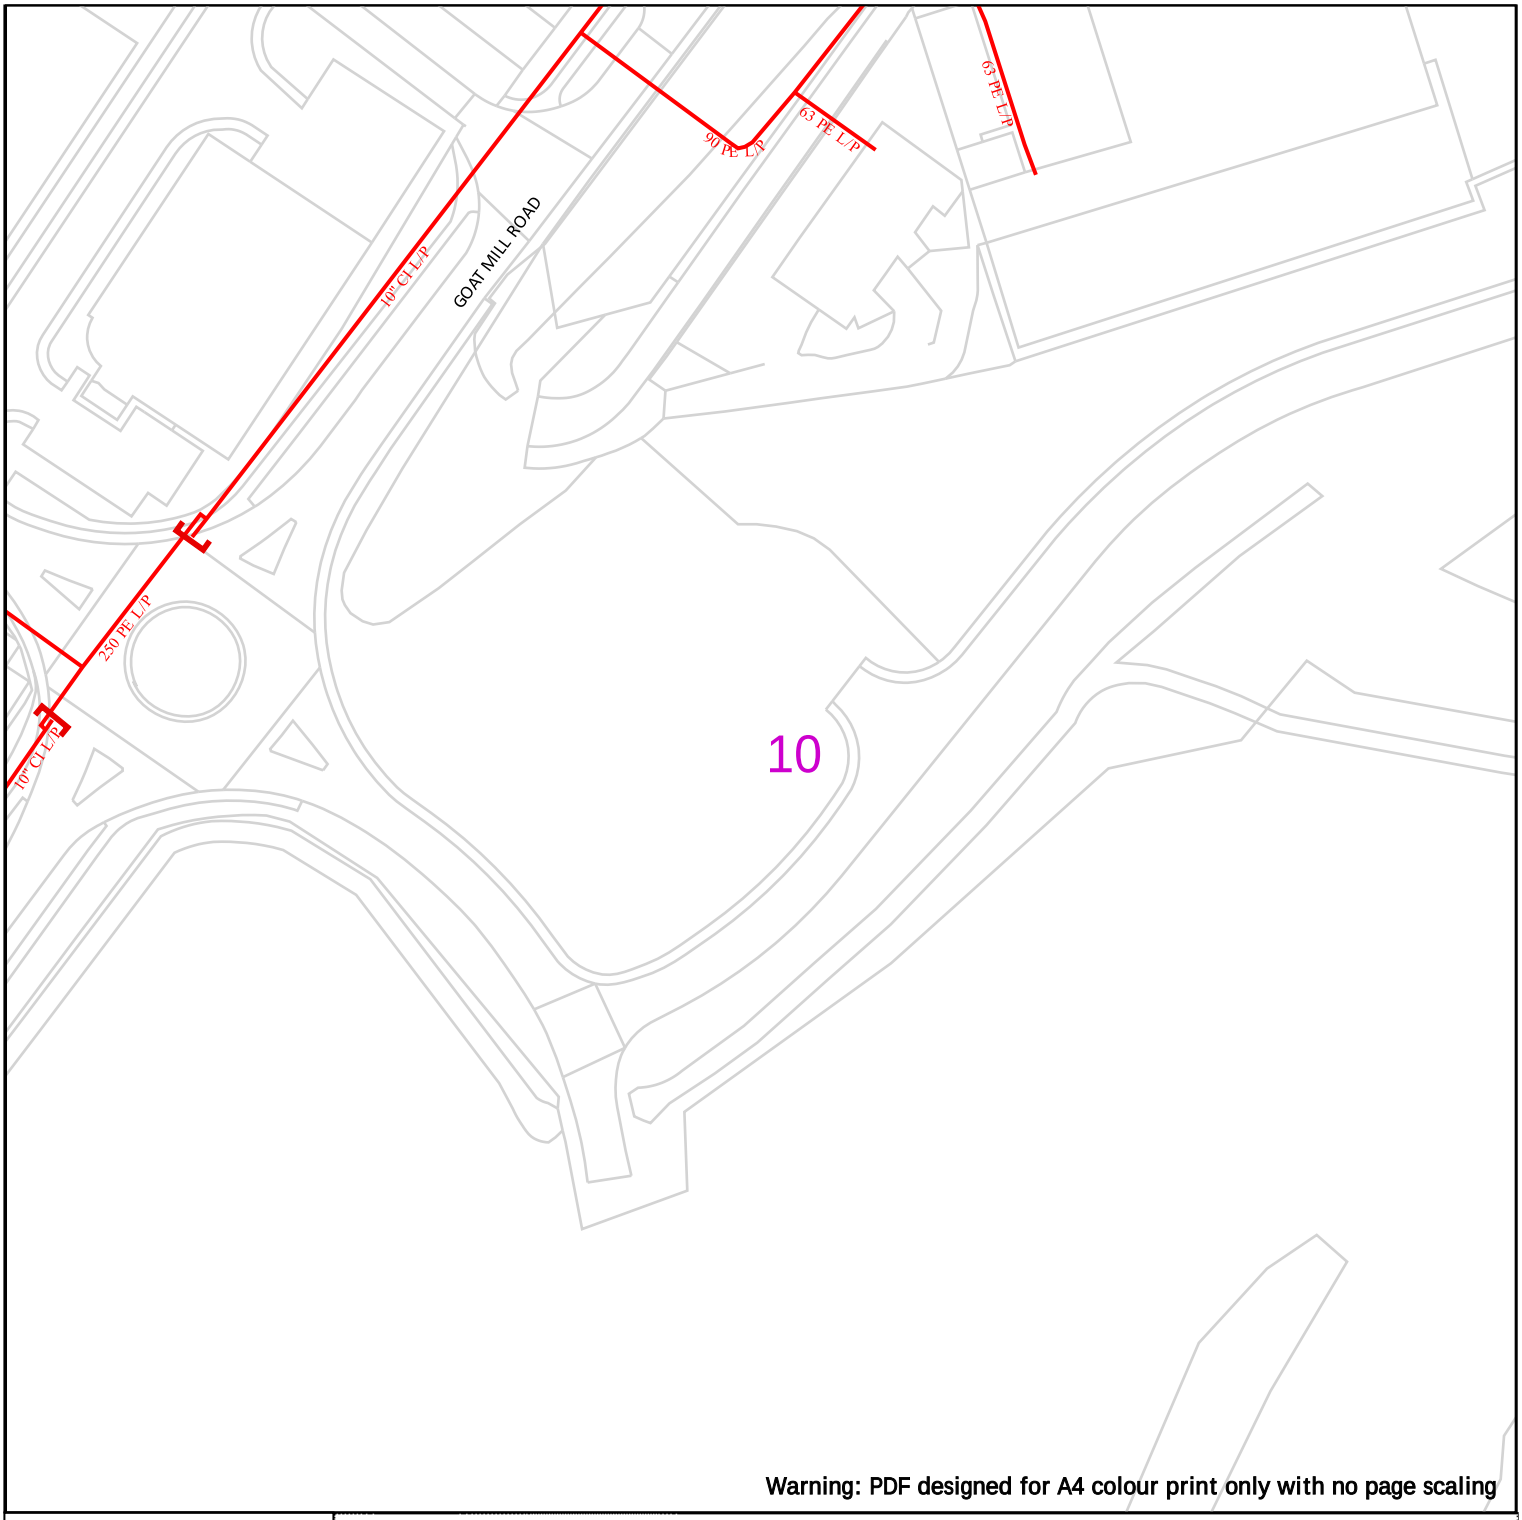

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

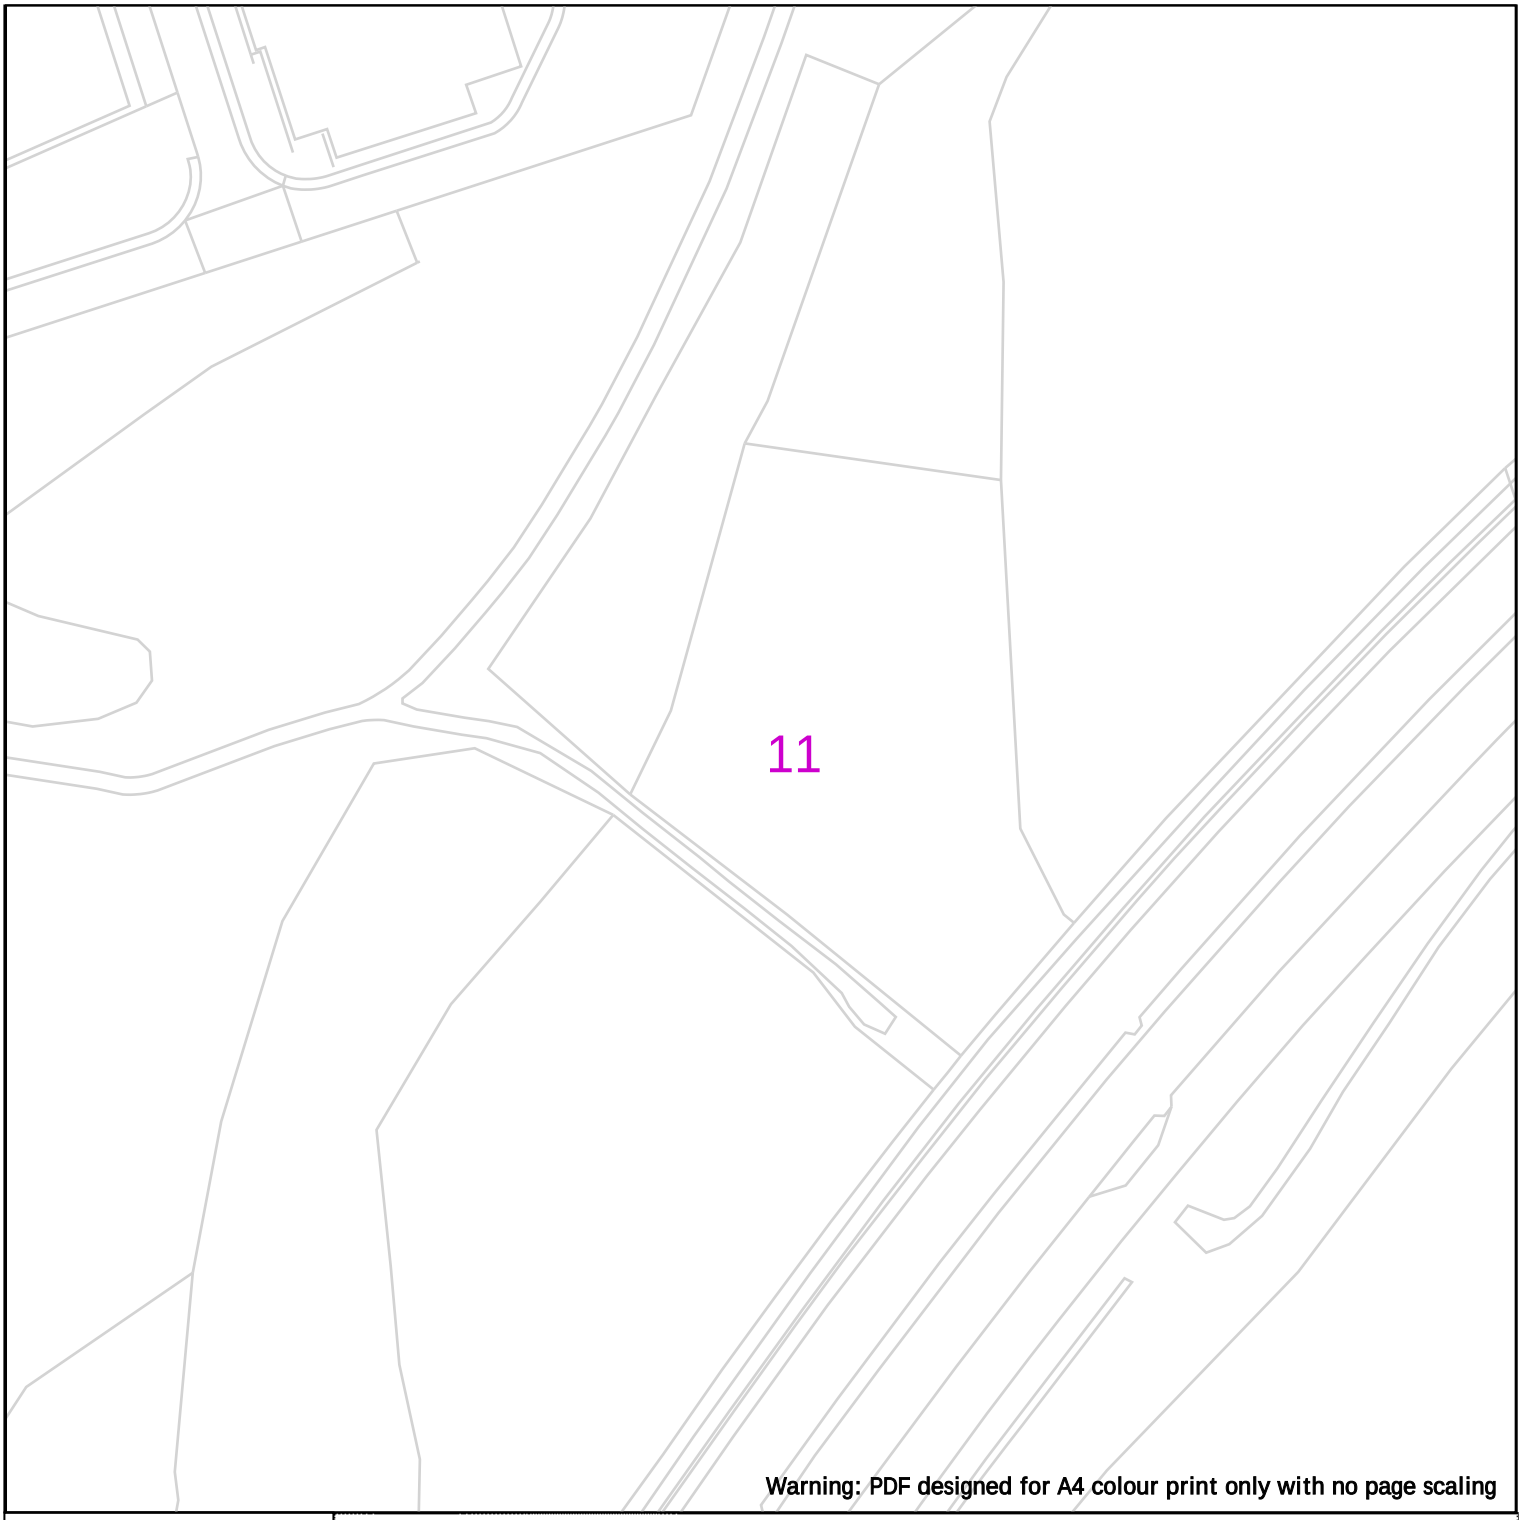

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

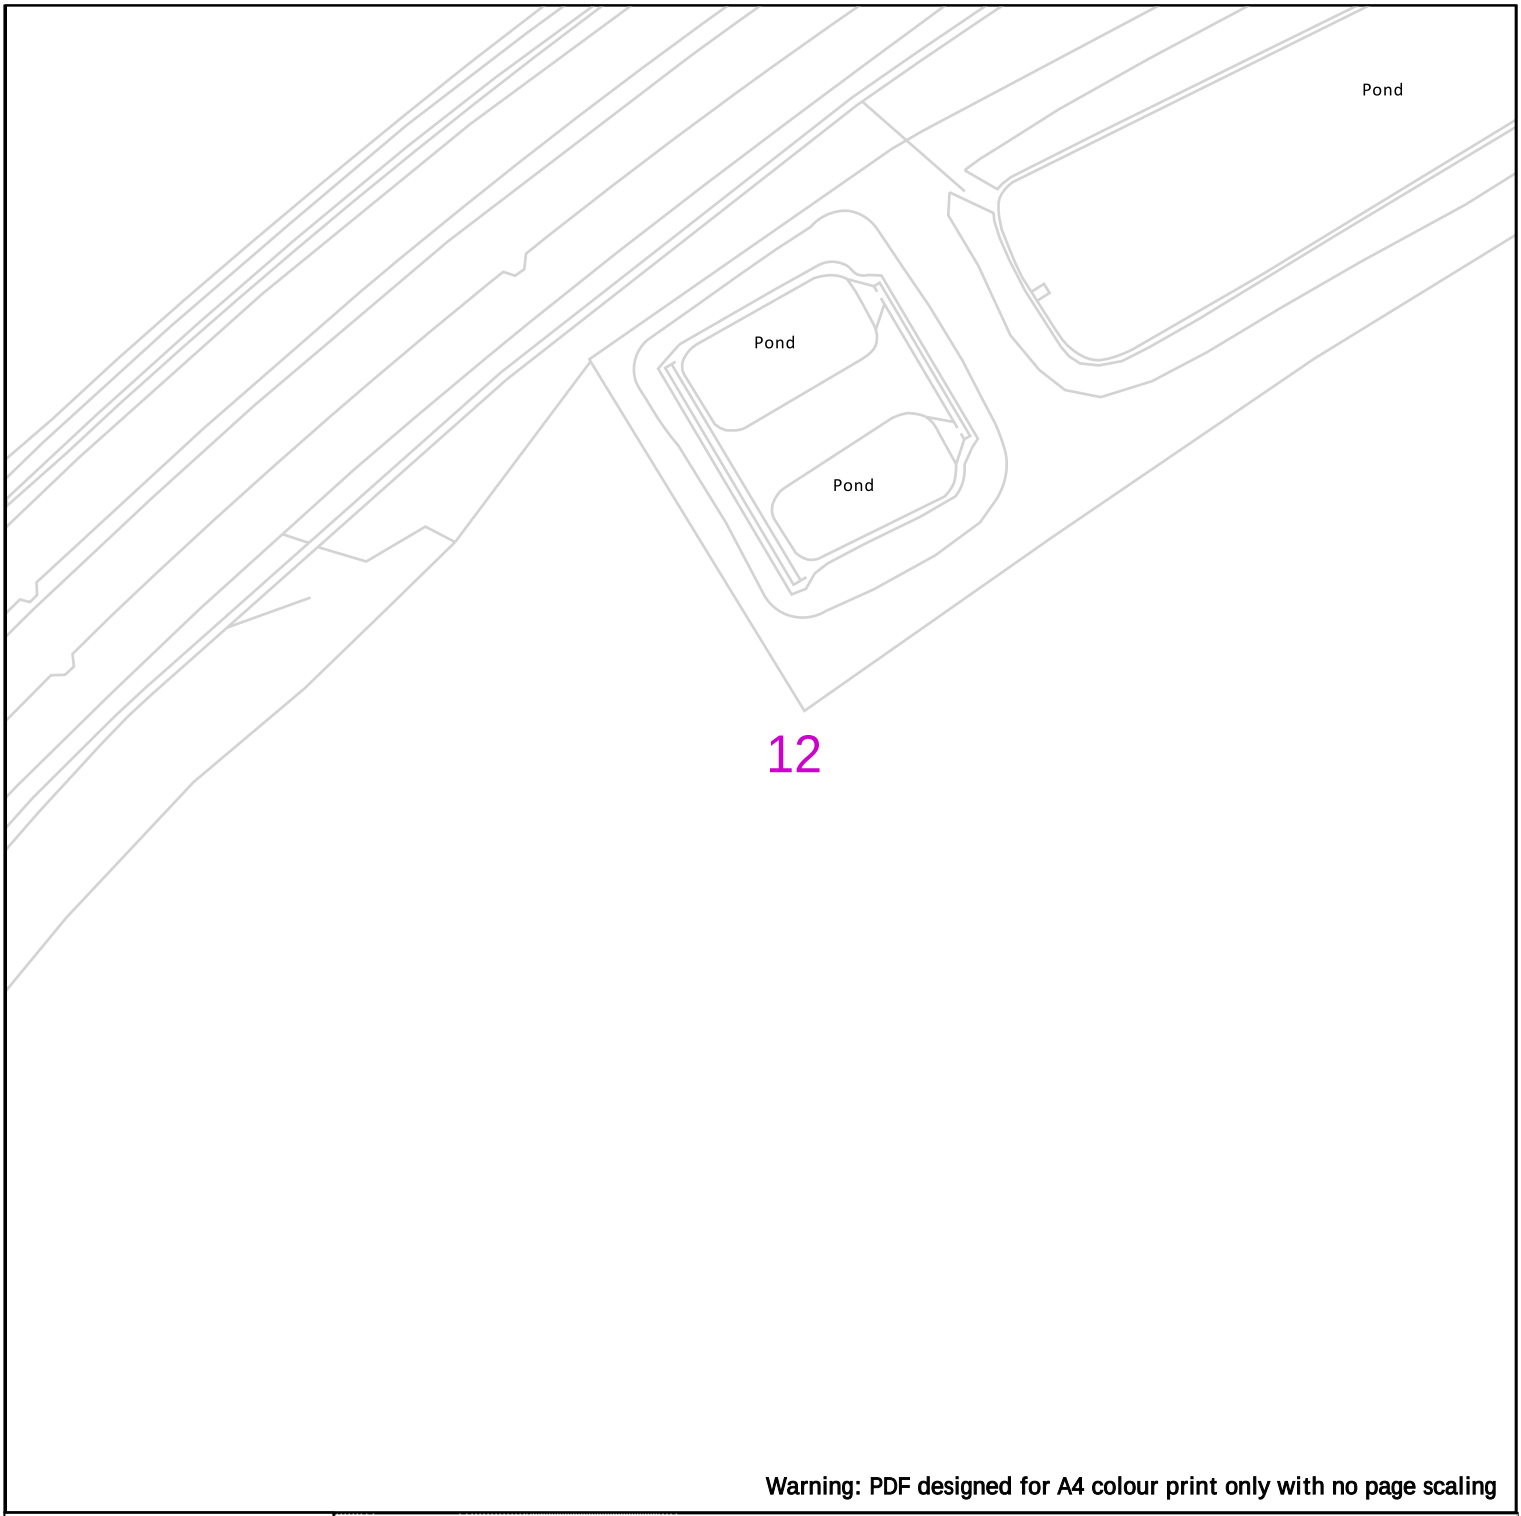

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar
- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

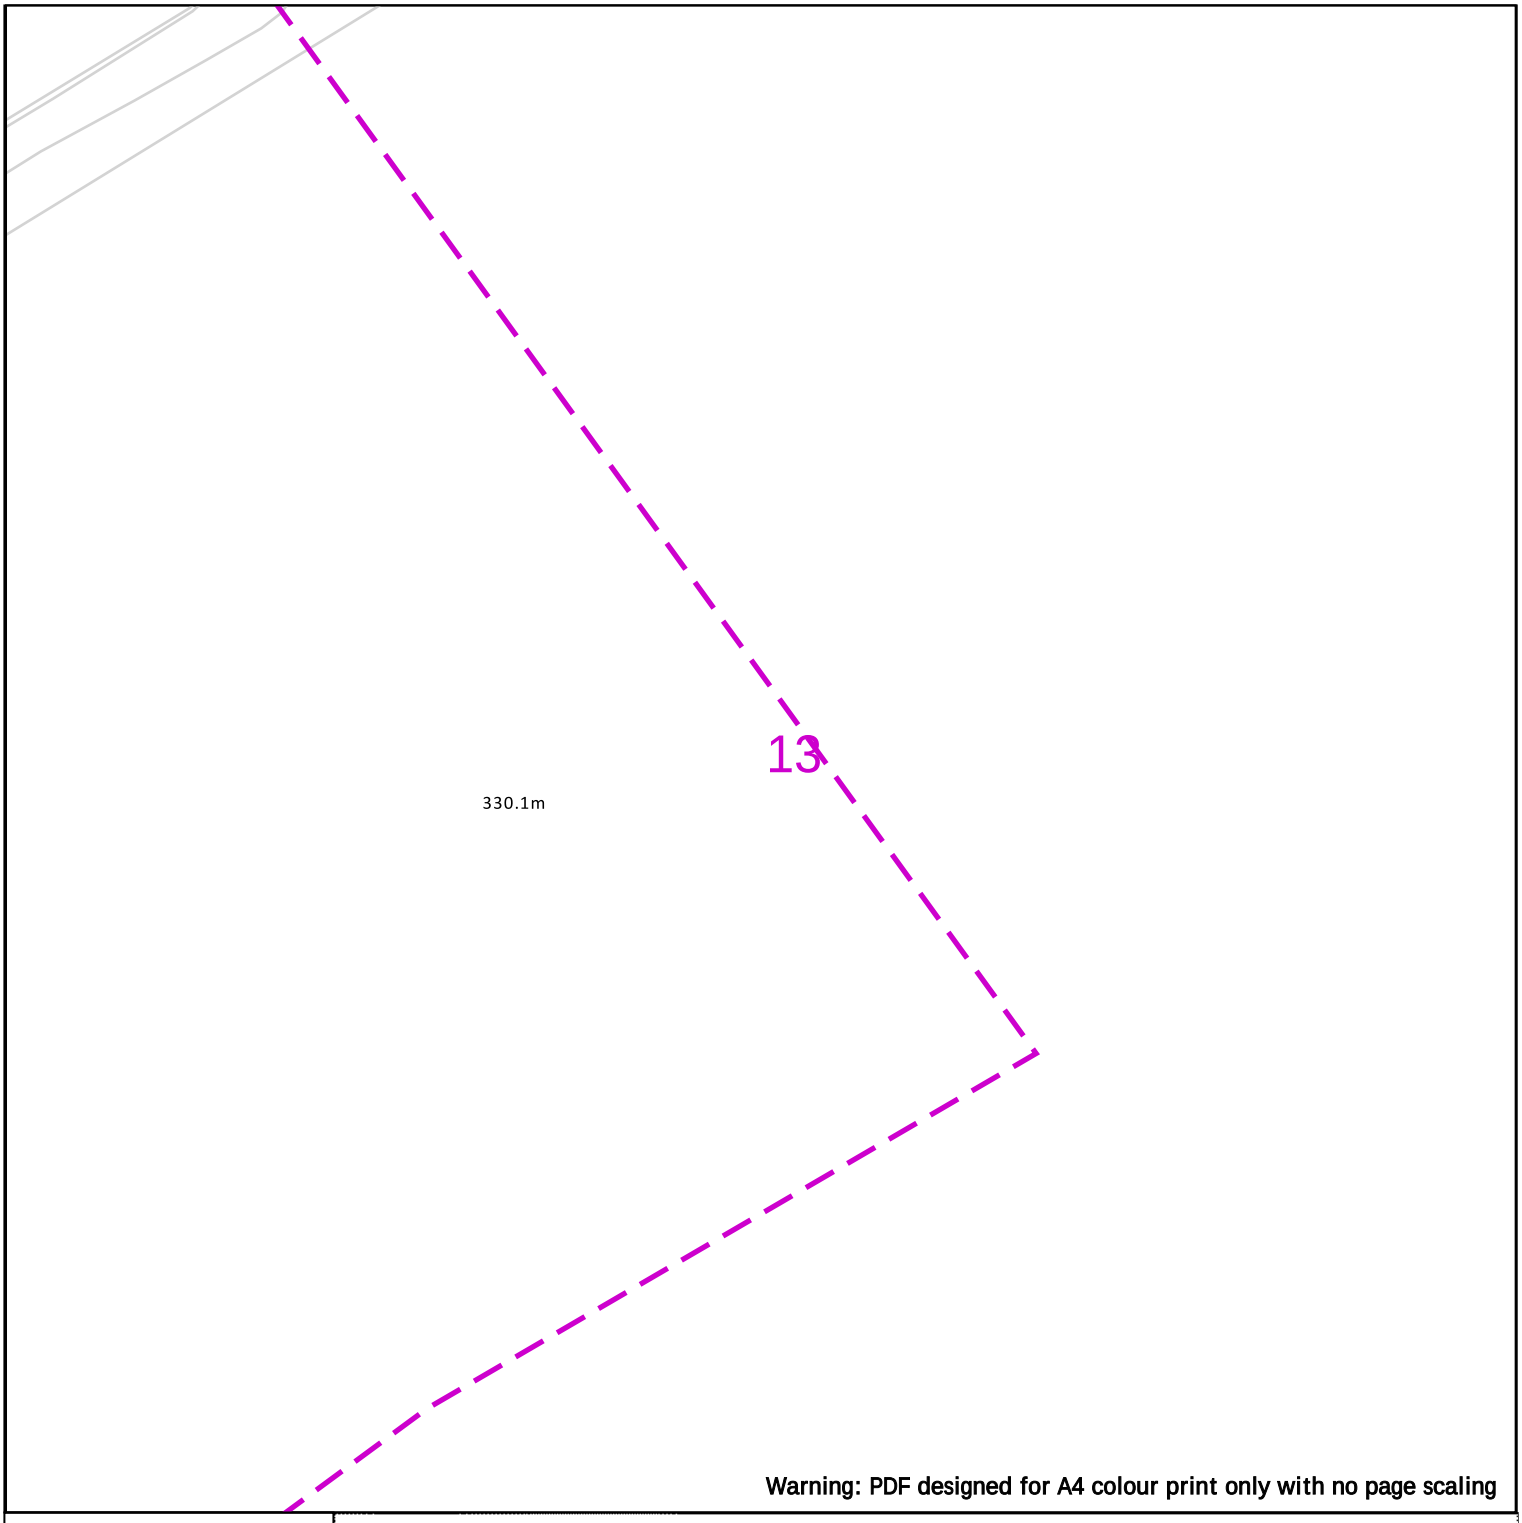

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial before you dig
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

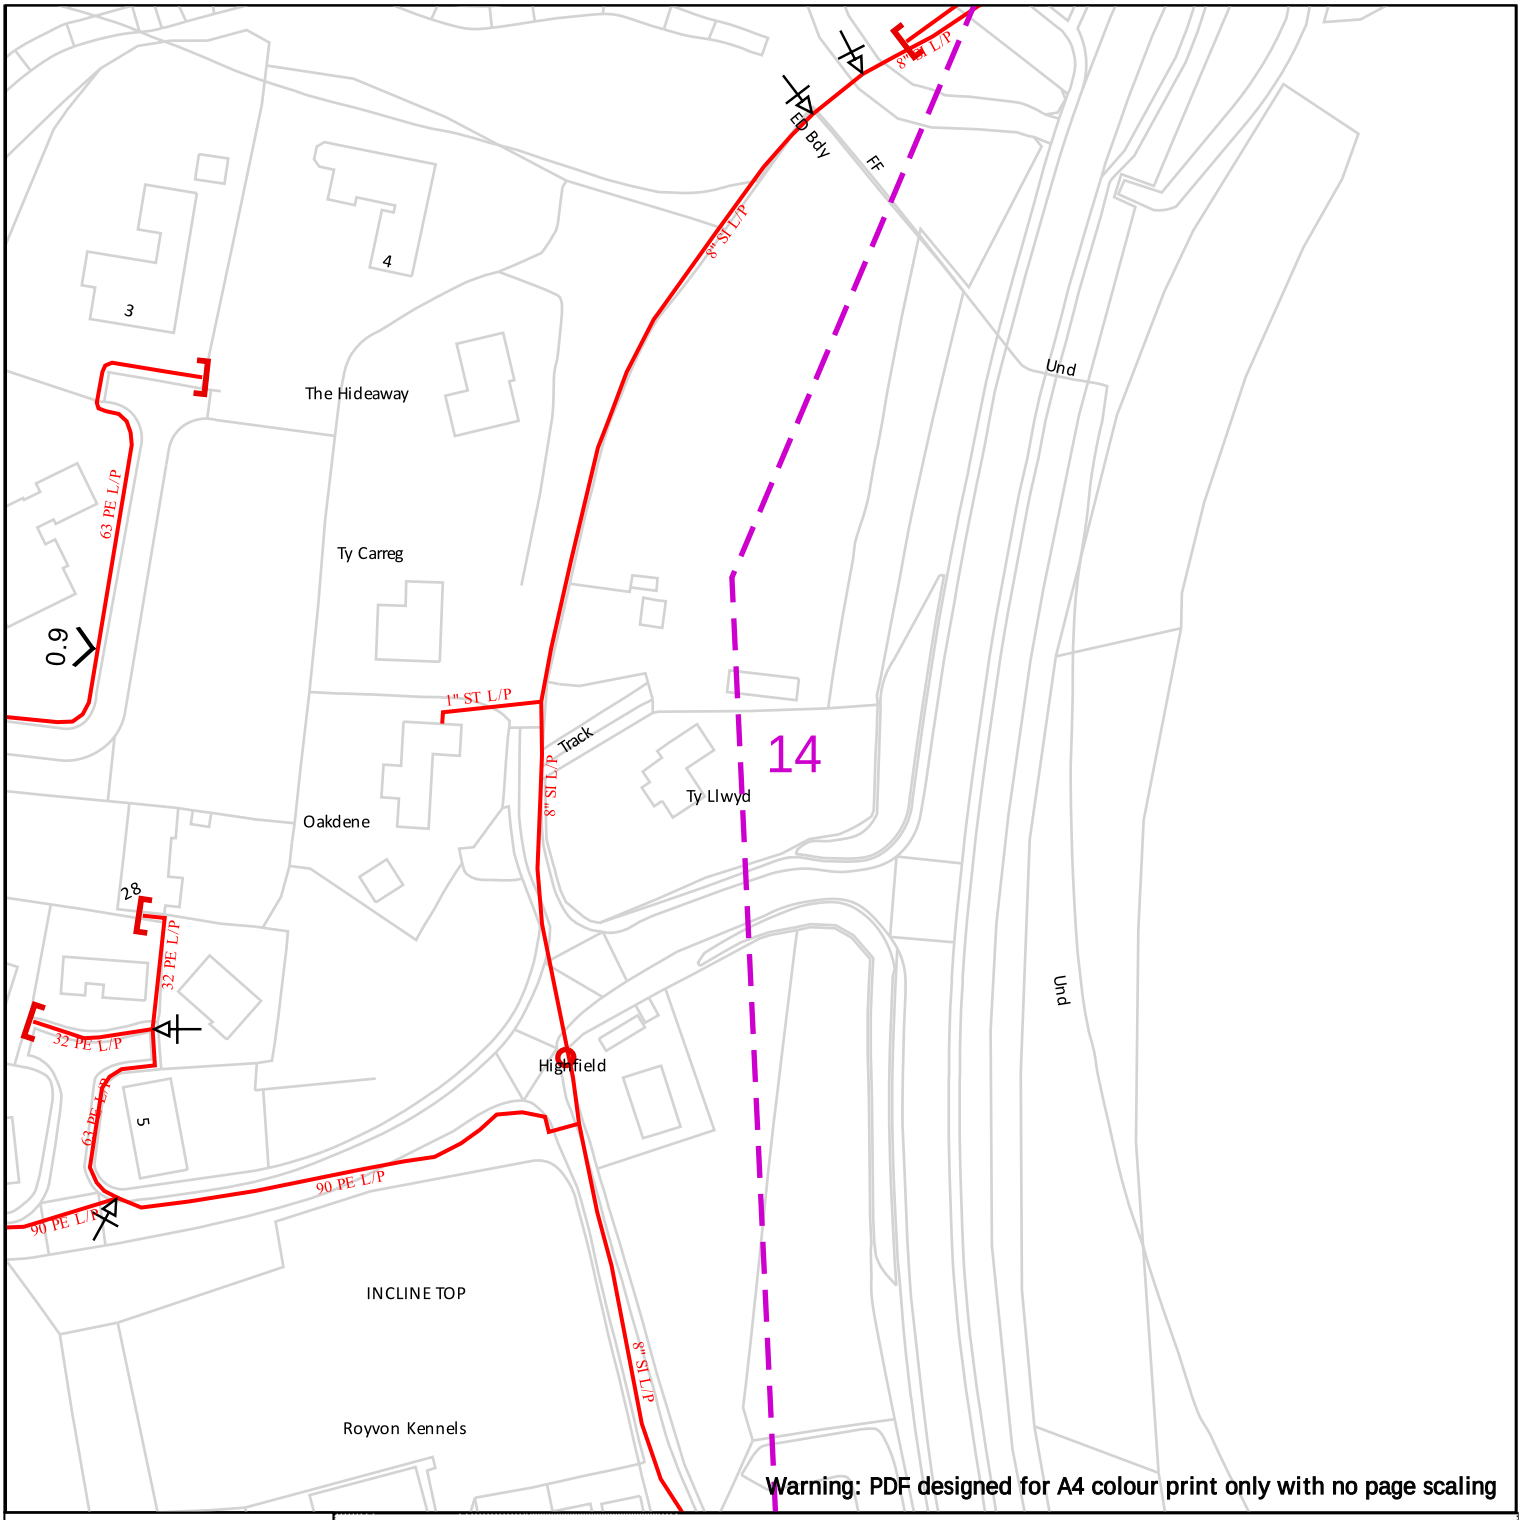

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

Change of Diameter
End Cap
Depth of cover
Line/Fire Valve
Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Dial before you dig
Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

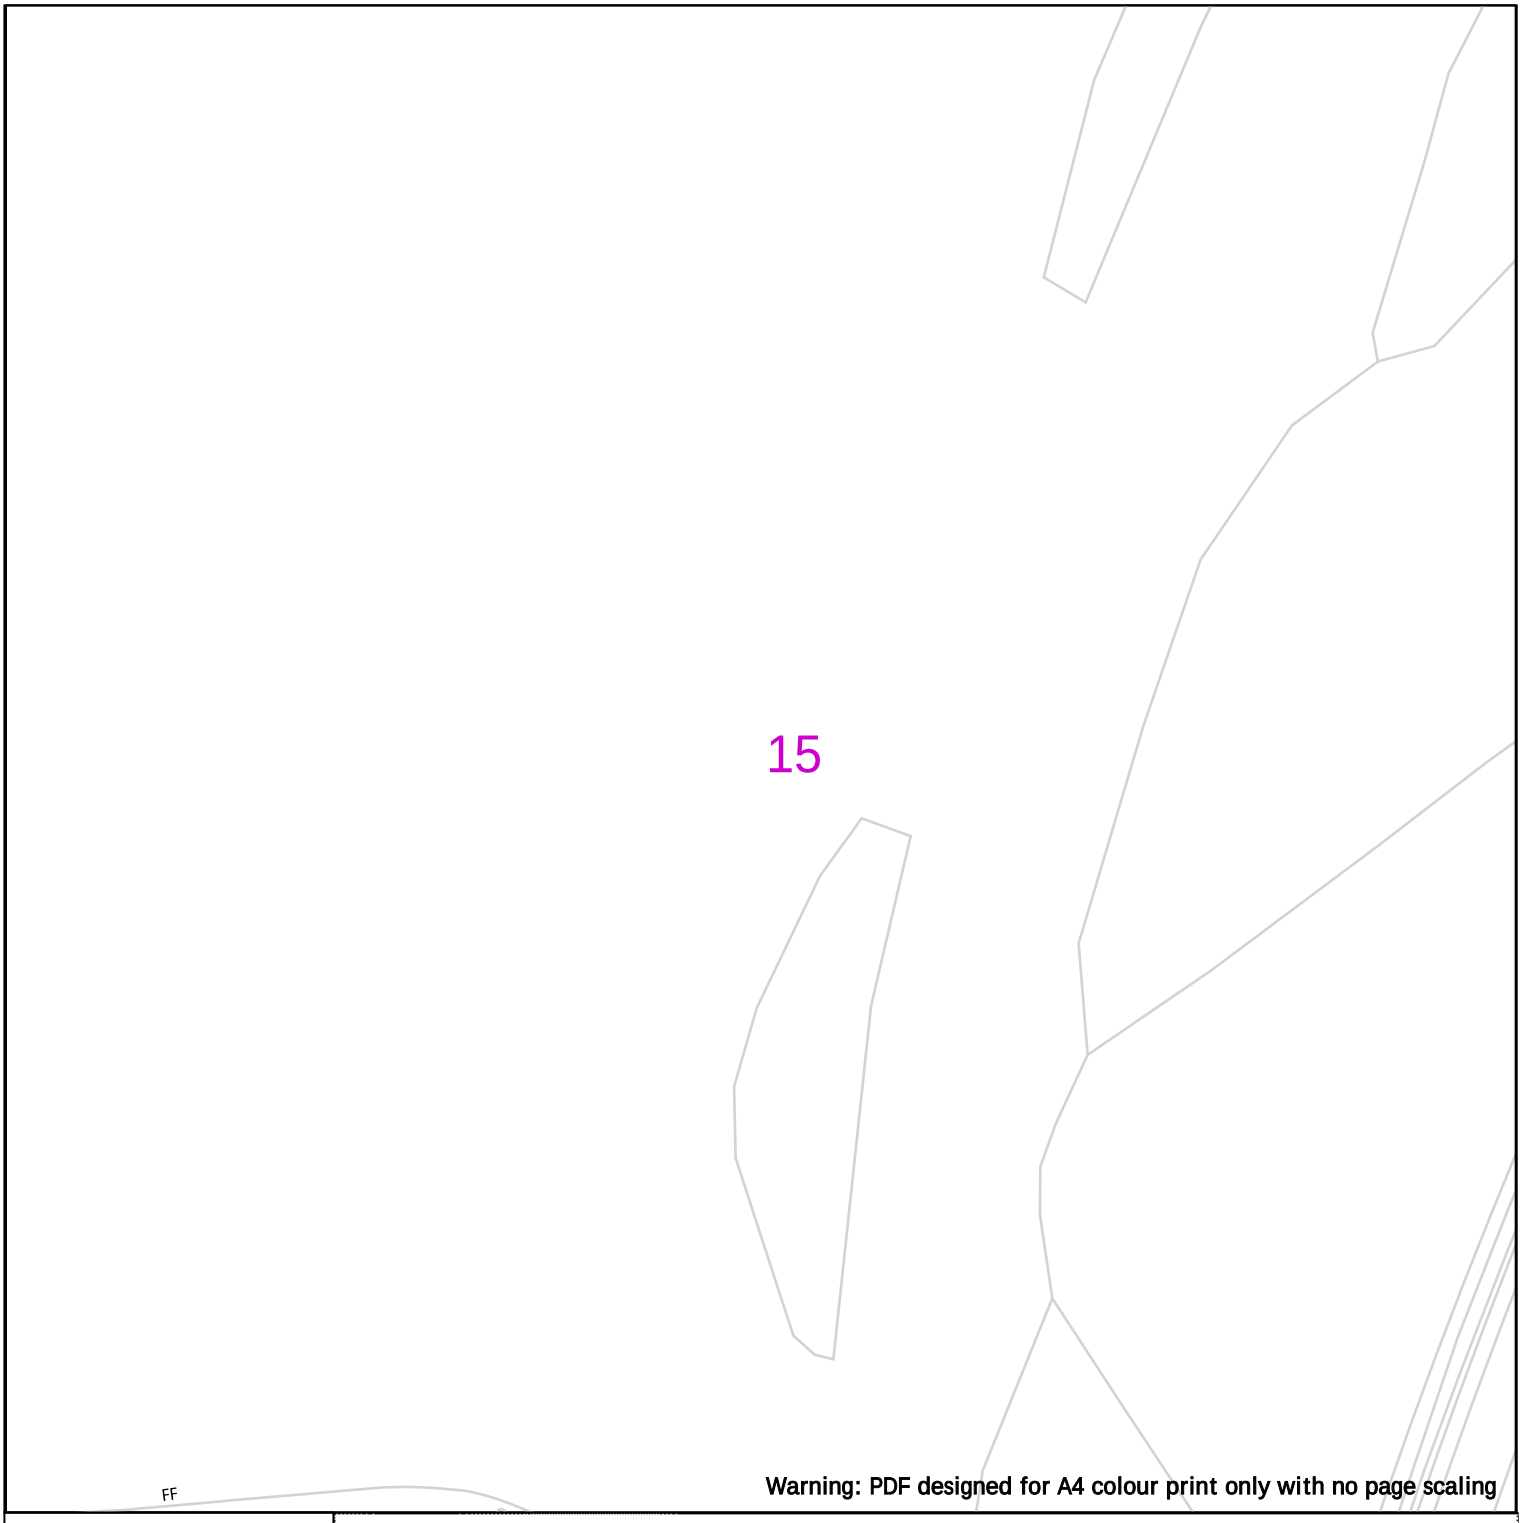

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar
- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

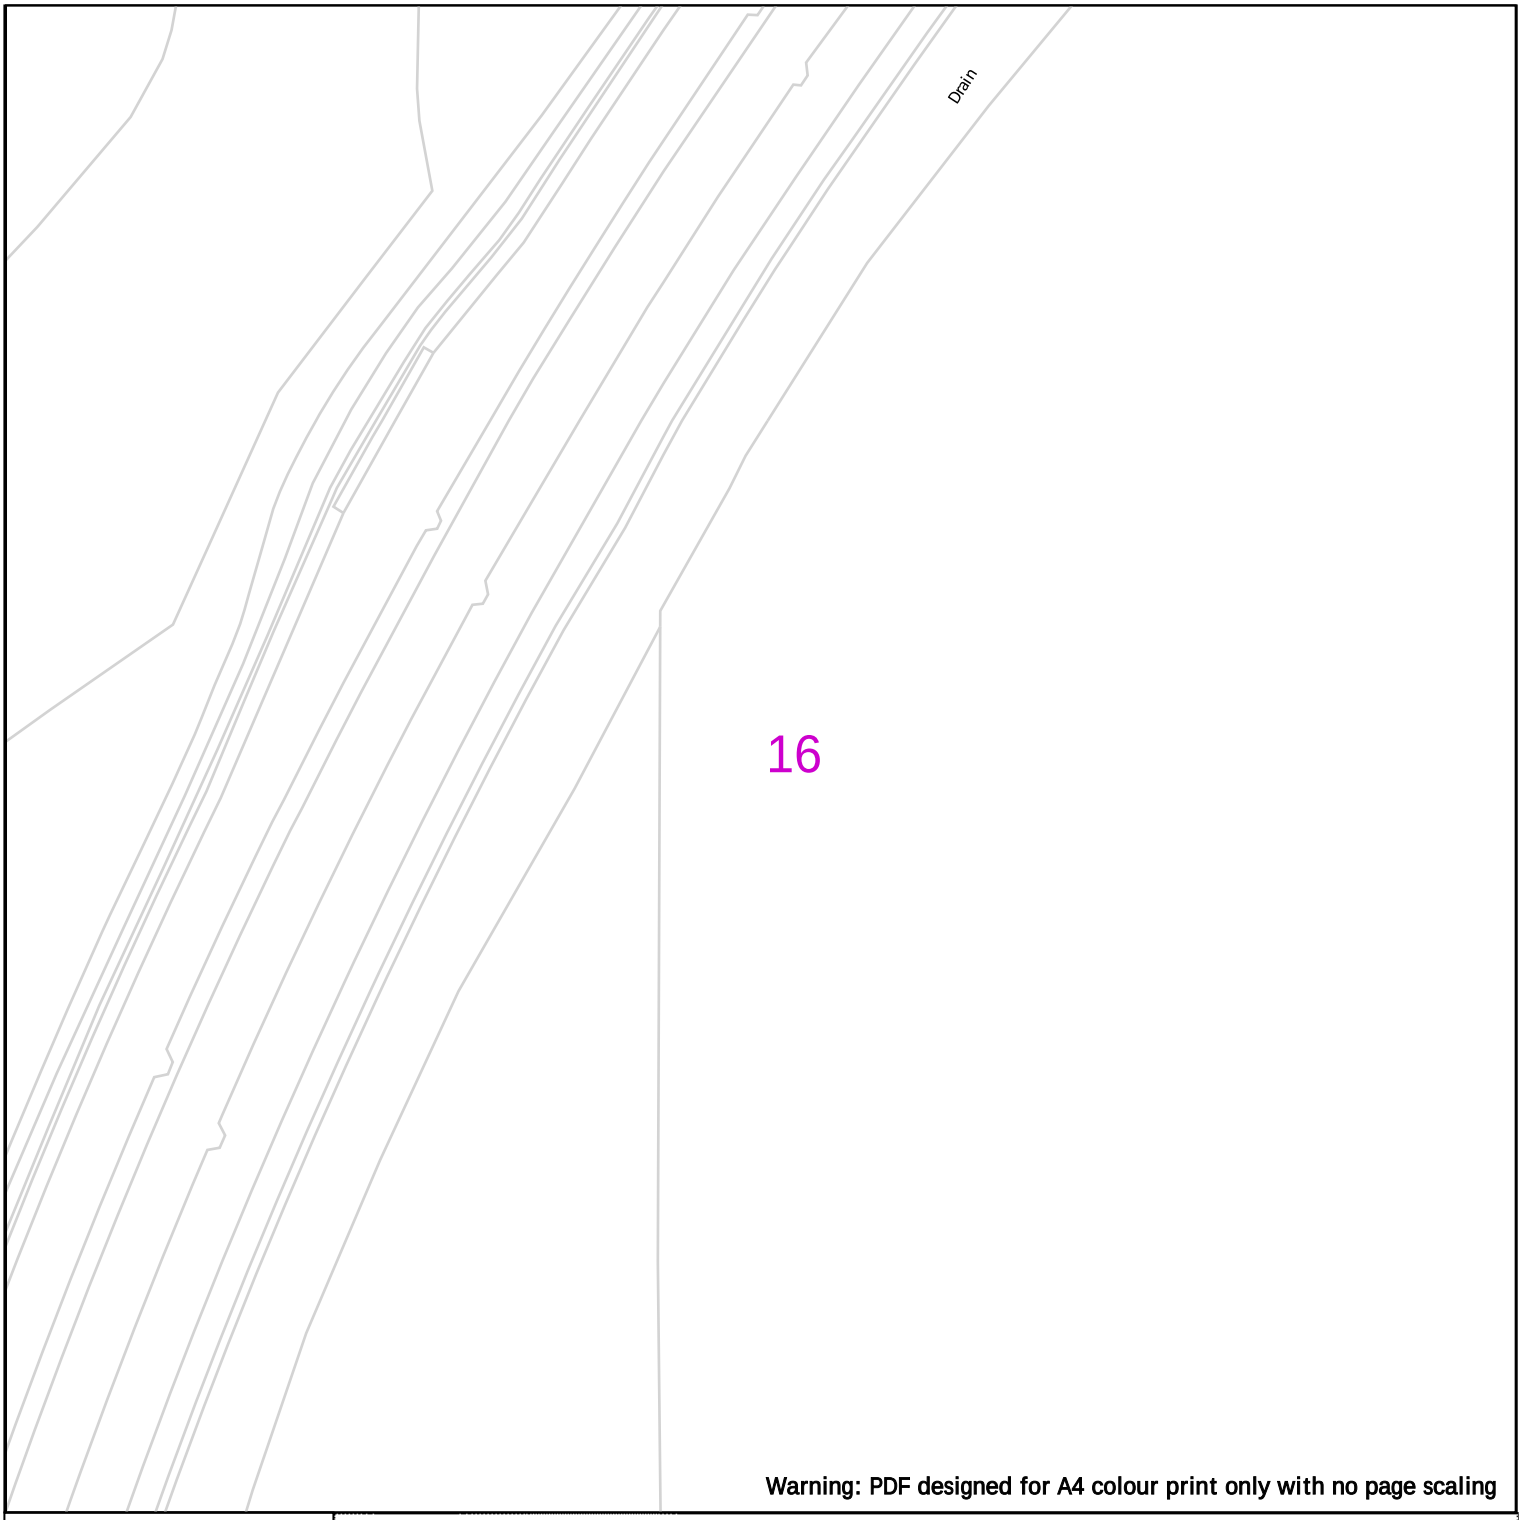

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

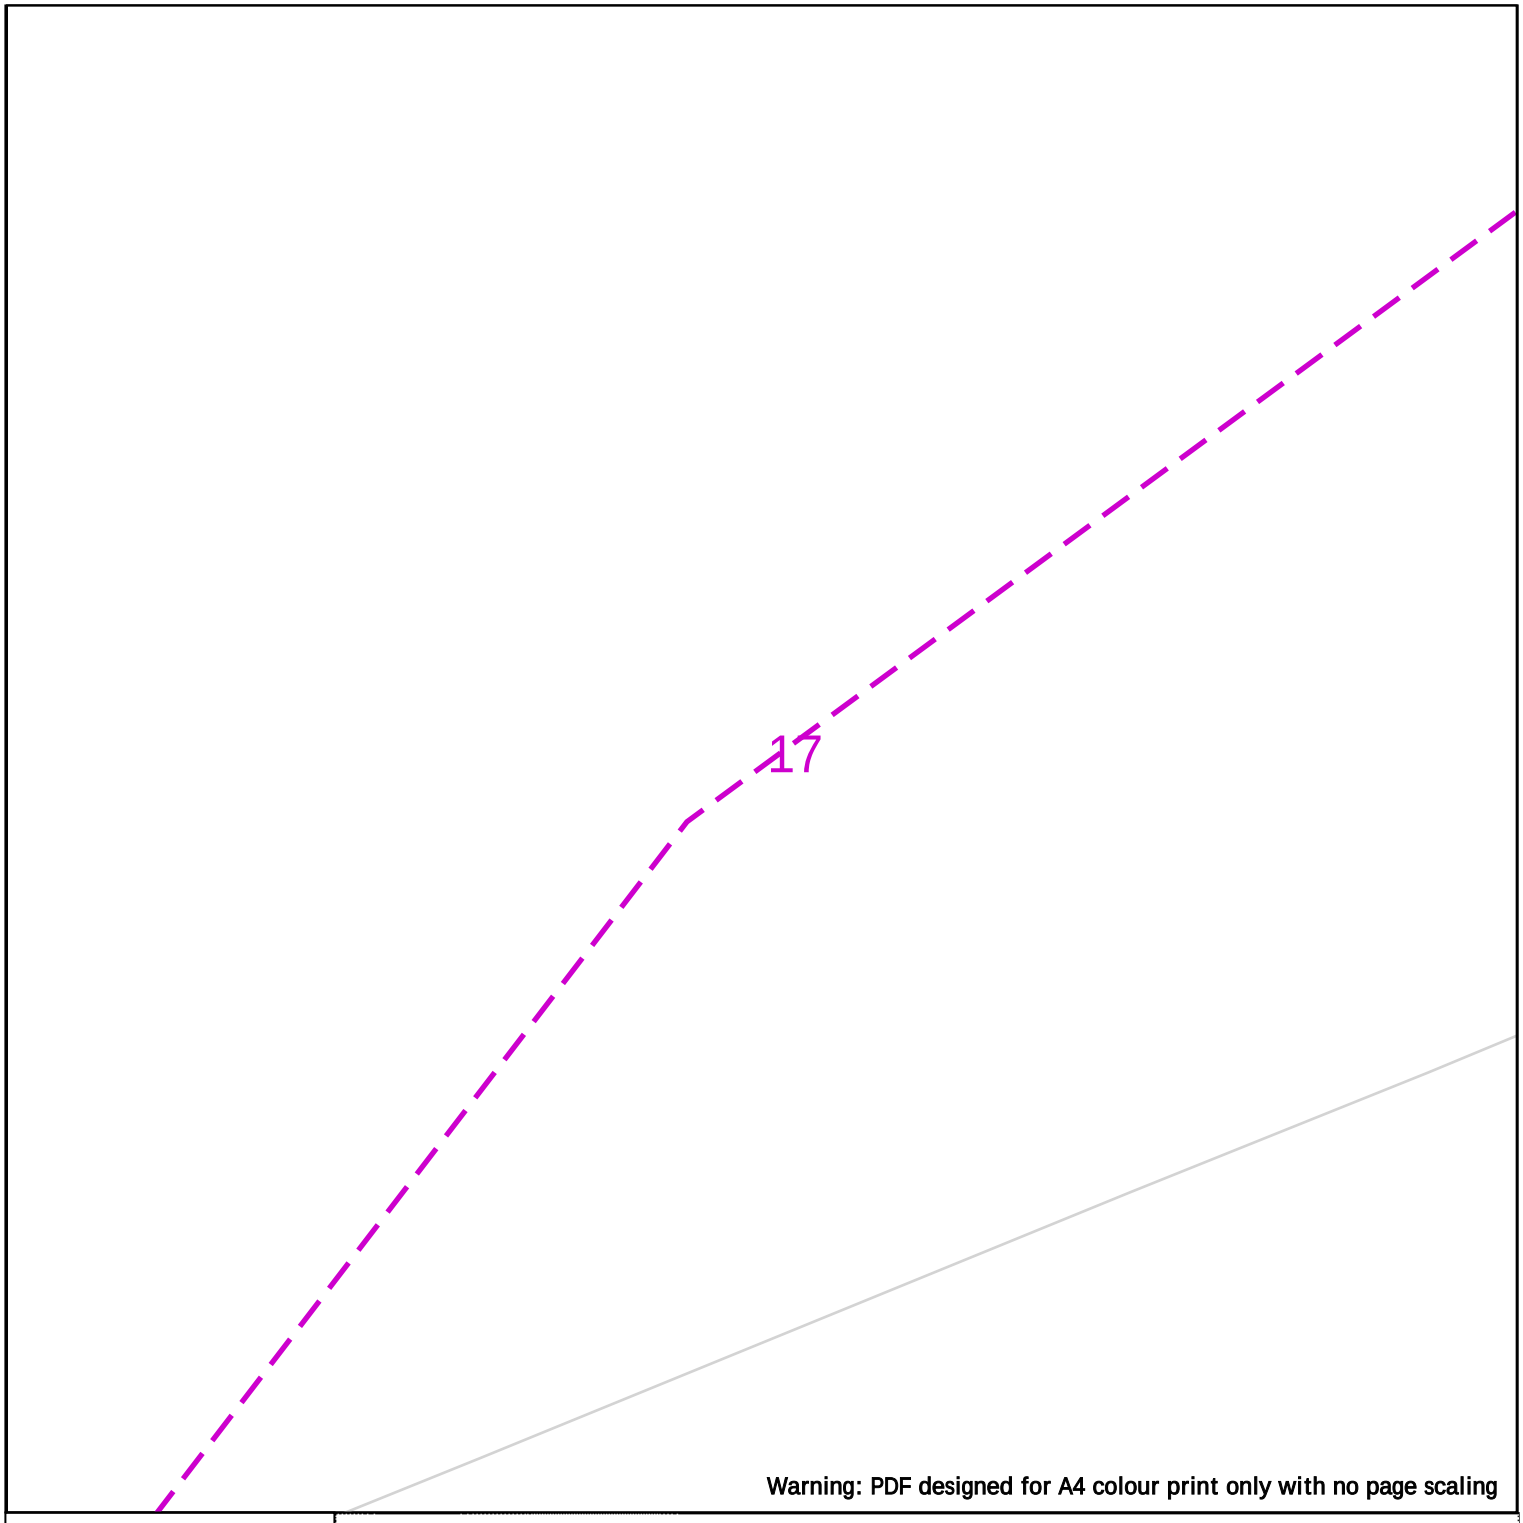

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Dial before you dig
Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

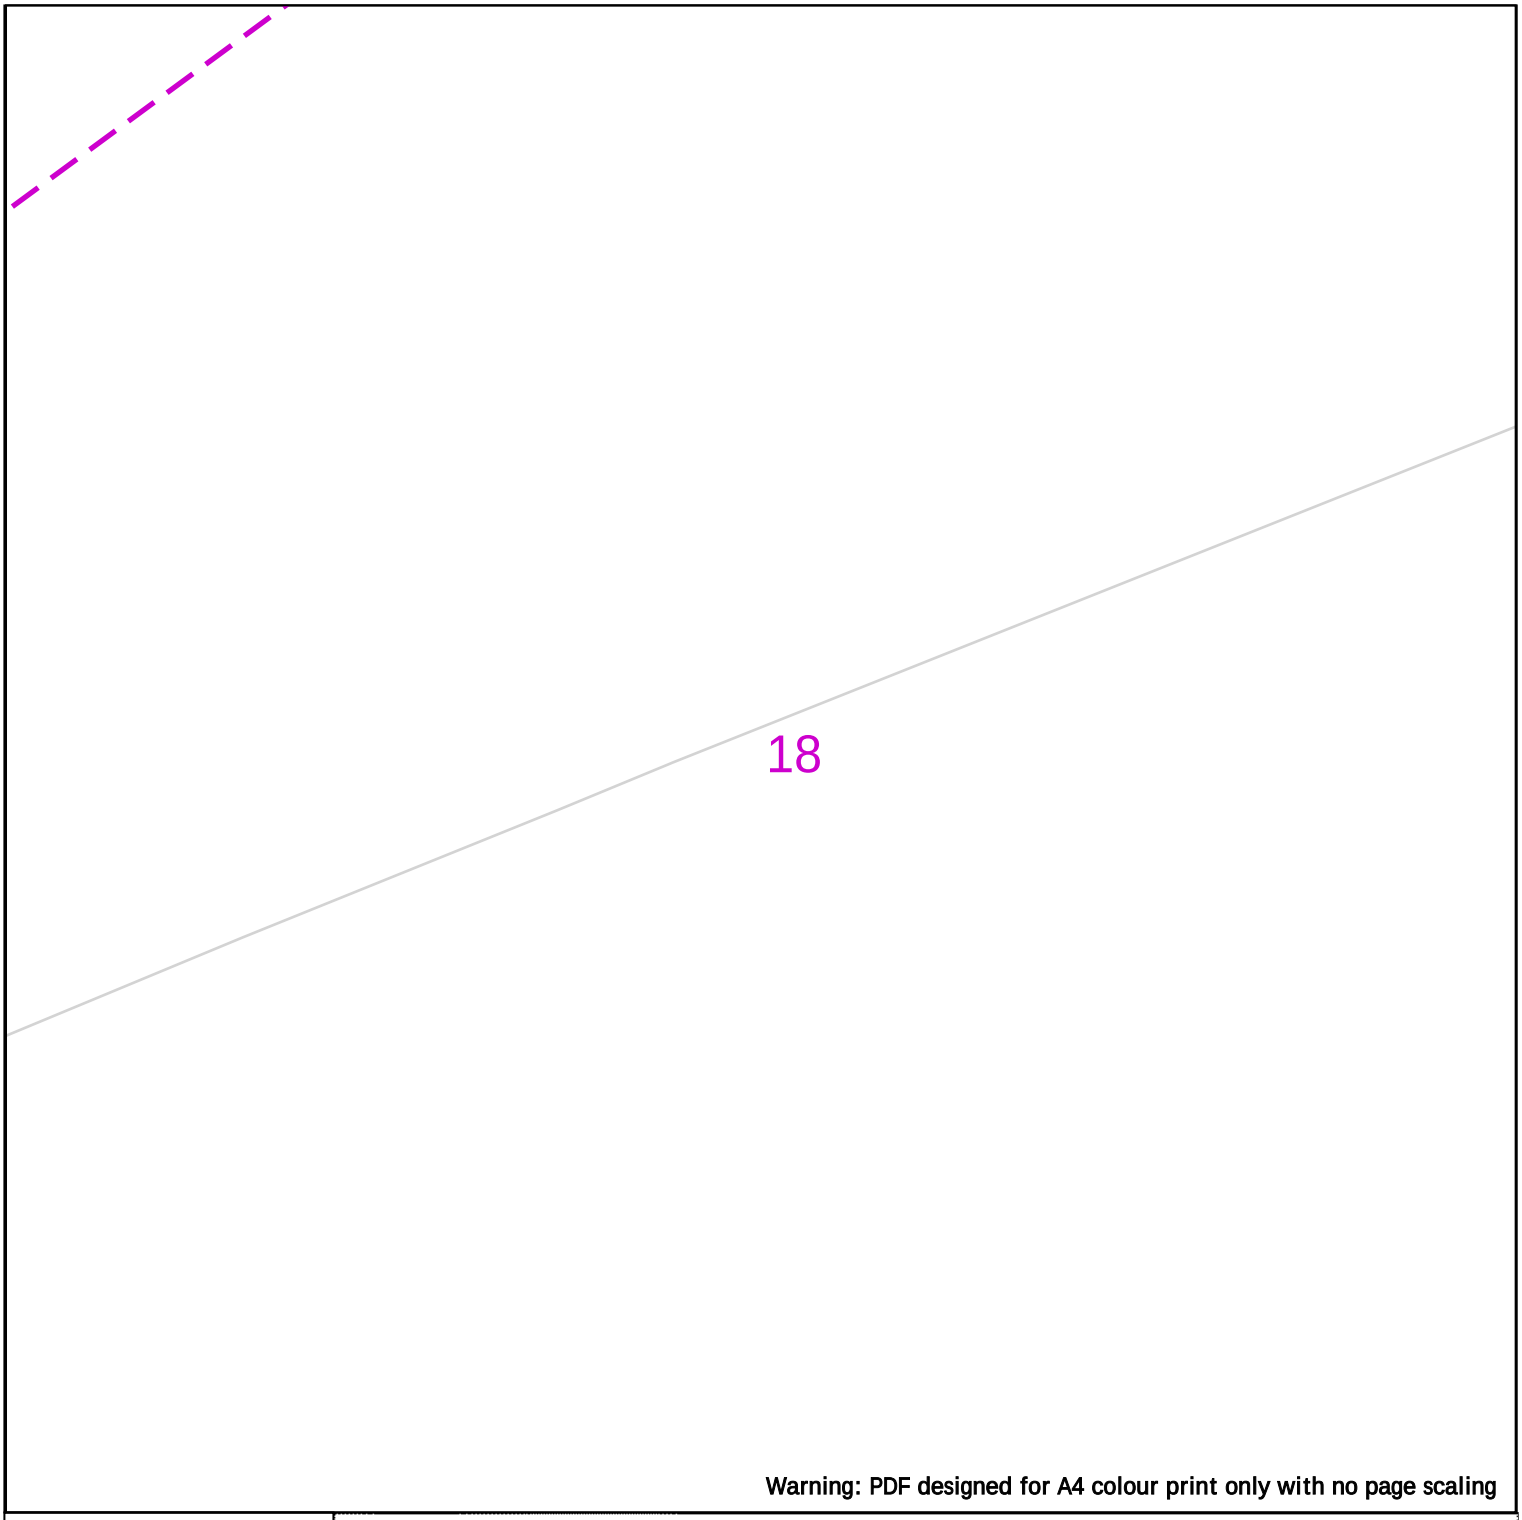

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

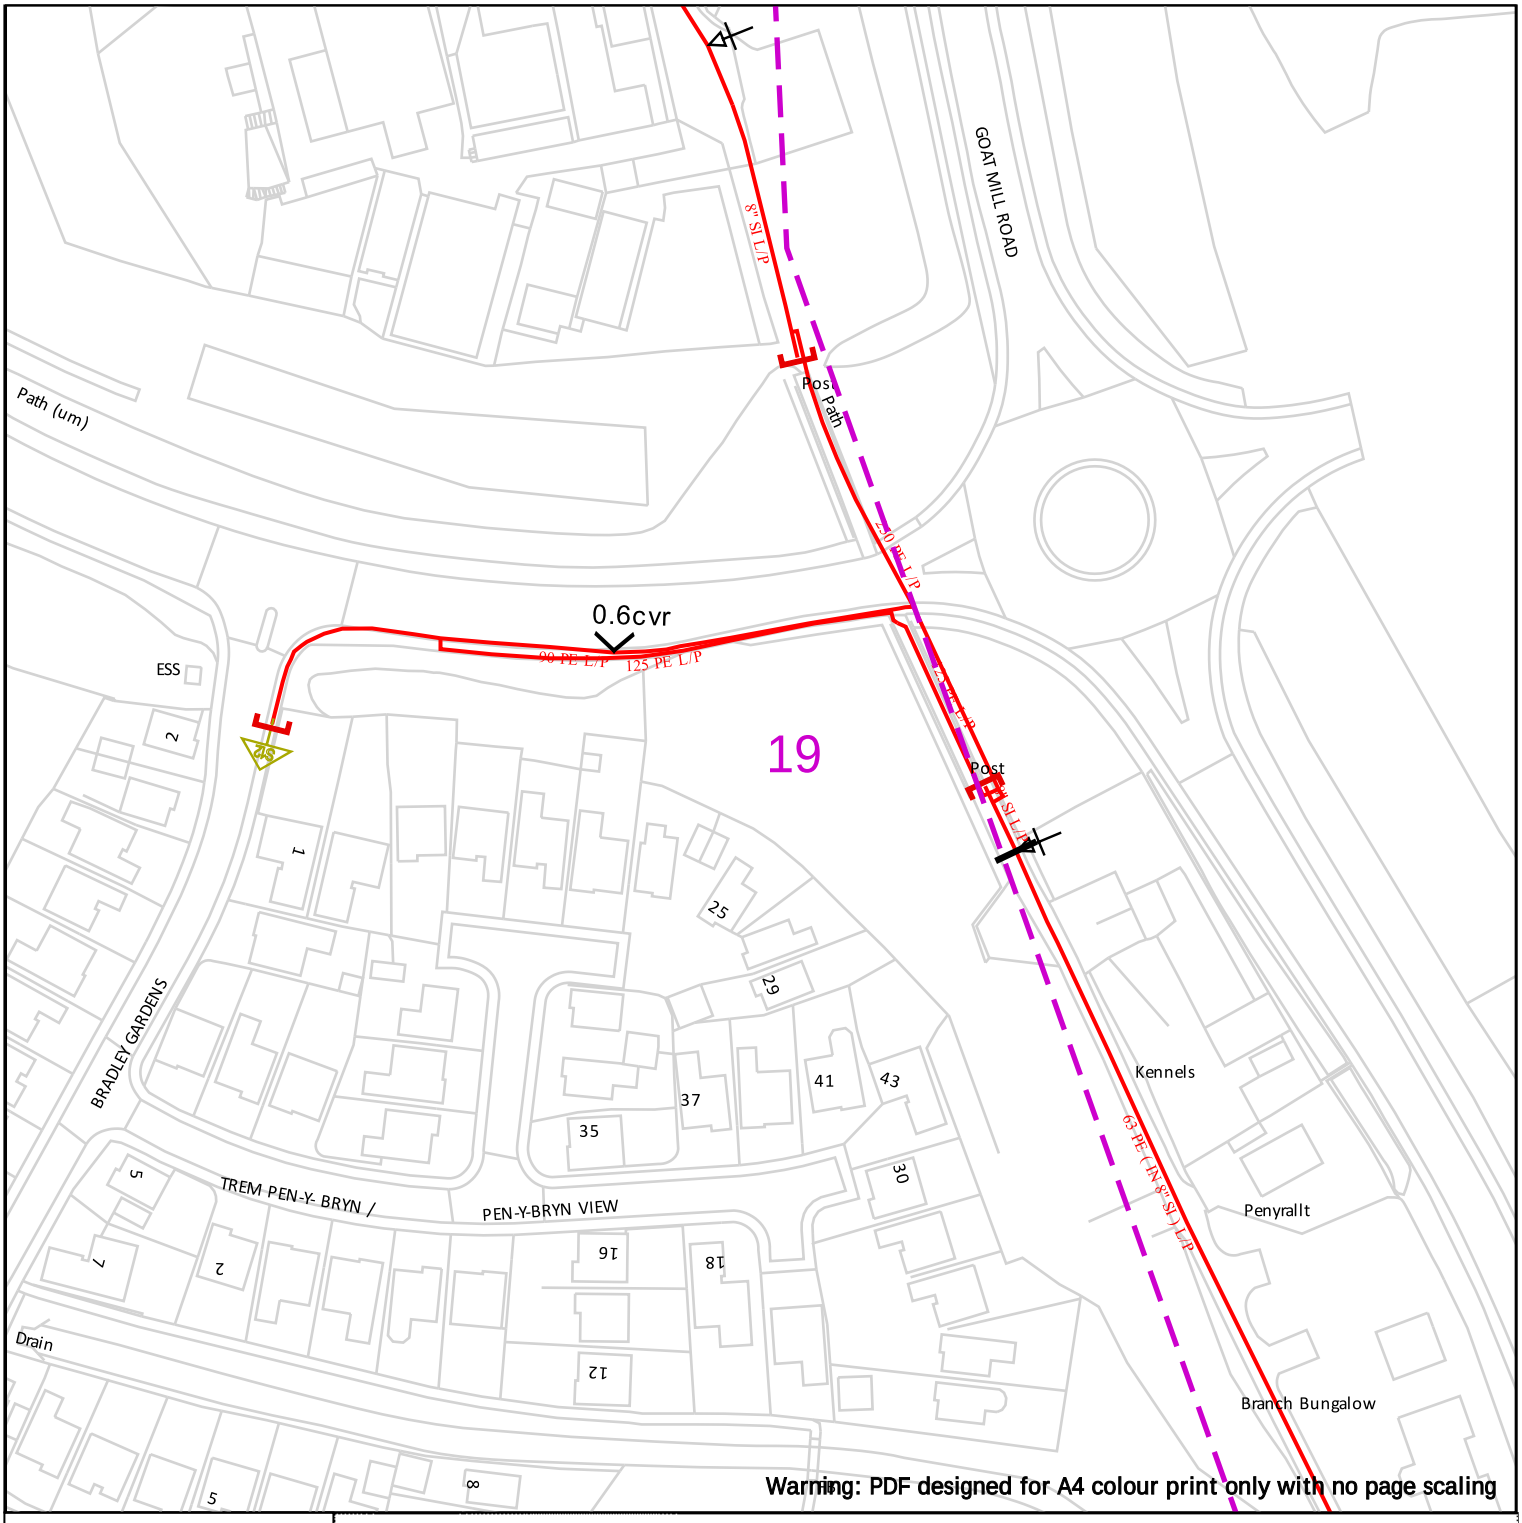

WALES&WEST UTILITIES

100m

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

Change of Diameter
End Cap
Depth of cover
Line/Fire Valve
Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Dial before you dig
Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

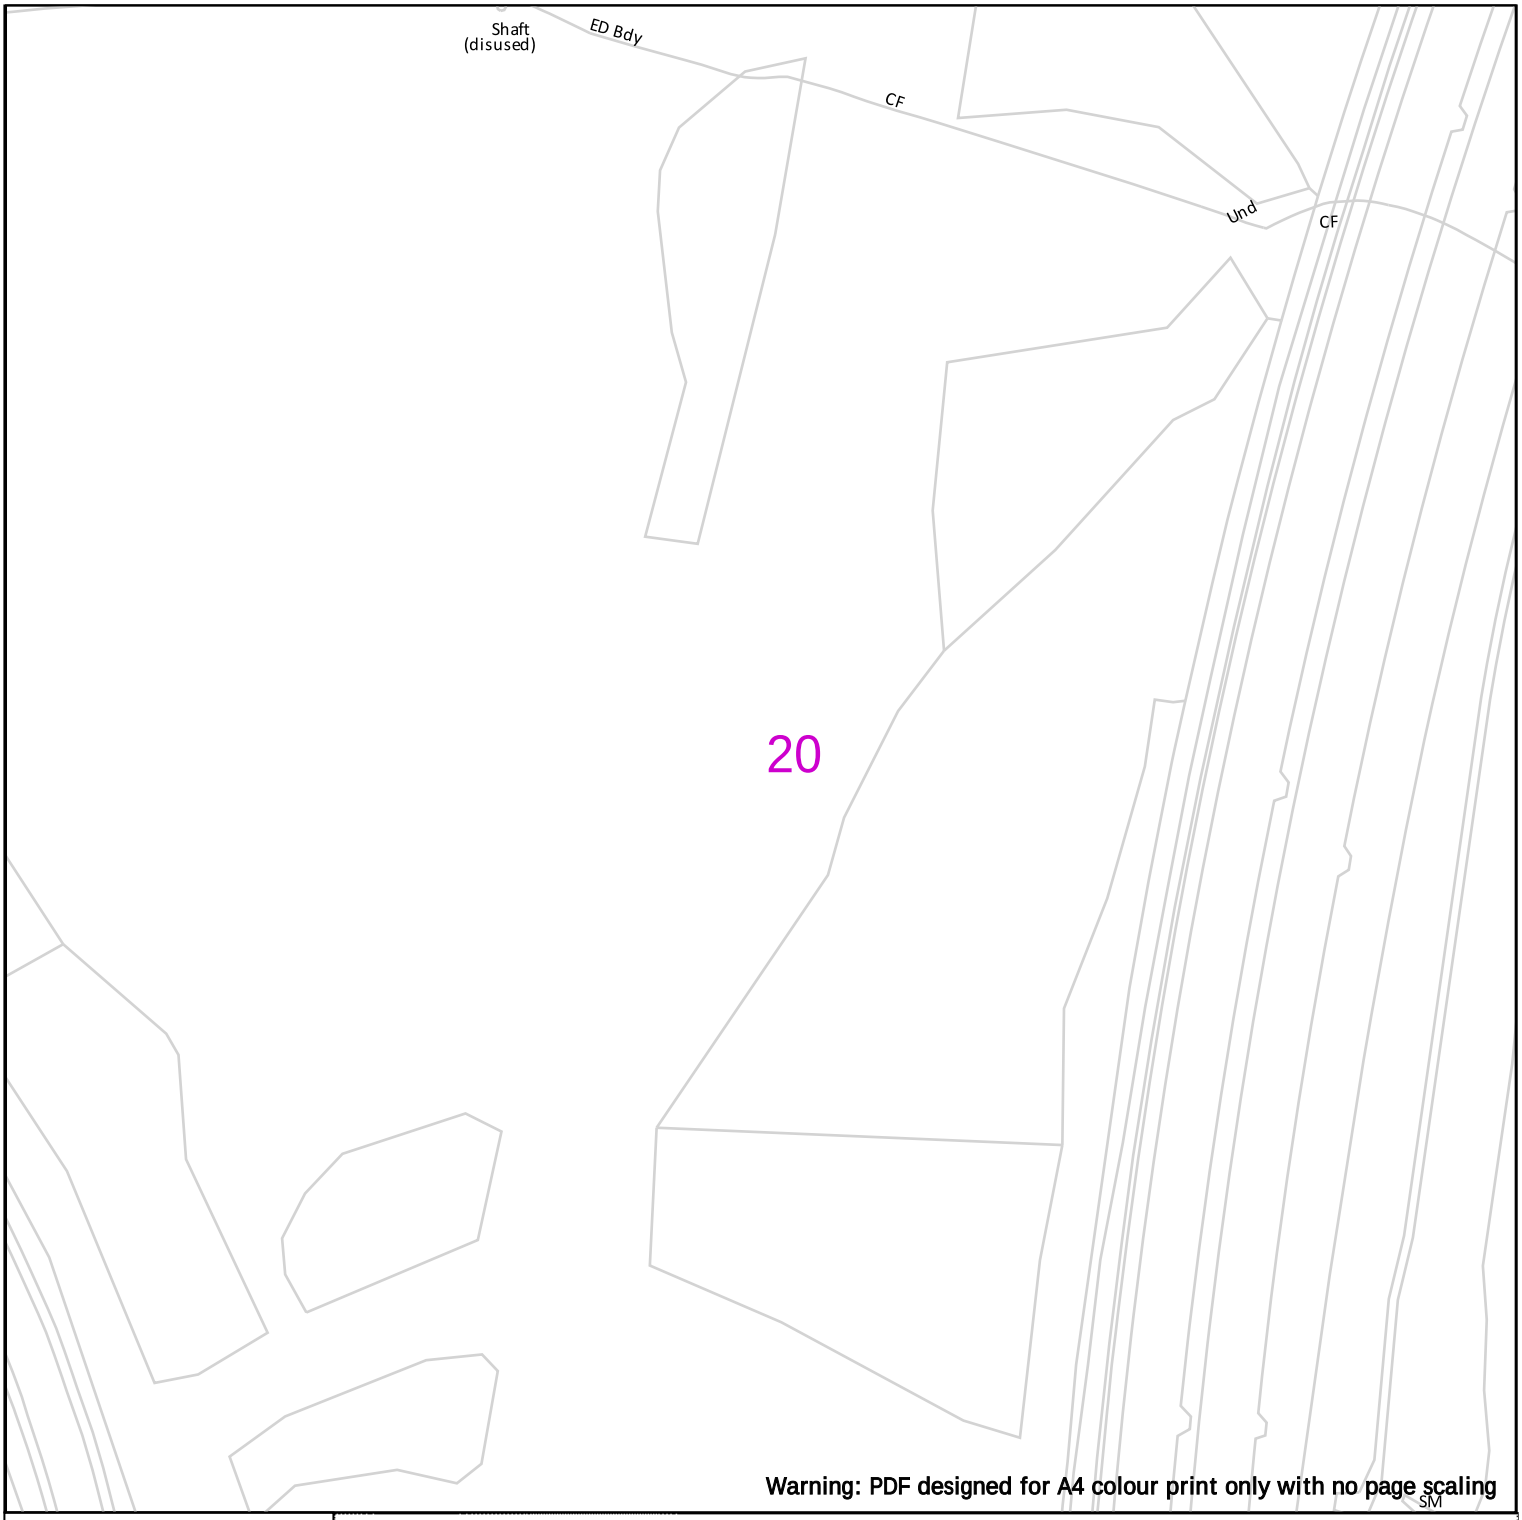

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

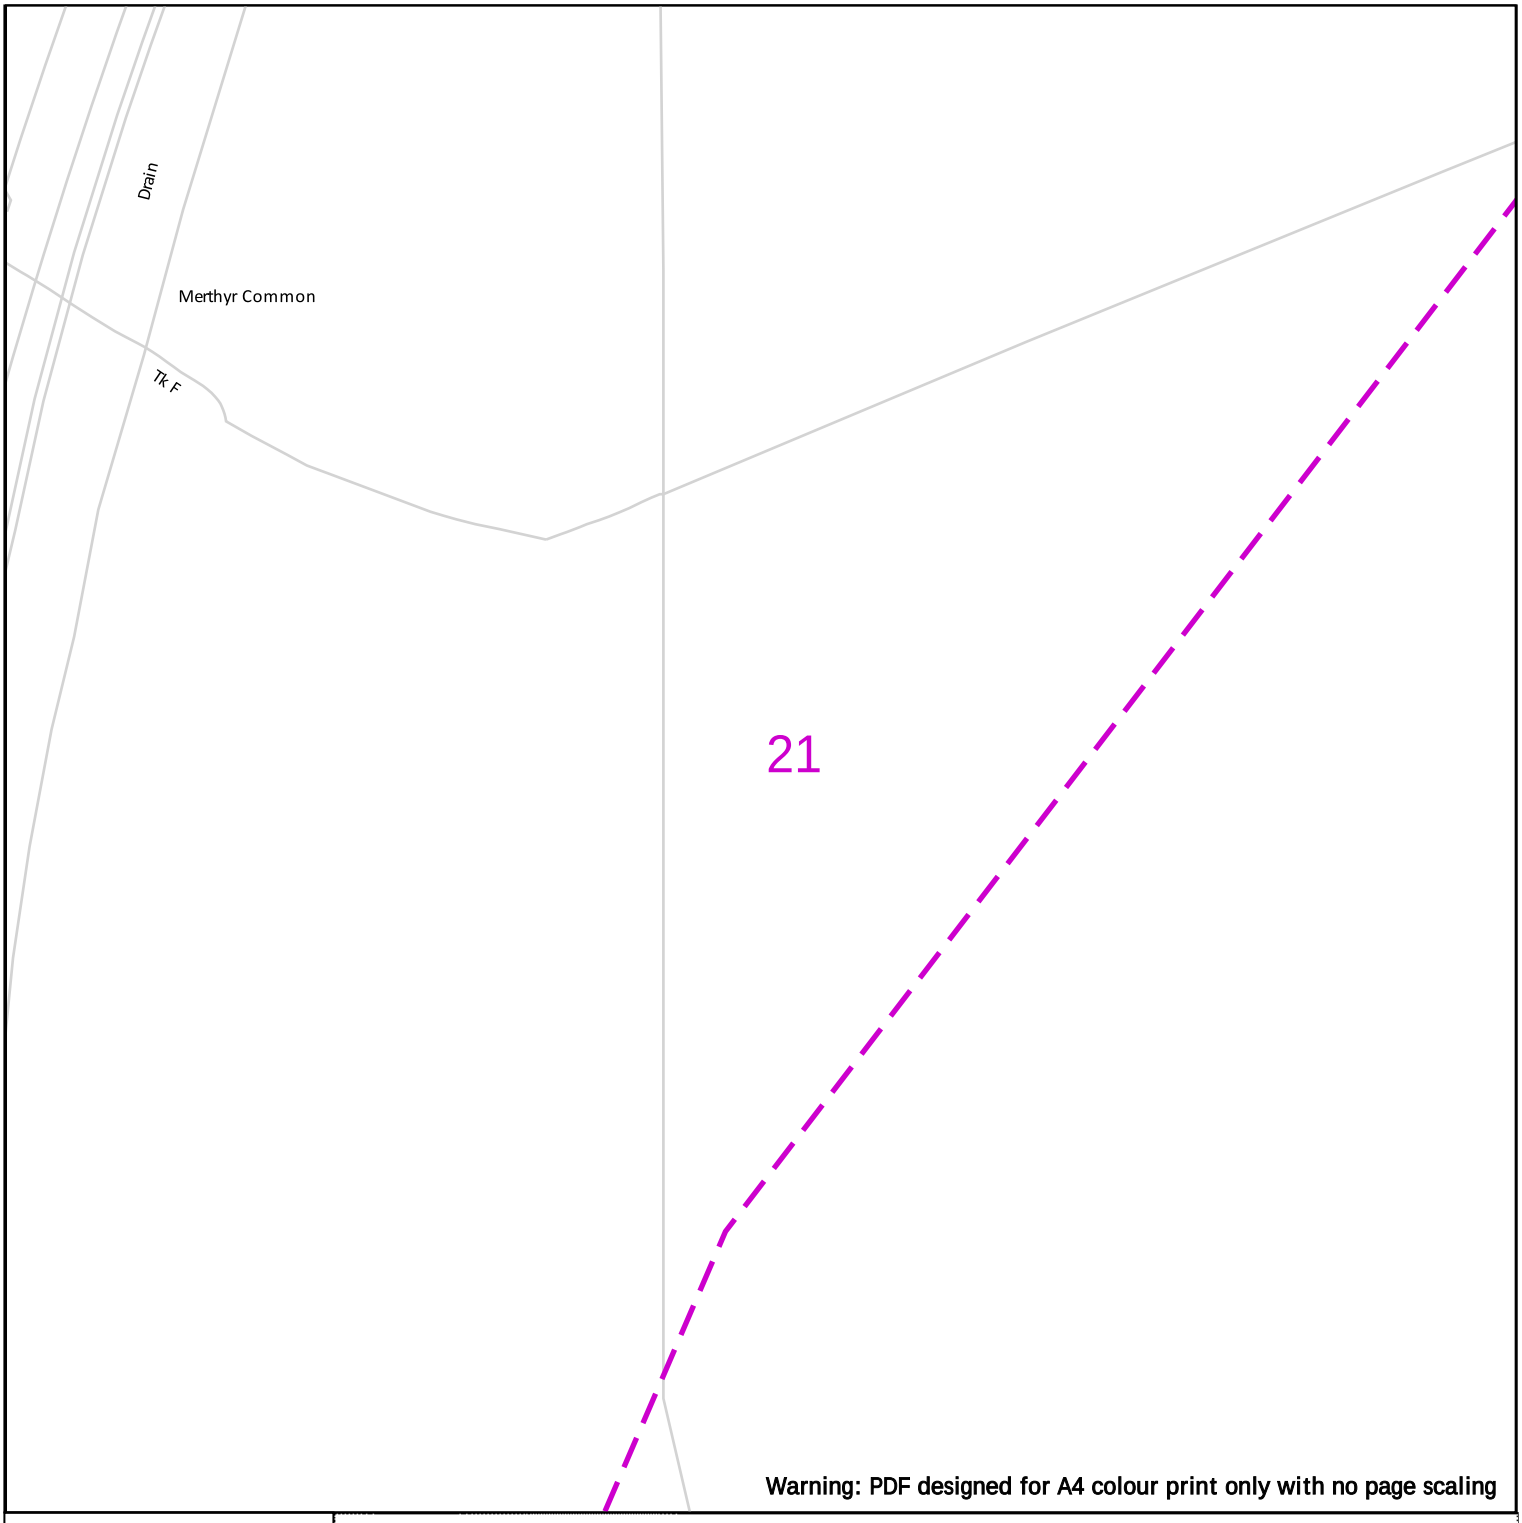

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

22

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

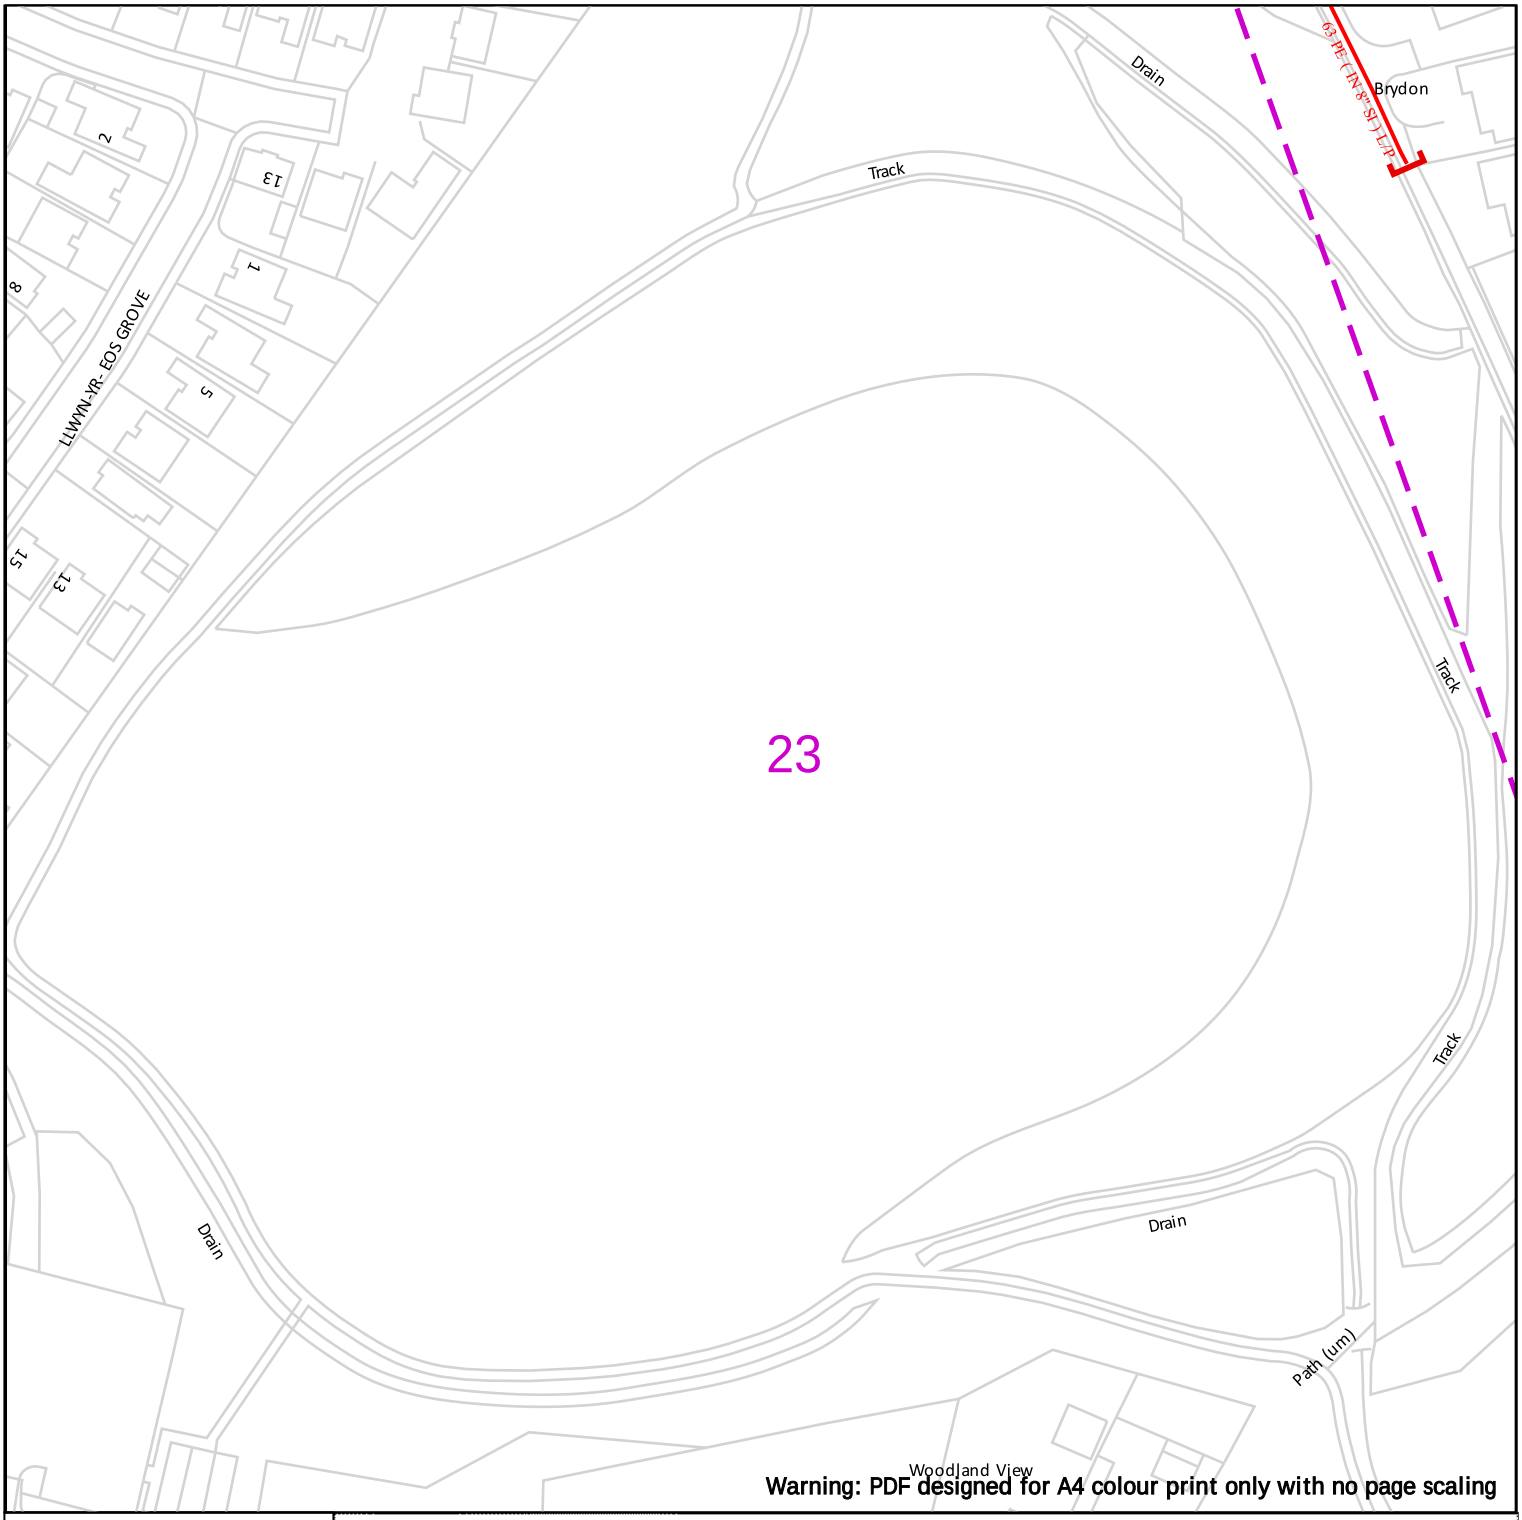

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar
- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

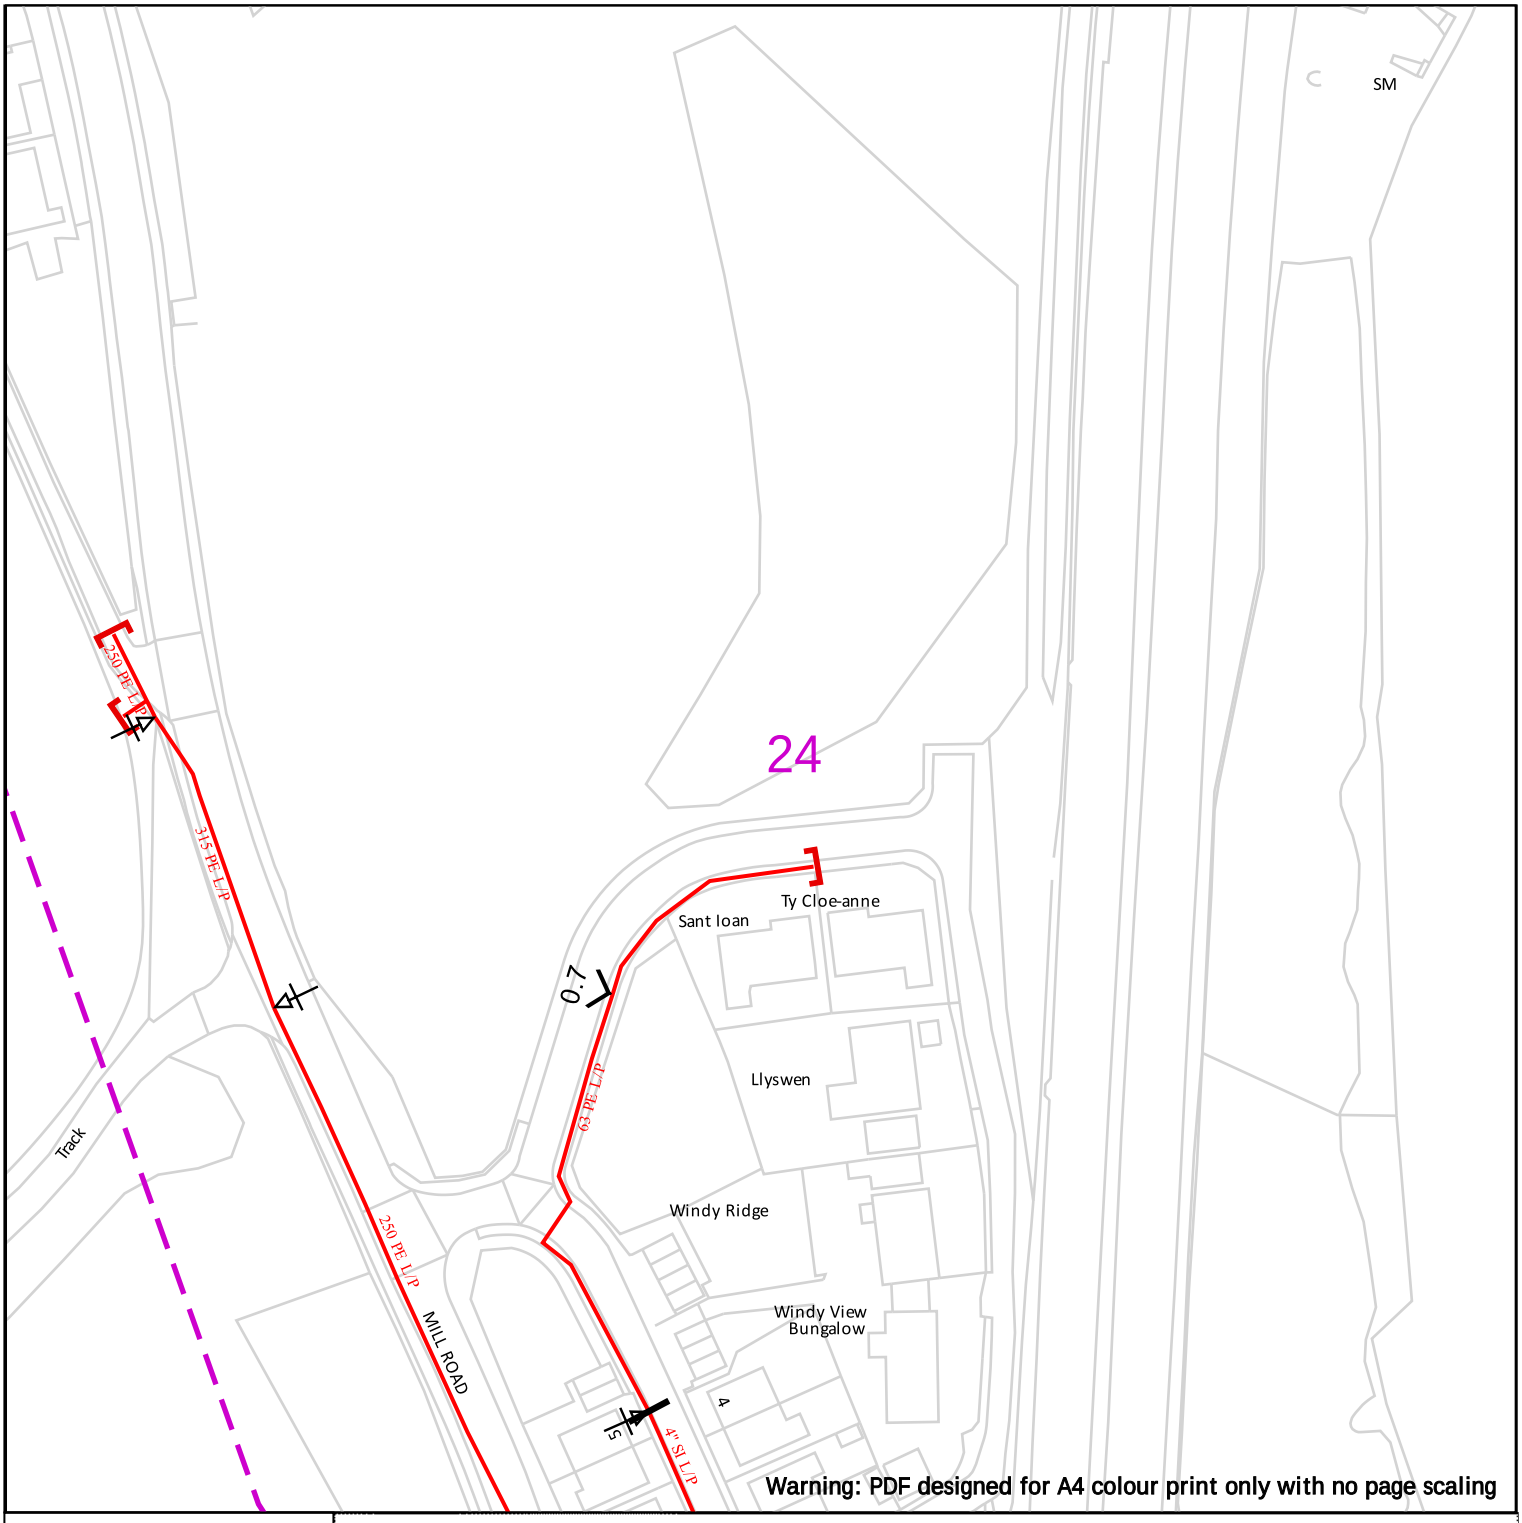

WALES&WEST UTILITIES

100m

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

Change of Diameter
End Cap
Depth of cover
Line/Fire Valve
Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Dial before you dig
Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

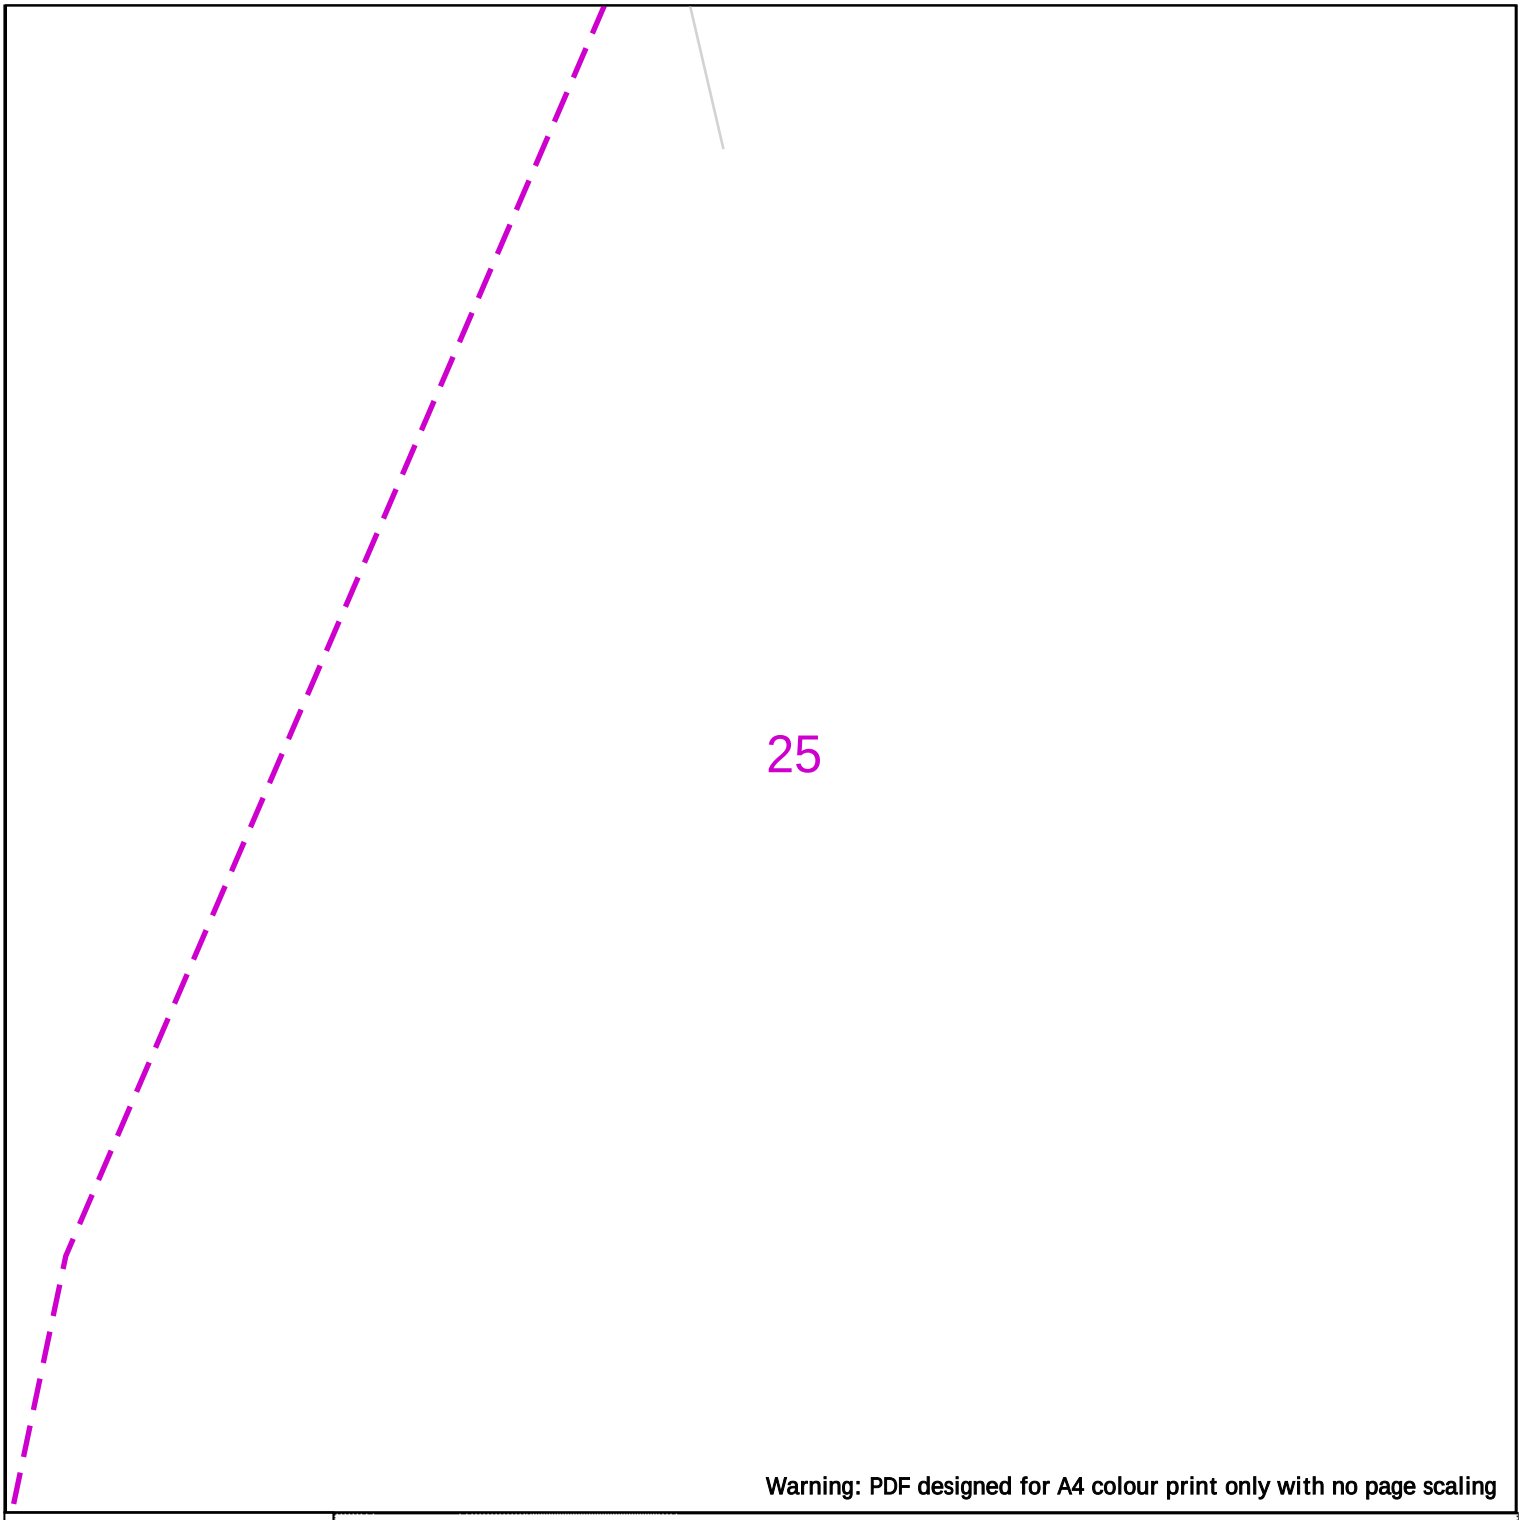

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

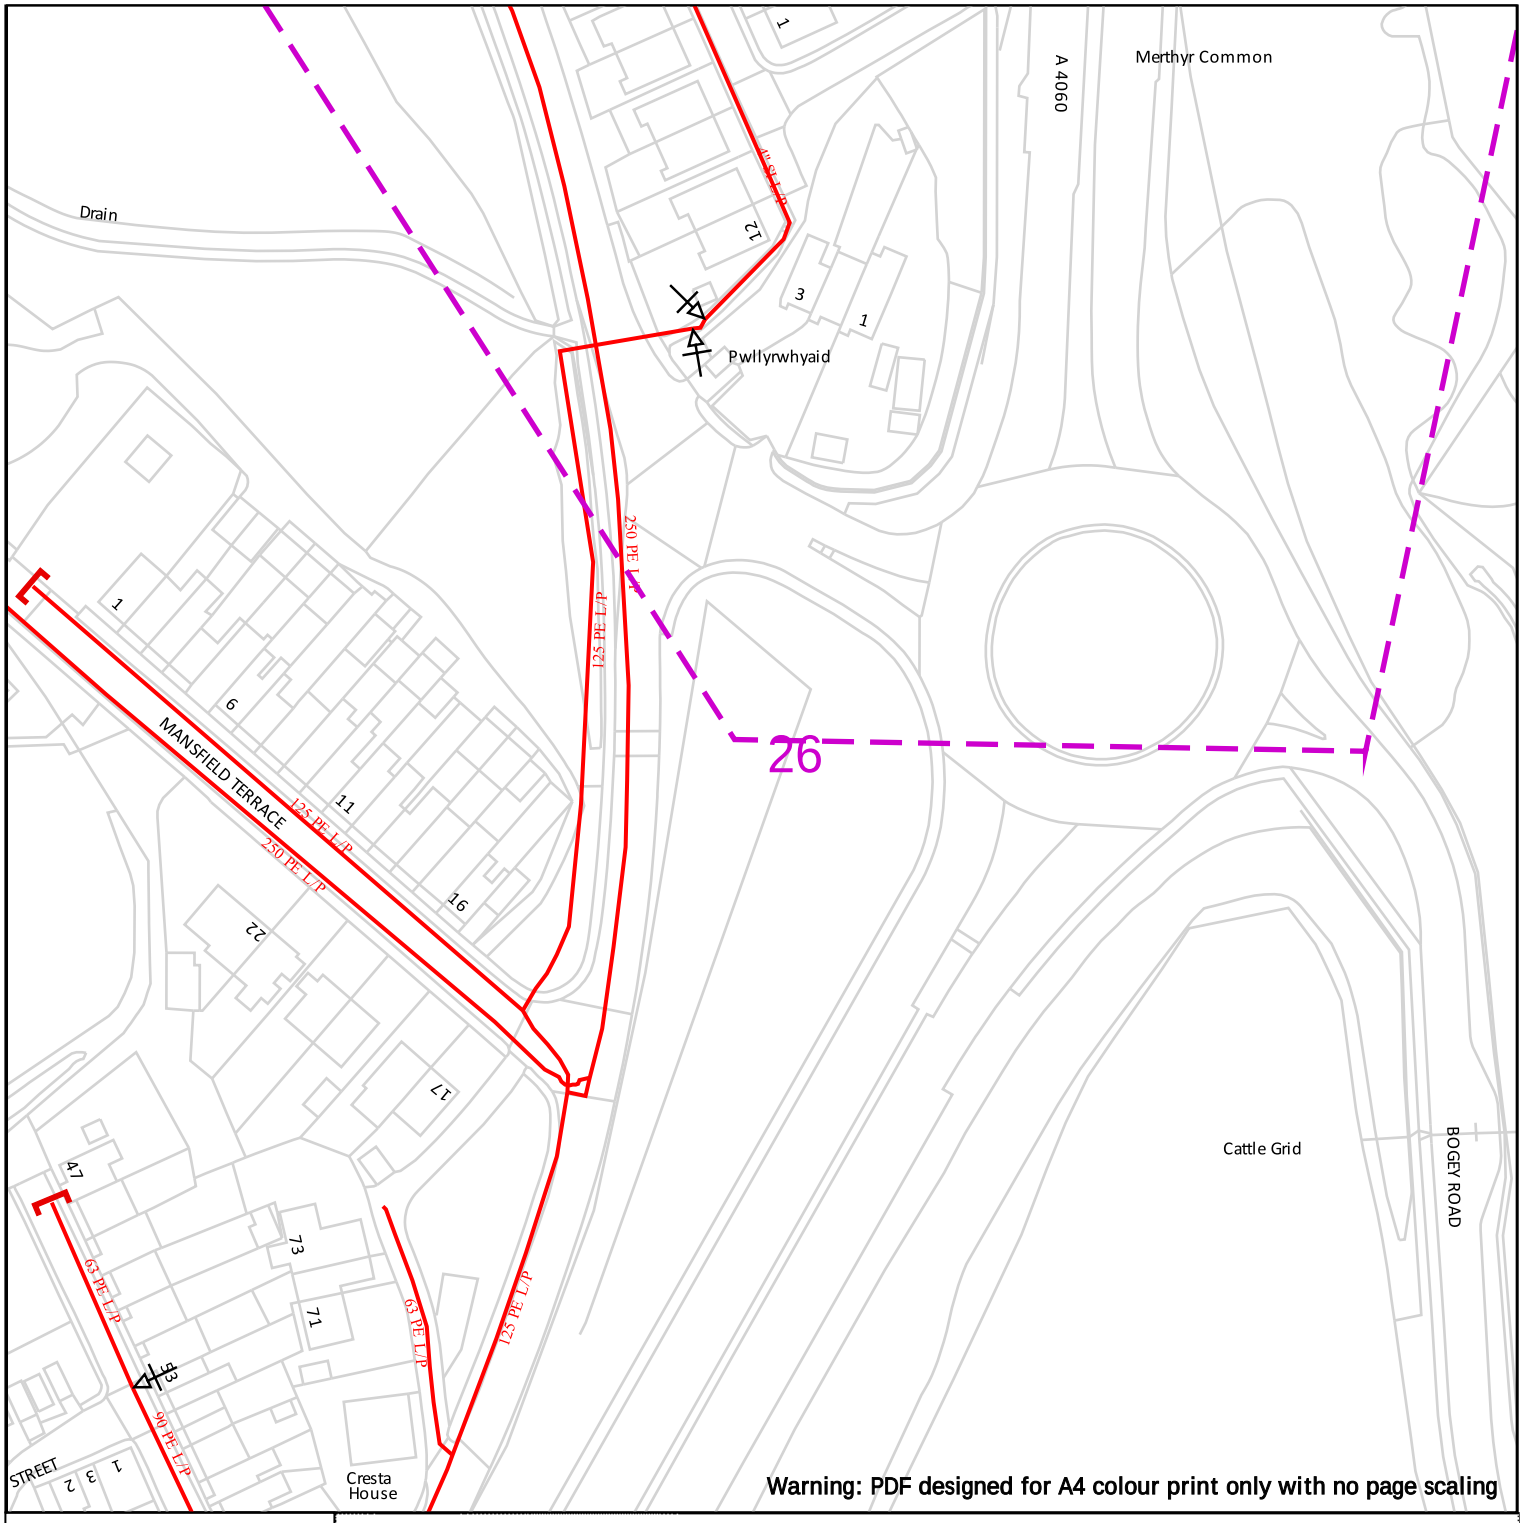

WALES&WEST UTILITIES

100m

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

Change of Diameter
End Cap
Depth of cover
Line/Fire Valve
Governor Station

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

Dial before you dig
Smell gas? Call the Gas Emergency Service on 0800 111 999.
Dial 029 2027 8912 before you start work.
Investigate Before you dig, make sure you know what's below.
Go ahead Done your research? Now you can dig safely.
We need 10 days' notice

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.

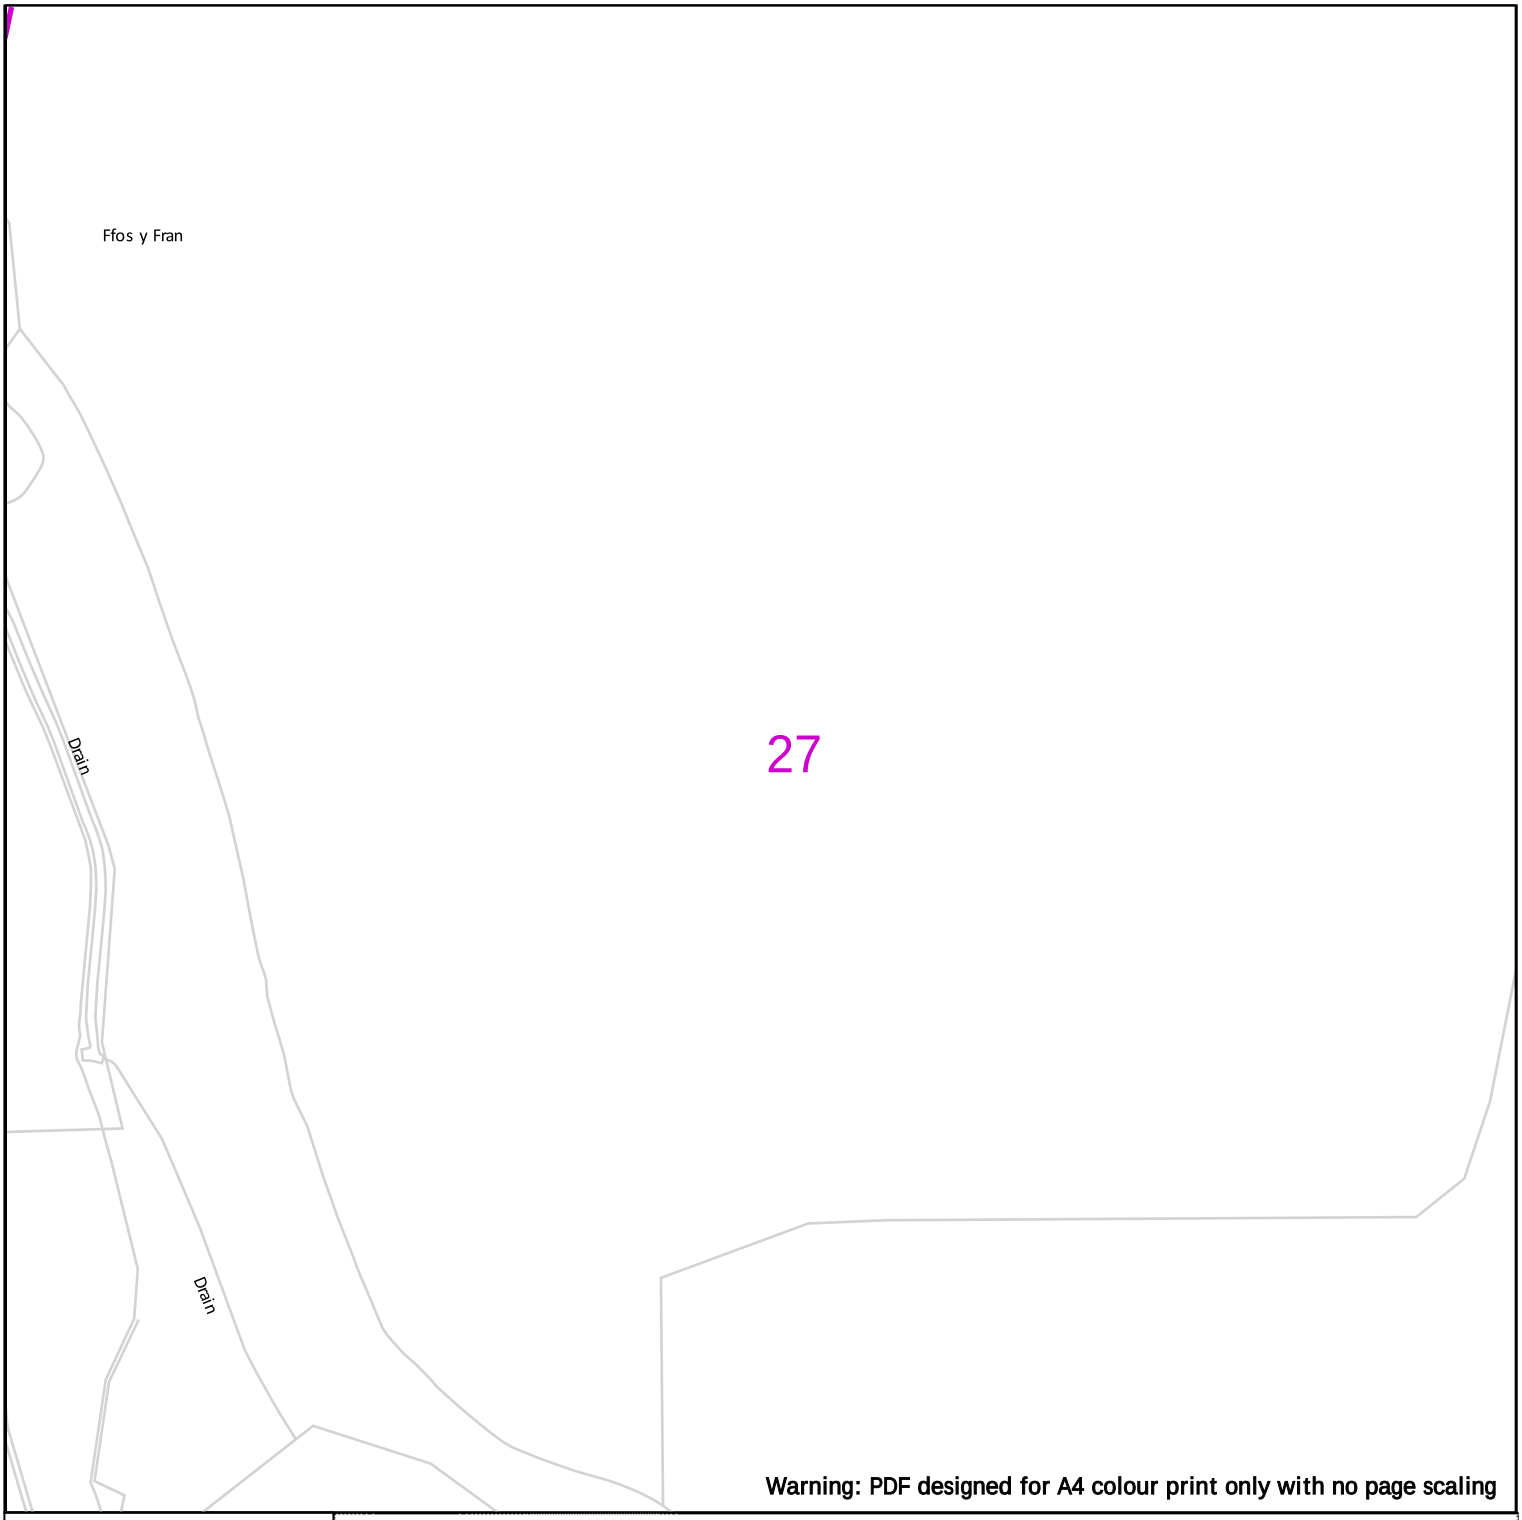

Warning: PDF designed for A4 colour print only with no page scaling

WALES&WEST UTILITIES

100m

Dig Sites Area: Line:

- Low Pressure (LP) 21mbar – 75mbar
- Medium Pressure (MP) 350mbar – 2bar
- Intermediate Pressure (IP) 2bar – 7bar
- High Pressure (HP) >7bar

- Change of Diameter
- End Cap
- Depth of cover
- Line/Fire Valve
- Governor Station

Contact Us
Mapping Enquiries:
All areas 02920 278 912
General Enquiries:
All areas 0800 912 2999

Date Requested: 14/11/2023
Job Reference: 31537673
Site Location: 306392 206954
Requested by: Mr Jason Chim

Your Scheme/Reference: 70118543

Scale: 1:1250 (When plotted at A4)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 27891

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 0100044308.